


Under Revision see DR 94095
Withdrawn April 1996



Australian Standard[®] 2950—1988

PROPYLENE COPOLYMER PRESSURE PIPE

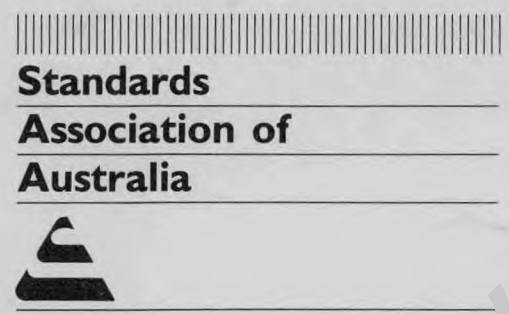

This Australian Standard was prepared by Committee PL/38, Polypropylene Pipe Systems. It was approved on behalf of the Council of the Standards Association of Australia on 8 June 1988 and published on 8 August 1988.

The following interests are represented on Committee PL/38:

Department of Public Works, N.S.W.
Engineering and Water Supply Department, S.A.
Federated Master Plumbers of Australia
Melbourne and Metropolitan Board of Works
Metropolitan Water Authority, W.A.
Rural Water Commission, Vic.
The Plastics Institute of Australia Inc.
Water Board, Sydney

Review of Australian Standards. To keep abreast of progress in industry, Australian Standards are subject to periodic review and are kept up-to-date by the issue of amendments or new editions as necessary. It is important therefore that Standards users ensure that they are in possession of the latest edition, and any amendments thereto.

Full details of SAA publications will be found in the Catalogue of SAA Publications; this information is supplemented each month by SAA's journal 'The Australian Standard', which subscribing members receive, which gives details of new publications, new editions and amendments, and of withdrawn Standards.

Suggestions for improvements to Australian Standards, addressed to the head office of the Association, are welcomed. Notification of any inaccuracy or ambiguity found in an Australian Standard should be made without delay in order that the matter may be investigated and appropriate action taken.

AUSTRALIAN STANDARD

**PROPYLENE COPOLYMER
PRESSURE PIPE**

AS 2950—1988

First published as AS 2950—1988.

**PUBLISHED BY THE STANDARDS ASSOCIATION OF AUSTRALIA
STANDARDS HOUSE, 80 ARTHUR ST, NORTH SYDNEY, N.S.W.**

ISBN 0 7262 5188 7

PREFACE

This Standard was prepared by the Association's Committee on Polypropylene Pipe Systems, under the authority of the Plastics Standards Board.

In the preparation of this Standard, the committee took cognizance of overseas experience, including BS 4991, *Specification for propylene copolymer pressure pipe*, ISO 1873/1, *Plastics—Polypropylene and (PP) propylene copolymer thermoplastics—Part 1: Designation*, and ISO 3212, *Polypropylene pipes—Burst test requirements*.

CONTENTS

	<i>Page</i>
FOREWORD	3
1 SCOPE	4
2 REFERENCED DOCUMENTS	4
3 DEFINITIONS	4
4 NOTATION	4
5 TYPE AND CLASSIFICATION	5
6 COMPOSITION	5
7 GENERAL REQUIREMENTS	5
8 TEST REQUIREMENTS	5
9 MARKING	5
10 STORAGE AND TRANSPORT	6
 APPENDICES	
A DETERMINATION OF COMPLIANCE OF A LOT	8
B METHOD FOR DETERMINING THE DIMENSIONS OF PIPE	10
C METHOD FOR HYDROSTATIC PRESSURE TESTING OF PRESSURE PIPES	11
D METHOD FOR DETERMINING THE IMPACT RESISTANCE OF PIPES	15
E METHOD FOR DETERMINING REVERSION OF PIPE	18
F RECOMMENDED WORKING PRESSURE OF PIPE ACCORDING TO PIPE MATERIAL TEMPERATURE	20

© Copyright — STANDARDS ASSOCIATION OF AUSTRALIA 1988

Users of Standards are reminded that copyright subsists in all SAA publications. Except where the Copyright Act otherwise allows, no part of this publication may be reproduced, stored in a retrieval system in any form or transmitted by any means without prior permission in writing of the Standards Association of Australia. Requests for permission should be directed to the Head Office of the Association. Where such requests relate to the reproduction of the whole or a substantial part of any Standard, permission may be conditional on an appropriate royalty payment.

FOREWORD

The hydrostatic design stress of 5 MPa specified in this Standard has been determined by the application of a safety factor of 1.8 to the extrapolated 50-year long-term hydrostatic stress value. This has been taken from ISO 3213.

Minimum wall thickness for pipes specified has been calculated using the Barlow formula which takes into account the hydrostatic design stress of the material, working pressure and diameter of pipes.

The Barlow formula used for calculating the maximum wall thickness is as follows:

$$T_{\min} = \frac{PD_{\text{m max}}}{2S + P}$$

$$T_{\max} = 1.10T_{\min} + 0.1$$

where

T_{\min} = minimum wall thickness of pipe, in millimetres

P = maximum allowable working pressure at 20°C, in megapascals

$D_{\text{m max}}$ = maximum mean outside diameter, in millimetres

S = hydrostatic design stress at 20°C, in megapascals

T_{\max} = maximum wall thickness of pipe, in millimetres.

In the interests of serviceability, and irrespective of the calculated minimum wall thickness, this Standard does not provide for a wall thickness of less than 1.6 mm.

STANDARDS ASSOCIATION OF AUSTRALIA

Australian Standard

PROPYLENE COPOLYMER PRESSURE PIPE

1 SCOPE. This Standard specifies requirements for black or grey propylene copolymer pressure pipe for the conveyance of water in water supply, agricultural, industrial, and other applications. Pipes manufactured in accordance with this Standard are not intended for the transport of gaseous fuels (see AS 1667 and AS 2718). Propylene copolymer pipe of colour other than black, may not be suitable for storage or use where exposed to direct sunlight.

The Standard specifies requirements for dimensions, freedom from defects, impact characteristics, reversion, short term and long term hydrostatic pressure resistance and effect on water.

Test requirements included in this Standard are only applicable to pipe at the time of manufacture or after a conditioning period or test period as detailed in the particular test method. Tests performed at times other than those specified may provide different results due to either change in the properties of the propylene copolymer or the service history of the pipe specimens.

NOTES:

1. Advisory information on alternative methods of determining compliance of a lot with this Standard is given in Appendix A.
2. Pipes manufactured in accordance with this Standard may be suitable for the conveyance of fluids other than water. Advice should be sought from the manufacturer.
3. Exposure to direct sunlight may reduce the service life of propylene copolymer pipe. Advice should be sought from the pipe manufacturer where this may be important.
4. Tests specified in Clauses 7.1, 7.2, 7.3, 8.1, 8.2 and 8.3 are type tests performed to assess compliance of finished product with this Standard, however it may also be convenient for product manufacturers to use those tests for quality control purposes during manufacture.

2 REFERENCED DOCUMENTS. The documents below are referred to in this Standard:

AS

- 1199 Sampling procedures and tables for inspection by attributes
- 1349 Bourdon tube pressure and vacuum gauges
- 1399 Guide to AS 1199, Sampling procedures and tables for inspection by attributes
- 1667 Plastics pipes and fittings for gas reticulation—Polyethylene—Nominal size series
- 1821–1823 Suppliers quality systems
- 1901 Vernier callipers (metric series)
- 2000 Guide to AS 1821–1823, Suppliers quality control systems
- 2033 Installation of polyethylene pipe systems
- 2102 External micrometers (metric series)
- 2490 Sampling procedures and charts for inspection by variables for percent defective
- 2718 Plastics pipes and fittings for gas reticulation—Polyethylene—Outside diameter series
- 2949 Propylene copolymer compounds for the manufacture of pressure pipe and fittings

- 3900 Quality systems—Guide to selection and use
- 3901 Quality systems for design/development, production, installation and servicing
- 3902 Quality systems for production and installation
- 3903 Quality systems for final inspection and test
- 3904 Quality systems—Guide to quality management and quality system elements

ISO

- 3213 Polypropylene pipes—Reduction of permissible stress as a function of time and temperature

3 DEFINITIONS. For the purpose of this Standard, the definitions below apply:

3.1 Hoop stress—the stress in a pipe or fitting under pressure acting tangentially to the perimeter of a transverse section.

3.2 Long-term hydrostatic stress—the continuously applied hoop stress which is estimated will cause failure at a specified time and temperature.

3.3 Hydrostatic design stress—the hoop stress due to internal hydrostatic pressure that can be applied continuously at a specified temperature. It is obtained by the application of a safety factor to the extrapolated 50-year long-term hydrostatic stress value.

3.4 Working pressure—the maximum pressure that can be sustained by the type and class of pipe or fitting for its estimated useful life under the expected working conditions.

3.5 Pipe material temperature—the average temperature estimated as applying through the full wall thickness.

3.6 Type test—a test intended to prove the suitability and performance of a new composition, a new compounding or processing technique, or a new design or size of pipe, joint or fitting. Type tests are generally carried out when a change is made in compound composition or method of manufacture.

3.7 Quality control test—a test carried out during or after manufacture to prove the quality of a production run of pipe or fittings.

4 NOTATION. The following notation applies in this Standard:

D_e = nominal outside diameter, in millimetres.

D_m = mean outside diameter, in millimetres.

D_i = mean inside diameter, in millimetres.

D_o = outside diameter including ovality, in millimetres

T = wall thickness, in millimetres.