

ASCE 19-96

American Society of Civil Engineers

Structural Applications of Steel Cables for Buildings

Published by

ASCE *American Society
of Civil Engineers*

345 East 47th Street
New York, NY 10017-2398

Abstract:

This Standard provides requirements for the structural design, construction contract documents, fabrication, and installation of cables for use as structural elements for the support and bracing of buildings, their roofs, and their floors. It specifically covers such topics as drawings and specifications; design considerations; cable materials; fittings; protective coatings; fabrication; and erection.

Library of Congress Cataloging-in-Publication Data

Structural applications of steel cables for buildings

p. cm.

ISBN 0-7844-0245-0

1. Cable structures--Standards--United States. 2. Cables--Standards--United States.

TA660.C3C76 1997 97-16275

624.1'774--dc21 CIP

Photocopies. Authorization to photocopy material for internal or personal use under circumstances not falling within the fair use provisions of the Copyright Act is granted by ASCE to libraries and other users registered with the Copyright Clearance Center (CCC) Transactional Reporting Service, provided that the base fee of \$4.00 per article plus \$.50 per page is paid directly to CCC, 222 Rosewood, Drive, Danvers, MA 01923. The identification for ASCE Books is 0-7844-0245-0/97/\$4.00 + \$.50 per page. Requests for special permission or bulk copying should be addressed to Permissions & Copyright Dept., ASCE.

Copyright © 1997 by the American Society of Civil Engineers,
All Rights Reserved.

Library of Congress Catalog Card No: 97-16275

ISBN 0-7844-0245-0

Manufactured in the United States of America.

STANDARDS

In April 1980, the Board of Direction approved ASCE Rules for Standards Committees to govern the writing and maintenance of standards developed by the Society. All such standards are developed by a consensus standards process managed by the Codes and Standards Activities Committee. The consensus process includes balloting by the balanced standards committee, which is composed of Society members and nonmembers, balloting by the membership of ASCE as a whole, and balloting by the public. All standards are updated or reaffirmed by the same process at intervals not exceeding five years.

The following standards have been issued.

- ANSI/ASCE 1-82 N-725 Guideline for Design and Analysis of Nuclear Safety Related Earth Structures
- ANSI/ASCE 2-91 Measurement of Oxygen Transfer in Clean Water
- ANSI/ASCE 3-91 Standard for the Structural Design of Composite Slabs and ANSI/ASCE 9-91 Standard Practice for the Construction and Inspection of Composite Slabs
- ANSI/ASCE 4-86 Seismic Analysis of Safety-Related Nuclear Structures
- ACI 530-95/ASCE 5-95/TMS402-95 Building Code Requirements for Masonry Structures
- ACI 530.1-95/ASCE 6-95/TMS602-95 Specifications for Masonry Structures
- ANSI/ASCE 7-95 Minimum Design Loads for Buildings and Other Structures
- ANSI/ASCE 8-90 Specification for the Design of Cold-Formed Stainless Steel Structural Members
- ANSI/ASCE 9-91 listed with ASCE 3-91
- ANSI/ASCE 10-90 Design of Latticed Steel Transmission Structures
- ANSI/ASCE 11-90 Guideline for Structural Condition Assessment of Existing Buildings
- ANSI/ASCE 12-91 Guideline for the Design of Urban Subsurface Drainage
- ASCE 13-93 Standard Guidelines for Installation of Urban Subsurface Drainage
- ASCE 14-93 Standard Guidelines for Operation and Maintenance of Urban Subsurface Drainage
- ASCE 15-93 Standard Practice for Direct Design of Buried Precast Concrete Pipe Using Standard Installations (SIDD)
- ASCE 16-95 Standard for Load and Resistance Factor Design (LRFD) of Engineered Wood Construction
- ASCE 17-96 Air-Supported Structures
- ASCE 18-96 Standard Guidelines for In-Process Oxygen Transfer Testing
- ASCE 19-96 Structural Applications of Steel Cables for Buildings
- ASCE 20-96 Standard Guidelines for the Design and Installation of Pile Foundations
- ASCE 21-96 Automated People Mover Standards—Part I

Currently in preview, click buy full version

FOREWORD

The material presented in this Standard has been prepared in accordance with recognized engineering principles. This Standard should not be used without first securing competent advice with respect to its suitability for any given application. The publication of the material contained herein is not intended as a representation or warranty on the part

of the American Society of Civil Engineers, or of any other person named herein, that this information is suitable for any general or particular use or promises freedom from infringement of any patent or patents. Anyone making use of this information assumes all liability from such use.

Currently in preview, click buy full version

ACKNOWLEDGMENTS

The American Society of Civil Engineers (ASCE) acknowledges the devoted efforts of the Structural Applications of Steel Cables for Buildings Standards Committee of the Codes and Standards Activities Committee. This group comprises individuals from many backgrounds including: consulting engineering, research, construction industry, education, government, design, and private practice.

Blair Birdsall
Charles Birnstiel, Chair
John E. Bower
Dale T. Cich
Edward Cohen
James S. Cohen
Paul A. Gossen
Robert Hogenson
Michael H. Humwaldt
Jean-Jacques Jonatowski
Jerry King
Perm Krishna
Ronald M. Mayrbaur, Secretary
Gerard J. McGuire
Woods F. McRoy
Larry D. Means

This Standard was prepared through the consensus standards process by balloting in compliance with procedures of ASCE's Codes and Standards Activities Committee. Those individuals who serve on the Structural Applications of Steel Cables for Buildings Standards Committee are:

Nicholas F. Morris
Frank W. Neeld, Jr.
John W. Nixon
James E. Persing
Dennis Poffenroth
Donald Sayenga
Reinhold M. Schuster
Paul A. Seaburg
Thomas E. Secules, Vice Chair
David M. Sleightholm
Charles H. Thornton
George S. Tseng

Currently in preview, click buy full version

Contents

PAGE

STANDARDS	iii
FOREWORD	v
ACKNOWLEDGMENTS	vii
1 General	1
1.1 Scope	1
1.2 Glossary	1
1.3 Symbols and Notation	1
1.4 Reference Standards	1
2 Drawings and Specifications	2
2.1 Construction Contract Documents	2
2.1.1 Contract drawings	2
2.1.2 Contract specifications	2
2.2 Fabrication (Shop) Drawings	2
2.3 Erection (Field) Drawings	2
3 Design Considerations	2
3.1 Design Loadings	2
3.1.1 Loads	2
3.1.2 Load combinations	3
3.2 Cable Strength	3
3.2.1 Design strength	3
3.2.1.1 Fitting reduction factor	3
3.2.1.2 Deflector reduction factor	3
3.2.1.3 Elevated temperature effect	3
3.2.1.4 Fatigue effect	3
3.2.2 End fittings	4
3.3 Structural Analysis	4
3.3.1 General considerations	4
3.3.2 Vibrations	4
3.3.3 Deflections	4
3.3.4 Erection analyses	4
4 Cable Materials	4
4.1 Cable Specifications	4
4.2 Prestretching	4
5 Fittings	5
5.1 Materials	5
5.2 Inspection	5
5.3 End Fittings	5
5.3.1 Zinc-poured fittings	5
5.3.2 Resin-poured fittings	5
5.3.3 Swaged, clip, and wedge-type fittings	5
5.4 Saddles	5
5.5 Clamps	5
6 Protective Coatings	5
7 Fabrication	5
7.1 Socketing	5
7.2 Proof Loading of Assemblies	6

STRUCTURAL APPLICATIONS OF STEEL CABLES FOR BUILDINGS

7.3	Prestretching	6
7.4	Cable Length Measurements	6
7.5	Striping	6
7.6	Shipping	6
8	Erection	6
8.1	Erection Procedure	6
8.2	Cable Installation	6
8.3	Intermediate Fittings	6
8.4	Permanent Fittings Attached in the Field	6
COMMENTARY		
C1.0	General	7
C2.0	Drawings and Specifications	7
C3.0	Design Considerations	8
C4.0	Cable Materials	9
C5.0	Fittings	9
C6.0	Protective Coatings	9
C7.0	Fabrication	10
C8.0	Erection	10
References		11
Appendix A	—Examples of End Fittings	12
Appendix B	—Saddles	15
Appendix C	—Clamps	16
Index		17

1.0 General

1.1 Scope

This Standard provides requirements for the structural design, construction contract documents, fabrication, and installation of cables for use as structural elements for the support and bracing of buildings, their roofs, and their floors. Herein the word cable denotes a structural member that is a helically twisted wire strand or wire rope, or a parallel wire strand; its suitability as a structural member is essentially its capability for resisting tension. This Standard covers the use, for buildings, of carbon steel and stainless steel cables comprised of wires either uncoated or having a protective coating.

1.2 Glossary

Anchorage: a structural member at which the cable is terminated.

Cable: a flexible tension member consisting of a wire strand or a multiplicity of wire strands forming a wire rope.

Clamp: a cable fitting that transfers force by friction.

Damper: an active or passive device attached to the cable structure that modifies the structural response to dynamic loads.


Deflector: a grooved cable support used to create an angle change in the cable, also known as a saddle.

Fitting: any accessory used as an attachment to, or support for, the cable or its components.

Grade: classification of cable by nominal cable strength and/or metallic composition of wire.

Modulus of Elasticity: the slope of the secant to the stress-strain curve between 10% of the nominal cable strength and 90% of the prestretching force.

Nominal Cable Strength: the nominal cable strength of a cable is a computed value based on the breaking strength of the individual wires and the type of cable, as given in ASTM Standards.

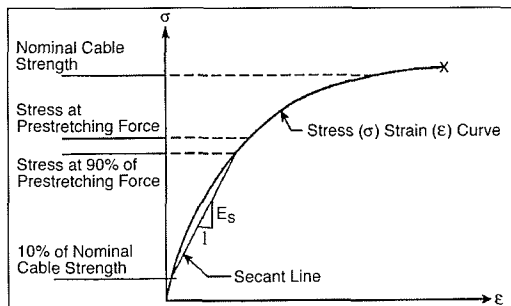

Prestressing: applying a tensile force to a cable at the time of its installation.

Prestretching: applying a tensile force to a helically twisted cable according to a predetermined program in order to remove constructional stretch in the cable.

Prestretching Force: tensile force applied to a cable one or more times and held for a specified duration during prestretching.

Rope: A plurality of strands twisted about an axis, or about a core which may be a strand or another wire rope.

Strand: a plurality of wires either parallel or helically twisted about an axis, usually about a central wire.

Termination: a device, also known as an end fitting, attached to a cable to transfer the tension in the cable to its supporting anchorage. A termination may also be a loop formed from the end of a rope.

Wire: a single continuous length of steel with a circular or noncircular cross-section. Wires of circular cross-section are cold-drawn from rod. Wires of noncircular cross-section are either cold-drawn or cold-rolled from rod.

1.3 Symbols and Notation

C = Erection or temporary load during construction

D = Dead load due to weight of the structure and the permanent features on the structure

E = Earthquake load

E_s = Modulus of elasticity (secant)

L = Live load due to occupancy and movable equipment

L_r = Roof live load

P = Prestress force

R = Load due to initial rainwater exclusive of the ponding contribution

S = Snow load

S_d = Design strength of the cable

S_n = Nominal strength of the cable

T = Cable tension

W = Wind load

ϕ_d = Deflector reduction factor

ϕ_f = Fitting reduction factor

1.4 Reference Standards

ASCE 7-95 *Minimum Design Loads for Buildings and Other Structures*.