

Australian/New Zealand Standard™

**Information technology —
Implementation and operation of
customer premises cabling**

**Part 2: Planning and installation
(ISO/IEC 14763-2 (ED. 2.0) MOD)**



AS/NZS 14763.2:2020

This Joint Australian/New Zealand Standard™ was prepared by Joint Technical Committee CT-001, Communications Cabling. It was approved on behalf of the Council of Standards Australia on 15 June 2020 and by the New Zealand Standards Approval Board on 3 June 2020.

This Standard was published on 26 June 2020.

The following are represented on Committee CT-001:

- Australian Chamber of Commerce and Industry
- Australian Council of Trade Unions
- Australian Digital and Telecommunications Industry Association
- Australian Industry Group
- Australian Information Industry Association
- BICSI South Pacific, Australia
- BICSI South Pacific, New Zealand
- Energy Networks Australia
- Engineers Australia
- KNX National Group
- National Electrical and Communications Association
- Telecommunications Users Association of New Zealand
- Telstra Corporation

This Standard was issued in draft form for comment as DR AS/NZS 14763.2:2020.

Keeping Standards up-to-date

Ensure you have the latest versions of our publications and keep up-to-date about Amendments, Rulings, Withdrawals, and new projects by visiting:

www.standards.org.au

www.standards.govt.nz

ISBN 978 1 76072 892 2

Australian/New Zealand Standard™

**Information technology —
Implementation and operation of
customer premises cabling**

**Part 2: Planning and installation
(ISO/IEC 14763-2 (ED. 2.0) MOD)**

Originates as AS/NZS ISO/IEC 14763.2:2014.
Revised and redesignated as AS/NZS 14763.2:2020.

COPYRIGHT

© ISO/IEC 2020 — All rights reserved

© Standards Australia Limited/the Crown in right of New Zealand, administered by the New Zealand Standards Executive 2020

All rights are reserved. No part of this work may be reproduced or copied in any form or by any means, electronic or mechanical, including photocopying, without the written permission of the publisher, unless otherwise permitted under the Copyright Act 1968 (Cth) or the Copyright Act 1994 (New Zealand).

Preface

This document was prepared by the Joint Standards Australia/Standards New Zealand Committee CT-001 Communications Cabling, to supersede AS/NZS ISO/IEC 14763.2:2014, *Information technology — Implementation and operation of customer premises cabling, Part 2: Planning and installation*.

The objective of this document is to specify requirements for the planning, installation and operation of telecommunications cabling and cabling infrastructures including cabling, pathways, spaces and telecommunications bonds (other than that specified in AS 30129) in support of generic cabling standards and associated documents.

The following aspects are addressed:

- (a) Specification of the installation.
- (b) Quality assurance.
- (c) Installation planning.
- (d) Installation practice.
- (e) Documentation.
- (f) Administration.
- (g) Testing.
- (h) Inspection.
- (i) Operation.
- (j) Maintenance.
- (k) Repair.

This document describes the methodology for the assessment of spaces, pathways, pathway systems and cabling (either installed or planned) in support of remote powering objectives.

This document is applicable to certain hazardous environments but does not exclude additional requirements which are applicable in particular circumstances, e.g. electricity supply and electrified railways.

This second edition includes the following significant technical changes with respect to the previous edition:

- (i) Inclusion of planning and installation practices to support remote powering over the telecommunications cabling infrastructure.
- (ii) Inclusion of planning and installation practices outside buildings.

This document includes specific requirements applicable to other cabling systems (e.g. power supply cabling); however, it takes account of the effects other cabling systems may have on the installation of telecommunications cabling (and vice versa) and gives general advice.

This document excludes those aspects of installation associated with the transmission of signals in the space between transmitters, receivers or their associated antenna systems, e.g. wireless, radio, microwave or satellite.

Safety and electromagnetic compatibility (EMC) requirements are outside the scope of this document and are covered by other standards and regulations. However, information given in this document can be of assistance in meeting these standards and regulations.

This document is an adoption with national modifications, and has been reproduced from, ISO/IEC 14763-2:2019, *Information technology — Implementation and operation of customer premises cabling — Part 2: Planning and installation*. The modifications are additional requirements and are set out in Appendix ZZ, which has been added at the end of the source text.

Appendix ZZ lists the variations to ISO/IEC 14763-2:2019 for the application of this in Australia and New Zealand.

As this document has been reproduced from an International Standard, the following applies:

- (A) In the source text “this part of ISO/IEC 14763” should read “this Australian/New Zealand Standard”
- (B) A full point substitutes for a comma when referring to a decimal marker.

Australian or Australian/New Zealand Standards that are identical adoptions of international normative references may be used interchangeably. Refer to the online catalogue for information on specific Standards.

The terms “normative” and “informative” are used in Standards to define the application of the appendices or annexes to which they apply. A “normative” appendix or annex is an integral part of a Standard, whereas an “informative” appendix or annex is only for information and guidance.

CONTENTS

FOREWORD.....	9
INTRODUCTION.....	11
1 Scope.....	13
2 Normative references	14
3 Terms, definitions and abbreviated terms	15
3.1 Terms and definitions.....	15
3.2 Abbreviated terms.....	20
3.3 Conventions.....	21
4 Conformance.....	21
5 Specification of installations	21
5.1 General.....	21
5.2 Installation specification.....	22
5.2.1 Requirements	22
5.2.2 Recommendations	23
5.3 Technical specification.....	24
5.3.1 General	24
5.3.2 Notification of hazards	24
5.3.3 Security requirements.....	25
5.3.4 Performance and configuration – Requirements.....	25
5.3.5 Environmental conditions.....	27
5.4 Scope of work.....	28
5.4.1 Pre-installation	28
5.4.2 Installation.....	29
5.4.3 Post-installation.....	30
5.5 Quality assurance.....	30
6 Quality planning.....	30
6.1 Quality plan	30
6.2 Specification of cabling components	31
6.3 Sampling.....	32
6.3.1 Balanced cabling.....	32
6.3.2 Optical fibre cabling.....	34
6.4 Treatment of marginal results.....	36
6.4.1 Balanced cabling	36
6.4.2 Optical fibre cabling.....	36
6.5 Treatment of non-compliant results	36
6.6 Change control	36
7 Installation planning.....	36
7.1 General.....	36
7.2 Safety	37
7.2.1 General	37
7.2.2 Low voltage power supply cabling.....	37
7.2.3 Telecommunications cables fire performance	37
7.2.4 Optical fibre cabling.....	37
7.2.5 Transmission and terminal equipment.....	37
7.3 Environment.....	37
7.4 Points of electrical contact	38

7.5	External service provision	38
7.5.1	Requirements	38
7.5.2	Recommendations	38
7.6	Pathways and pathway systems	38
7.6.1	General	38
7.6.2	Inside buildings	42
7.6.3	Outside buildings	49
7.7	Spaces	61
7.7.1	Requirements	61
7.7.2	Recommendations	66
7.8	Functional elements	68
7.8.1	Requirements	68
7.8.2	Recommendations	70
7.9	Segregation of telecommunications cabling and power supply cabling inside buildings	70
7.9.1	General	70
7.9.2	Requirements	72
7.9.3	Recommendations	78
7.10	Segregation of underground telecommunications cabling and power supply cabling outside buildings	78
7.10.1	General	78
7.10.2	Power supply cabling \leq AC 1 000 V RMS or DC 1 500 V	78
7.10.3	Power supply cabling $>$ AC 1 000 V RMS or DC 1 500 V	79
7.10.4	Earthing systems	80
7.10.5	Other infrastructures	81
7.11	Segregation of aerial telecommunications cabling	82
7.11.1	General	82
7.11.2	Overhead power supply infrastructures	82
7.11.3	Sharing of infrastructures carrying \leq 1 000 V AC (1 500 V DC)	84
7.11.4	Sharing of infrastructures carrying $>$ 1 000 V AC (1 500 V DC)	86
7.12	Planning for repair	86
7.13	Cabling – Requirements	87
7.13.1	General	87
7.13.2	Unscreened cabling	87
7.13.3	Screened cabling	87
7.13.4	Optical fibre cabling	87
7.14	Planning and assessment of cabling in support of remote powering objectives	88
7.14.1	General	88
7.14.2	Remote powering installations of Category RP3	88
7.14.3	Connecting hardware	92
	Installation practices	93
8.1	General	93
8.2	Safety	93
8.2.1	General	93
8.2.2	Power supply cabling	93
8.2.3	Telecommunications cables fire performance	93
8.2.4	Optical fibre cabling	93
8.2.5	Guards and signs	94

8.2.6	Enclosed spaces	94
8.2.7	Maintenance holes.....	94
8.2.8	Closures	94
8.3	Environment.....	94
8.3.1	Storage.....	94
8.3.2	Installation – Requirements	94
8.4	Component inspection and testing – Requirements	94
8.5	Pathways	95
8.5.1	Requirements	95
8.5.2	Recommendations	96
8.6	Spaces	96
8.6.1	Requirements	96
8.6.2	Recommendations	97
8.7	Pathway system installation	97
8.7.1	General	97
8.7.2	Inside buildings	98
8.7.3	Outside buildings	98
8.8	Closure installation	98
8.9	Cable installation	99
8.9.1	Cable installation within pathway systems	99
8.9.2	Inside buildings	100
8.9.3	Cable installation in maintenance holes	101
8.9.4	Cable installation within closures – Requirements.....	102
8.10	Jointing and terminating of cables.....	102
8.10.1	Requirements	102
8.10.2	Balanced cabling	103
8.10.3	Screened balanced cabling	103
8.10.4	Optical fibre cabling.....	103
8.11	Cords and jumpers.....	103
8.12	Surge protective devices.....	103
8.13	Acceptance	104
8.13.1	Inspection.....	104
8.13.2	Testing	104
9	Documentation and administration.....	104
9.1	Symbols and preparation of documents.....	104
9.1.1	Requirements	104
9.1.2	Recommendations	104
9.2	Administration.....	104
9.2.1	General	104
9.2.2	Administration system.....	105
9.2.3	Identifiers – Requirements	109
9.2.4	Component labelling	109
9.2.5	Records.....	112
9.2.6	Cable administration system.....	116
9.2.7	Reports.....	119
10	Testing.....	119
10.1	General.....	119
10.1.1	Links and permanent links	119
10.1.2	Channels	120

10.1.3	Cabling interface adapters	121
10.1.4	Calibration	121
10.1.5	Equipment protection	121
10.1.6	Measurement conditions	122
10.2	Test procedures for balanced cabling	122
10.2.1	General	122
10.2.2	Measurement of length-related parameters	122
10.2.3	Treatment of marginal test results	122
10.2.4	Treatment of unacceptable test results	122
10.2.5	Test result format	122
10.2.6	Test result documentation	123
10.3	Test procedures for optical fibre cabling	123
10.3.1	General	123
10.3.2	Treatment of unacceptable test results	123
10.3.3	Test result documentation	124
11	Inspection	124
11.1	General	124
11.2	Inspection Level 1	124
11.3	Inspection Level 2	125
11.4	Inspection Level 3	125
11.5	Inspection documentation – Requirements	125
12	Operation	126
12.1	Connection of equipment	126
12.2	Standard operating procedure	126
12.2.1	Requirements	126
12.2.2	Recommendations	126
12.3	Cords and jumpers	126
12.4	Optical fibre adapters	126
13	Maintenance	127
13.1	Approaches to maintenance	127
13.1.1	General	127
13.1.2	Requirements	127
13.2	Maintenance procedures	127
13.2.1	Requirements	127
13.2.2	Recommendations	127
14	Repair	128
Annex A (normative)	Optical fibre polarity maintenance: connecting hardware for multiple optical fibres	129
Annex B (normative)	Common infrastructures within multi-tenant premises	143
Annex C (normative)	Cabling in accordance with ISO/IEC 11801-2	151
Annex D (normative)	Cabling in accordance with ISO/IEC 11801-3	153
Annex E (normative)	Cabling in accordance with ISO/IEC 11801-4	156
Annex F (normative)	Cabling in accordance with ISO/IEC 11801-5	162
Annex G (normative)	Cabling in accordance with ISO/IEC 11801-6	166
Annex H (informative)	Equipment accommodation environments	168
Annex I (normative)	Information for remote powering	169
Bibliography	173

Figure 1 – Schematic relationship between ISO/IEC 14763-2 and other relevant International Standards and Technical Reports	12
Figure 2 – Quality assurance schematic.....	22
Figure 3 – Conductor current for IEEE 802.3 remote powering applications	26
Figure 4 – Examples of conformant and non-conformant bend radius management	44
Figure 5 – Example of use of curved corners in pathway systems	46
Figure 6 – Example of layered cable trays with smaller width upper trays	48
Figure 7 – Example of uncovered (accessible) row of floor tiles to provide access to lower tray.....	48
Figure 8 – Example of cabling installations outside buildings	49
Figure 9 – Example of wind vibration damper.....	61
Figure 10 – Dimensions of rooms intended to contain distributors.....	63
Figure 11 – Process of determining cable separation	72
Figure 12 – Flowchart for cable separation calculation.....	75
Figure 13 – Separation of power supply and telecommunications cables without dividers.....	76
Figure 14 – Assumed minimum separation of power supply and telecommunications cables with dividers	77
Figure 15 – Example of cable separation distance	77
Figure 16 – Example showing the protection of underground information technology cables when located next to power supply cables	79
Figure 17 – Separation of adjacent infrastructures	83
Figure 18 – Separation distances on supporting structures	85
Figure 19 – Separation distance on supporting structures with lighting devices.....	85
Figure 20 – Separation of cable bundles to minimize heating	101
Figure 21 – Examples of labels indicating RP Category of remote powering installation	108
Figure 22 – Examples of cord and jumper labelling	111
Figure 23 – Cable administration database and possible linkages.....	117
Figure 24 – Basic cabling administration.....	117
Figure 25 – Examples of cabling permanent links.....	120
Figure 26 – Reference planes for link and channels (point-to-point).....	120
Figure 27 – Example of a cabling channel.....	121
Figure A.1 – Duplex connecting hardware plug	130
Figure A.2 – Duplex connecting hardware adapter	130
Figure A.3 – Duplex patch cord.....	130
Figure A.4 – Views of crossover patch cords.....	131
Figure A.5 – Optical fibre sequences and adapter orientation in patch panel for the symmetrical position method.....	132
Figure A.6 – Optical fibre sequences and adapter orientation in patch panel for the reverse-pair position method.....	133
Figure A.7 – Array connector cable or patch cord (key-up to key-up)	134
Figure A.8 – Array adapter with aligned keyways	135
Figure A.9 – Transition assembly	136
Figure A.10 – Connectivity method for duplex signals	137

Figure A.11 – Connectivity method for parallel optics channels	138
Figure A.12 – Array connector cable or patch cord (key-up to key-up).....	139
Figure A.13 – Array adapter with aligned keyways	139
Figure A.14 – Transition assembly	140
Figure A.15 – Connectivity method for duplex cabling	141
Figure A.16 – Connectivity method for array cabling	142
Figure B.1 – Example of common pathways and spaces in a multi-tenant building	144
Figure B.2 – Example of a campus entrance facility	146
Figure B.3 – Example 1: Common equipment room.....	148
Figure B.4 – Example 1: Common telecommunications room	149
Figure B.5 – Example 2: Common telecommunications room	149
Figure C.1 – Connection of functional elements providing redundancy	152
Figure F.1 – Connection of functional elements providing redundancy	163
Figure I.1 – Illustration of installation environments	172
Table 1 – Remote powering cabling installation Categories and controls.....	26
Table 2 – Installed balanced cabling test parameters	33
Table 3 – Minimum sample sizes for alien (exogenous) crosstalk testing	34
Table 4 – Installed optical fibre cabling test parameters	35
Table 5 – Examples of pathway systems	39
Table 6 – Stacking height for non-continuous and interval support pathway systems	45
Table 7 – Design and planning of pathways outside buildings	50
Table 8 – Requirements and recommendations for pathway depths below finished surface	52
Table 9 – Minimum installed clearances above ground for aerial cables.....	54
Table 10 – Separation recommendations between metallic telecommunications cabling and specific EMI sources	71
Table 11 – Classification of telecommunications cables	73
Table 12 – Minimum separation, S	74
Table 13 – Power cabling factor, P	74
Table 14 – Minimum distance between telecommunications cables and earthed electrodes of power systems in rural and urban environments	81
Table 15 – Minimum distance between telecommunications cables and earthed electrodes of power systems in accordance with ITU-T K.8.....	81
Table 16 – Minimum clearances and protective measures at crossings between telecommunications cables and various underground services	82
Table 17 – Minimum clearances between aerial telecommunications and overhead power supply cabling	83
Table 18 – Technology-independent channel length vs. temperature	89
Table 19 – Temperature changes for various cable bundle sizes.....	90
Table 20 – Reduction factors for rectangular cable groups.....	91
Table 21 – Level of installation complexity	105
Table 22 – Level of operational complexity	106
Table 23 – Minimum requirements of administration systems	106
Table 24 – Minimum requirements of operational administration systems.....	108

Table 25 – Labelling requirements	110
Table 26 – Labelling recommendations (additional).....	111
Table 27 – Infrastructure records for spaces, cabinets, racks, frames and closures	113
Table 28 – Infrastructure records for cables and termination points.....	114
Table 29 – Infrastructure records	115
Table 30 – Infrastructure records for pathways and premises.....	116
Table 31 – Recommendations of installation administration systems.....	118
Table 32 – Recommendations of operational administration systems	118
Table A.1 – Optical fibre colour code scheme used in Annex A	129
Table B.1 – Summary of common spaces used to service a multi-tenant building.....	144
Table D.1 – Risk elements in determining a maintenance approach	154
Table E.1 – Minimum requirements for dimensions of primary distribution spaces.....	159
Table E.2 – Requirements for dimensions of secondary distribution spaces	159
Table E.3 – Minimum dimensions of spaces allocated to junction boxes	160
Table E.4 – Recommendations for dimensions of primary distribution spaces	161
Table E.5 – Recommendations for dimensions of secondary distribution spaces.....	161
Table H.1 – Equipment environmental specifications	168
Table I.1 – Temperature changes for remote power installations of Category RP2	170

INFORMATION TECHNOLOGY – IMPLEMENTATION AND OPERATION OF CUSTOMER PREMISES CABLING –

Part 2: Planning and installation

FOREWORD

- 1) ISO (the International Organization for Standardization) and IEC (the International Electrotechnical Commission) form the specialized system for worldwide standardization. National bodies that are members of ISO or IEC participate in the development of International Standards through technical committees established by the respective organization to deal with particular fields of technical activity. ISO and IEC technical committees collaborate in fields of mutual interest. Other international organizations, governmental and non-governmental, in liaison with ISO and IEC, also take part in the work. In the field of information technology, ISO and IEC have established a joint technical committee, ISO/IEC JTC 1.
- 2) The formal decisions or agreements of IEC and ISO on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees and ISO member bodies.
- 3) IEC, ISO and ISO/IEC publications have the form of recommendations for international use and are accepted by IEC National Committees and ISO member bodies in that sense. While all reasonable efforts are made to ensure that the technical content of IEC, ISO and ISO/IEC publications is accurate, IEC or ISO cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees and ISO member bodies undertake to apply IEC, ISO and ISO/IEC publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any ISO, IEC or ISO/IEC publication and the corresponding national or regional publication should be clearly indicated in the latter.
- 5) ISO and IEC do not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. ISO or IEC are not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or ISO or its directors, employees, servants or agents including individual experts and members of their technical committees and IEC National Committees or ISO member bodies for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication of, use of, or reliance upon, this ISO/IEC publication or any other IEC, ISO or ISO/IEC publications.
- 8) Attention is drawn to the normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this ISO/IEC publication may be the subject of patent rights. ISO and IEC shall not be held responsible for identifying any or all such patent rights.

International Standard ISO/IEC 14763-2 was prepared by subcommittee 25: Interconnection of information technology equipment, of ISO/IEC joint technical committee 1: Information technology.

This second edition cancels and replaces the first edition published in 2012 and Amendment 1:2015. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- the inclusion of planning and installation practices to support remote powering over the telecommunications cabling infrastructure;
- the inclusion of planning and installation practices outside buildings.

The text of this standard is based on the following documents:

FDIS	Report on voting
JTC1-SC25/2909/FDIS	JTC1-SC25/2931/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of the ISO/IEC 14763 series, published under the general title *Information technology – Implementation and operation of customer premises cabling*, can be found on the IEC and ISO websites.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

The use of generic information technology (IT) cabling, termed telecommunications cabling throughout this document (in accordance with the ISO/IEC 11801 series), for an increased number of non-IT services is reflected in the predominant use of the term telecommunications in this document.

The importance of services delivered by telecommunications cabling infrastructure is similar to that of utilities such as heating, lighting and electricity supplies. As with those utilities, interruptions to service can have a serious impact. Poor quality of service due to lack of planning, use of inappropriate components, incorrect installation, poor administration or inadequate support can threaten an organization's effectiveness.

There are four phases in the successful implementation of telecommunications cabling:

- a) design;
- b) specification – the detailed requirement for the cabling, including the planning of its accommodation and associated building services addressing safety and specific environments (e.g. electromagnetic), together with the quality assurance requirements to be applied;
- c) installation – in accordance with the requirements of the specification;
- d) operation – the management of connectivity and the maintenance of transmission performance during the life of the cabling.

This document supports the specification, implementation and operation of generic telecommunications cabling designed in accordance with the standards and associated documents developed by ISO/IEC JTC 1/SC 25 and addresses the following topics:

- specification depending on the application, environment, building infrastructure and facilities;
- quality assurance;
- installation planning (including pathways and spaces) depending on the application, environment, building infrastructure and facilities, etc.;
- installation practice (including pathways and spaces);
- documentation and administration;
- testing;
- inspection;
- operation;
- maintenance and maintainability (based on any impact from planning and installation);
- repair and repairability (based on any impact from planning and installation).

It does not cover those aspects of installation associated with the transmission of signals in free space between transmitters, receivers or their associated antenna systems (e.g. wireless, radio, microwave or satellite).

The following normative annexes support specific aspects of planning and installation:

- Annex A: Optical fibre polarity;
- Annex B: Common infrastructures within multi-tenant premises.

The requirements and recommendations of Clauses 5 to 14 are premises-independent. The following normative annexes include requirements for generic cabling in accordance with specific International Standards:

- Annex C: Cabling in accordance with ISO/IEC 11801-2;

- Annex D: Cabling in accordance with ISO/IEC 11801-3;
- Annex E: Cabling in accordance with ISO/IEC 11801-4;
- Annex F: Cabling in accordance with ISO/IEC 11801-5;
- Annex G: Cabling in accordance with ISO/IEC 11801-6.

Annex H provides information on environmental classes for spaces containing telecommunications equipment.

Annex I provides additional information regarding remote powering.


This document sets out the responsibilities of telecommunications cabling installers and premises owners, and is intended to be referenced in relevant contracts. The owners can delegate selected responsibilities to designers, specifiers, operators and maintainers of installed telecommunications cabling.

This document is also relevant to

- architects, building designers and builders,
- main contractors,
- designers, suppliers, installers, inspectors (auditors), building managers, maintainers and owners of telecommunications cabling,
- access providers and service providers,
- end users.

This document is one of a number of documents prepared in support of International Standards and Technical Reports for cabling design produced by ISO/IEC JTC 1/SC 25. Figure 1 shows the inter-relationship between these International Standards and Technical Reports.

Users of this document should be familiar with the applicable cabling design standard.

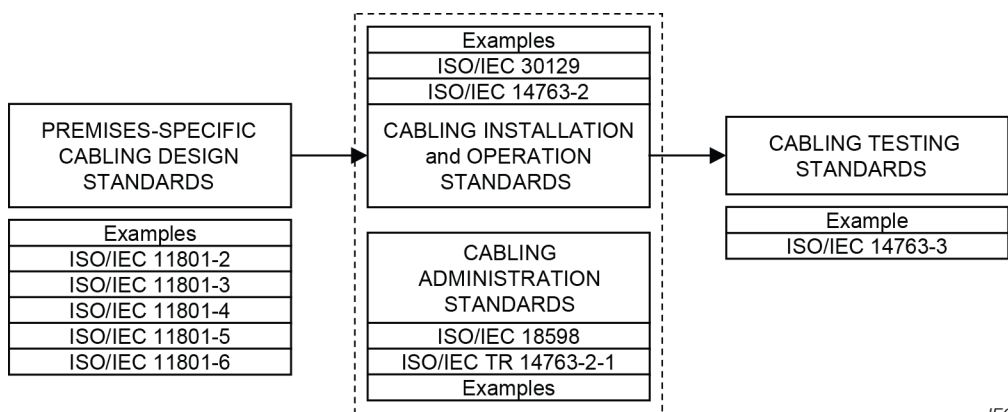

IEC

Figure 1 – Schematic relationship between ISO/IEC 14763-2 and other relevant International Standards and Technical Reports

NOTE Telecommunications infrastructure affects raw material consumption. The infrastructure design and installation methods also influence product life and sustainability of electronic equipment life cycling. These aspects of telecommunications infrastructure impact our environment. Since building life cycles are typically planned for decades, technological electronic equipment upgrades are necessary. The telecommunications infrastructure design and installation process magnifies the need for sustainable infrastructures with respect to building life, electronic equipment life cycling and considerations of effects on environmental waste. Telecommunications designers are encouraged to research local building practices for a sustainable environment and conservation of fossil fuels as part of the design process.

INFORMATION TECHNOLOGY – IMPLEMENTATION AND OPERATION OF CUSTOMER PREMISES CABLING –

Part 2: Planning and installation

1 Scope

This part of ISO/IEC 14763 specifies requirements for the planning, installation and operation of telecommunications cabling and cabling infrastructures including cabling, pathways, spaces and telecommunications bonds (other than that specified in ISO/IEC 30129) in support of generic cabling standards and associated documents.

The following aspects are addressed:

- a) specification of the installation;
- b) quality assurance;
- c) installation planning;
- d) installation practice;
- e) documentation;
- f) administration;
- g) testing;
- h) inspection;
- i) operation;
- j) maintenance;
- k) repair.

The requirements and recommendations of Clauses 5 to 14 are premises-independent. Annexes C through G contain premises-specific amendments of and additions to these requirements and recommendations.

In addition, this document describes the methodology for the assessment of spaces, pathways, pathway systems and cabling (either installed or planned) in support of remote powering objectives.

This document excludes specific requirements applicable to other cabling systems (e.g. power supply cabling); however, it takes account of the effects other cabling systems may have on the installation of telecommunications cabling (and vice versa) and gives general advice.

This document excludes those aspects of installation associated with the transmission of signals in free space between transmitters, receivers or their associated antenna systems (e.g. wireless, radio, microwave or satellite).

This document is applicable to certain hazardous environments but does not exclude additional requirements which are applicable in particular circumstances (e.g. electricity supply and electrified railways).

Safety and electromagnetic compatibility (EMC) requirements are outside the scope of this document and are covered by other standards and regulations. However, information given in this document can be of assistance in meeting these standards and regulations.