



**American Water Works
Association**

Dedicated to the World's Most Important Resource®

ANSI/AWWA C604-17
(Revision of ANSI/AWWA C604-11)

AWWA Standard

Installation of Buried Steel Water Pipe—4 In. (100 mm) and Larger

Effective date: Aug. 1, 2017.

First edition approved by AWWA Board of Directors Feb. 12, 2006.

This edition approved Jan. 14, 2017.

Approved by American National Standards Institute Jan. 6, 2017.




AWWA Standard

This document is an American Water Works Association (AWWA) standard. It is not a specification. AWWA standards describe minimum requirements and do not contain all of the engineering and administrative information normally contained in specifications. The AWWA standards usually contain options that must be evaluated by the user of the standard. Until each optional feature is specified by the user, the product or service is not fully defined. AWWA publication of a standard does not constitute endorsement of any product or product type, nor does AWWA test, certify, or approve any product. The use of AWWA standards is entirely voluntary. This standard does not supersede or take precedence over or displace any applicable law, regulation, or code of any governmental authority. AWWA standards are intended to represent a consensus of the water industry that the product described will provide satisfactory service. When AWWA revises or withdraws this standard, an official notice of action will be placed on the first page of the Official Notice section of *Journal – American Water Works Association*. The action becomes effective on the first day of the month following the month of *Journal – American Water Works Association* publication of the official notice.

American National Standard

An American National Standard implies a consensus of those substantially concerned with its scope and provisions. An American National Standard is intended as a guide to aid the manufacturer, the consumer, and the general public. The existence of an American National Standard does not in any respect preclude anyone, whether that person has approved the standard or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standard. American National Standards are subject to periodic review, and users are cautioned to obtain the latest editions. Producers of goods made in conformity with an American National Standard are encouraged to state on their own responsibility in advertising and promotional materials or on tags or labels that the goods are produced in conformity with particular American National Standards.

CAUTION NOTICE: The American National Standards Institute (ANSI) approval notice on the front cover of this standard indicates completion of the ANSI approval process. This American National Standard may be revised or withdrawn at any time. ANSI procedures require that action be taken to reaffirm, revise, or withdraw this standard no later than five years from the date of publication. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036; 212.642.4900; or emailing info@ansi.org

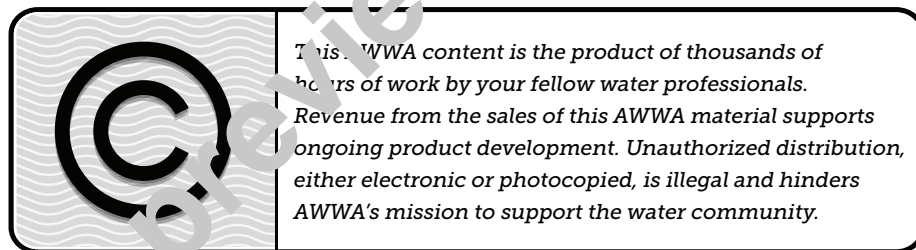

ISBN-13, print: 978-1-62576-241-2

eISBN-13, electronic: 978-1-61300-432-6

DOI: <http://dx.doi.org/10.12999/AWWA.C604.17>

All rights reserved. No part of this publication may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopy, recording, or any information or retrieval system, except in the form of brief excerpts or quotations for review purposes, without the written permission of the publisher.

Copyright © 2017 by American Water Works Association
Printed in USA

Committee Personnel

The Steel Water Pipe Manufacturers Technical Advisory Committee (SWPMTAC) Task Force for Development and Maintenance of ANSI/AWWA C604, which revised this standard, had the following personnel at the time:

Nash Williams, *Chair*

S.A. Arnaout, Forterra, Dallas, Texas	(AWWA)
H.H. Bardakjian, Consultant, Glendale, Calif.	(AWWA)
J. Buratto, Lifelast Inc., Austin, Texas	(AWWA)
R.J. Card, Consultant, Sugar Hill, Ga.	(AWWA)
D. Dechant, Consultant, Aurora, Colo.	(AWWA)
J. Forni, Jifco Inc., Livermore, Calif.	(AWWA)
B. Hansen, National Welding Corporation, Midvale, Utah	(AWWA)
B. Keil, Northwest Pipe Company, Draper, Utah	(AWWA)
D. Lay, Hytorc, Highland, Utah	(AWWA)
D. Libby, Chase Corporation, Westwood, Mass.	(AWWA)
J.L. Luka, American SpiralWeld Pipe Company, Columbia, S.C.	(AWWA)
R. Mielke, Northwest Pipe Company, Raleigh, N.C.	(AWWA)
J. Olmos, Ameron International, Rancho Cucamonga, Calif.	(AWWA)
R.N. Satyarthi, Baker Coupling Company, Los Angeles, Calif.	(AWWA)
C. Shelley, Victaulic Company, Atlanta, Ga.	(AWWA)
N. Williams, National Welding Corporation, Midvale, Utah	(AWWA)

The Standards Committee on Steel Pipe, which reviewed and approved this standard, had the following personnel at the time of approval:

John H. Bambei Jr., *Chair*

Dennis Dechant, *Vice-Chair*

John L. Luka, *Secretary*

General Interest Members

W.R. Brunzell, Brunzell Associates Ltd., Skokie, Ill.	(AWWA)
R.J. Card, Lockwood, Andrews & Newnam Inc., Sugar Hill, Ga.	(AWWA)
R.L. Coffey, HDR Engineering Inc., Omaha, Neb.	(AWWA)
S.N. Foellmi, Black & Veatch Corporation, Irvine, Calif.	(AWWA)

R.L. Gibson, Freese and Nichols Inc., Fort Worth, Texas	(AWWA)
M.D. Gossett,* HDR, Denver, Colo.	(AWWA)
M.B. Horsley,* Black & Veatch Corporation, Kansas City, Mo.	(AWWA)
R.A. Kufas, Norske Corrosion & Inspection Services Ltd., Surrey, B.C., Canada	(AWWA)
J.L. Mattson, Corrosion Control Technologies, Sandy, Utah	(AWWA)
A. Murdock, CH2M, Salt Lake City, Utah	(AWWA)
R. Ortega,* Consultant, Spring, Texas	(AWWA)
E.S. Ralph,† Standards Engineer Liaison, AWWA, Denver, Colo.	(AWWA)
A.E. Romer, AECOM, Orange, Calif.	(AWWA)
J.R. Snow, MWH Americas, Denver, Colo.	(AWWA)
W.R. Whidden, Woolpert, Winter Park, Fla.	(AWWA)

Producer Members

D.W. Angell,† Standards Council Liaison, American Flow Control, Birmingham, Ala.	(AWWA)
S.A. Arnaout, Forterra, Dallas, Texas	(AWWA)
H.H. Bardakjian, Consultant, Glendale, Calif.	(AWWA)
D. Dechant, Dechant Infrastructure Service, Aurora, Colo.	(AWWA)
V. DeGrande,* Ameron Water Transmission Group, Rancho Cucamonga, Calif.	(AWWA)
W.B. Geyer, Steel Plate Fabricators Association, Lake Zurich, Ill.	(SPFA)
B.D. Keil, Northwest Pipe Company, Draper, Utah	(AWWA)
J.L. Luka, American SpiralWeld Pipe Company, Columbia, S.C.	(AWWA)
R.D. Mielke,* Northwest Pipe Company, Raleigh, N.C.	(AWWA)
J. Olmos, Ameron Water Transmission Group, Rancho Cucamonga, Calif.	(AWWA)
G.F. Ruchti,* Consultant, Punta Gorda, Fla.	(SFPA)
B. Simpson,* American Cast Iron Pipe Company, Birmingham, Ala.	(AWWA)
C.C. Sundberg, Victaulic, Issaquah, Wash.	(AWWA)
D. Walker, Avid Protective Products Ltd/TNEMEC Company, Oakville, Ont., Canada	(AWWA)
J.A. Wise, Canada International Sales Inc., Surrey, B.C., Canada	(AWWA)

User Members

G. A. Andersen, New York City Bureau of Water Supply, Little Neck, N.Y.	(AWWA)
J. M. Bambei Jr., Bambei Engineering Services, Arvada, Colo.	(AWWA)

* Alternate

† Liaison, nonvoting

B. Cheng, Metro Vancouver, Burnaby, B.C., Canada (AWWA)
M.E. Conner, San Diego County Water Authority, San Diego, Calif. (AWWA)
R.V. Frisz, US Bureau of Reclamation, Denver, Colo. (BUREC)
S. Hattan, Tarrant Regional Water District, Ft. Worth, Texas (AWWA)
T.J. Jordan,* Metropolitan Water District of Southern California, La Verne, Calif. (AWWA)
P.K. Karna, Tacoma Water, Tacoma, Wash. (AWWA)
M. McReynolds, Metropolitan Water District of Southern California, Oak Park, Calif. (AWWA)
M. Turney,* Denver Water, Denver, Colo. (AWWA)
N.A. Wigner, Los Angeles Department of Water and Power, Los Angeles, Calif. (AWWA)

* Alternate

This page intentionally blank.

Currently in preview, click buy full version

Contents

All AWWA standards follow the general format indicated subsequently. Some variations from this format may be found in a particular standard.

SEC.	PAGE	SEC.	PAGE
Foreword		5	Trench Construction
I	Introduction..... ix	5.1	Alignment and Grade..... 7
I.A	History..... ix	5.2	Trench Construction 8
I.B	Discussion ix	6	Pipe Installation
I.C	Acceptance..... ix	6.1	General Pipe Installation 10
II	Special Issues..... xi	6.2	Joint Assembly and Testing 11
II.A	Application..... xi	6.3	Thrust Restraint 28
II.B	Chlorine and Chloramine Degradation of Elastomers xi	6.4	Backfilling 28
III	Use of This Standard xi	6.5	Flushing 31
III.A	Purchaser Options and Alternatives xi	6.6	Disinfection 31
III.B	Modification to Standard xii	6.7	Highway and Railroad Crossings 32
IV	Major Revisions..... xii	6.8	Subaqueous Crossings 32
V	Comments xii	7	Verification
Standard		7.1	Inspection 32
1	General	7.2	Hydrostatic Field Testing 33
1.1	Scope 1	8	Delivery
1.2	Purpose 2	8.1	Unloading, Handling, and Storage.. 34
1.3	Application..... 2	8.2	Affidavit of Compliance 35
2	References 2	Appendix	
3	Definitions 3	A	Flange Joint Assembly
4	Preliminary Information	A.1	General Flange Joint Assembly Procedures and Checklists..... 37
4.1	Permeation 6	A.2	Flanges, Fasteners, and Gaskets (Additional Details)..... 41
4.2	Materials 6	A.3	Bolting Patterns and Sequences 44
4.3	Preconstruction Planning..... 6		

SEC.	PAGE	SEC.	PAGE
Figures			
1	12	A.2	45
2	13		45
3	14	A.3	46
4	16	A.4	47
5	18		
6	20		
7	30		
A.1	45		
Table			
		1	30

Foreword

This foreword is for information only and is not a part of ANSI/AWWA C604.

I. Introduction.

I.A. *History.* This standard pertains to the in-ground installation of steel pipelines for use in the distribution and transmission of water, air, and other products in water system facilities. It has been prepared by the AWWA Standards Committee on Steel Pipe, initially formed as Committee A7A in 1939. At that time, the Steel Water Pipe Manufacturers Technical Advisory Committee was organized as a subsidiary group to function as a source of technical information for the parent committee. Committee A7A and its successors, Committee 8310D and the AWWA Standards Committee on Steel Pipe, have assumed responsibility for all AWWA standards and manuals pertaining to steel pipe, fittings, linings and coatings, and installations, and related items.

In 1996 the AWWA Standards Council directed the Standards Committee on Steel Pipe to develop a standard for the installation of steel pipelines and their appurtenances used in water treatment or conveying facilities. The first edition of AWWA C604 was approved by the AWWA Board of Directors on Feb. 12, 2006. The second edition was approved on Jan. 23, 2011. The present edition of C604 was approved on Jan. 14, 2017.

I.B. *Discussion.* ANSI/AWWA C604 addresses the installation of steel pipe 4 in. (100 mm) in diameter and larger typically used in the water industry. ANSI/AWWA C604 anticipates the use of pipe produced in a fabricator's shop or pipe mill that meets the stringent design, quality control, and testing requirements of AWWA Manual M11, ANSI/AWWA C200, and the applicable AWWA steel pipe lining and coating standards.

I.C. *Acceptance.* In May 1985, the US Environmental Protection Agency (USEPA) entered into a cooperative agreement with a consortium led by NSF International (NSF)[†] to develop voluntary third-party consensus standards and a certification program for direct and indirect drinking water additives. Other members of the original consortium included the Water Research Foundation (formerly AwwaRF) and the Conference of State Health and Environmental Managers (COSHEM). The

* American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036.

† NSF International, 789 North Dixboro Road, Ann Arbor, MI 48105.

American Water Works Association (AWWA) and the Association of State Drinking Water Administrators (ASDWA) joined later.

In the United States, authority to regulate products for use in, or in contact with, drinking water rests with individual states.* Local agencies may choose to impose requirements more stringent than those required by the state. To evaluate the health effects of products and drinking water additives from such products, state and local agencies may use various references, including

1. Specific policies of the state or local agency.
2. Two standards developed under the direction of NSF: NSF/ANSI 60, Drinking Water Treatment Chemicals—Health Effects, and NSF/ANSI 61, Drinking Water System Components—Health Effects.
3. Other references, including AWWA standards, *Food Chemicals Codex*, *Water Chemicals Codex*,† and other standards considered appropriate by the state or local agency.

Various certification organizations may be involved in certifying products in accordance with NSF/ANSI 61. Individual states or local agencies have authority to accept or accredit certification organizations within their jurisdictions. Accreditation of certification organizations may vary from jurisdiction to jurisdiction.

Annex A, “Toxicology Review and Evaluation Procedures,” to NSF/ANSI 61 does not stipulate a maximum allowable level (MAL) of a contaminant for substances not regulated by a USEPA final maximum contaminant level (MCL). The MALs of an unspecified list of “unregulated contaminants” are based on toxicity testing guidelines (noncarcinogens) and risk characterization methodology (carcinogens). Use of Annex A procedures may not always be identical, depending on the certifier.

ANSI/AWWA C60 does not address additives requirements. Thus, users of this standard should consult the appropriate state or local agency having jurisdiction in order to

1. Determine additives requirements, including applicable standards.
2. Determine the status of certifications by parties offering to certify products for contact with, or treatment of, drinking water.
3. Determine current information on product certification.

* Persons outside the United States should contact the appropriate authority having jurisdiction.

† Both publications available from National Academy of Sciences, 500 Fifth Street, NW, Washington, DC 20001.

II. Special Issues.

II.A. *Application.* ANSI/AWWA C604, Installation of Buried Steel Water Pipe—4 In. (100 mm) and Larger, can be used as a reference when making extensions to existing distribution or transmission systems or when constructing new distribution or transmission systems using steel pipe. It is not the intent for this standard to be used as a contract document, but it may be used as a reference in contract documents. It is based on a consensus of the committee on the minimum practice consistent with sound, economical service under normal conditions, and its applicability under any circumstances must be reviewed by a responsible engineer. The standard is not intended to preclude the manufacture, marketing, purchase, or use of any product, process, or procedure.

II.B. *Chlorine and Chloramine Degradation of Elastomers.* The selection of materials is critical for water service and distribution piping in locations where there is a possibility that elastomers will be in contact with chlorine or chloramines. Documented research has shown that elastomers such as gaskets, seals, valve seats, and encapsulations may be degraded when exposed to chlorine or chloramines. The impact of degradation is a function of the type of elastomeric material, chemical concentration, contact surface area, elastomer cross section, and environmental conditions as well as temperature. Careful selection of and specifications for elastomeric materials and the specifics of their application for each water system component should be considered to provide long-term usefulness and minimum degradation (swelling, loss of elasticity, or softening) of the elastomer specified.

II.B.1 Gasket Degradation Study. A pipe gasket, having the hardness of a compressed elastomer with a large mass relative to the small exposed surface area, thus experiences minimal degradation. This was validated in a research paper reported in the *Journal AWWA*,* where the pipe gasket degradation in a 110 mg/L chloramine solution was found to degrade just the exposed surface.

III. Use of This Standard. It is the responsibility of the user of an AWWA standard to determine that the products described in that standard are suitable for use in the particular application being considered.

III.A. *Purchaser Options and Alternatives.* Considerable supplemental information is required in conjunction with the use of this standard, including, but not limited to, purchaser's documents consisting of detailed plans and specifications. The

* R.W. Bonds. 2004. Effect of Chloramines on Ductile-Iron Pipe Gaskets of Various Elastomer Compounds. *Jour. AWWA*, 96(4):153–160.

purchaser's documents should cover, as a minimum, detailed instructions pertaining to all references in this standard to "as specified" and "in accordance with the purchaser's documents." In addition, the purchaser shall provide specific supplementary information to the purchaser's documents regarding the following:

1. Standard used—that is, ANSI/AWWA C604, Installation of Buried Steel Water Pipe—4 In. (100 mm) and Larger, of latest revision.
2. Whether compliance with NSF/ANSI 61, Drinking Water System Components—Health Effects, is required.
3. Pipe design criteria and type of pipe ends.
4. Pipeline plan and profile drawings including appurtenances, vaults, valves, and existing utilities.
5. Pipe bedding specification and drawing details.
6. Inspection for pipe joints, protective coatings and linings, and pipe zone compaction.
7. Surface restoration.
8. Special handling requirements.
9. Details of other federal, state or provincial, and local requirements (Sec. 4.2).
10. Whether proof testing of the weld-after-backfill method is required for the project-specific conditions, including testing protocols (Sec. 6.2.2). NOTE: The exterior protective joint coating, backfill material, pipe wall thickness, and welding procedures should be considered when using this process.

III.B. *Modification to Standard.* Any modification of the provisions, definitions, or terminology in this standard must be provided by the purchaser.

IV. Major Revisions. Major revisions made to the standard in this edition include the following:

1. Sec. I.B in the foreword, which provides a discussion on ANSI/AWWA C604, was updated.
2. An advisory statement was added in the foreword (Sec. II.B) regarding chlorine and chloramine degradation of elastomers per the AWWA Standards Council directive.
3. Section 2, References, has been updated.
4. *Weld-after-backfill* was added to Section 3, Definitions.
5. The section numbering and subtitles were revised to streamline the document.
6. Additional information on pipe ends was added to Sec. 6.2.2, Pipe Placement for welded lap joints.

7. Sec. 6.2.4, Bolted Flange Joints, was significantly updated and expanded.
8. New Figure 5, Flat-Face Slip-on Ring Flange With Fillet Weld Detail, and Figure 6, Gasket Types, were added.
9. Old Figure 5, Bolt Torque Sequence, was deleted and is now covered in appendix A.
10. Sec. 6.2.10.4, Welded Joint Testing, was updated.
11. Sec. 6.2.12, Thermal Stress Control Joints, was revised.
12. Sec. 6.2.14.1, Tape Wrapping of Field Joints, was revised for clarity.
13. Sec. 6.2.14.3, Heat-Shrink Sleeves on Field Joints, was revised.
14. Additional information was added to Sec. 8.1.3, Internal Bracing.
15. A new appendix A was added to include flange assembly detail information.

V. Comments. If you have any comments or questions about this standard, please call AWWA Engineering and Technical Services at 303.794.7711, FAX at 303.795.7603; write to the department at 6666 West Quincy Avenue, Denver, CO 80235-3098; or email at standards@awwa.org.

This page intentionally blank.



**American Water Works
Association**

Dedicated to the World's Most Important Resource®

ANSI/AWWA C604-17
(Revision of ANSI/AWWA C604-11)

AWWA Standard

Installation of Buried Steel Water Pipe—4 In. (100 mm) and Larger

SECTION 1: GENERAL

Sec. 1.1 Scope

This standard provides the field installation guidelines for buried steel water pipe, 4 in. (100 mm)* and larger.

The information contained in this standard is intended to be used as a guide to assist in the installation of steel water pipe.

1.1.1 *Conditions that may require additional considerations.* Installations that require special attention, techniques, and materials are not covered by this standard. Some of these installations are

1. Piping through rigid walls or structures.
2. Connections to appurtenances.
3. Piping on supports or on piles aboveground or belowground.
4. Piping subject to significant thermal stresses.
5. Treatment plant or pump-station piping.
6. Industrial piping.
7. Piping in seismic areas.

* Metric conversions given in this standard are direct conversions of US customary units and are not those specified in the International Organization for Standardization (ISO) standards.

8. Piping in high-density, stray-current environments.
9. Piping through unstable soils or soils subject to sliding or soil drag.
10. Piping subject to excessive live loads.
11. Piping with cover less than 3 ft (900 mm).
12. Piping installed by horizontal directional drilling (HDD).

Sec. 1.2 Purpose

The purpose of this standard is to provide the minimum requirements for the installation of buried steel water pipelines, including inspection, unloading, handling, storage, and testing.

Sec. 1.3 Application

This standard is intended to cover typical pipeline construction practices that are deemed adequate for the satisfactory installation of steel water pipelines. Individual project requirements may vary substantially and should always be thoroughly reviewed before bidding or construction startup. For this reason, some practices discussed in this standard may not be suitable for all project conditions, and in some cases, specialized installation techniques may be required that are beyond the scope of this standard.

SECTION 2: REFERENCES

This standard references the following documents. In their latest editions, the referenced documents form a part of this standard to the extent specified herein. In case of conflict, the requirements of this standard shall prevail.

AASHTO* M145—Standard Specification for Classification of Soils and Soil-Aggregate Mixtures for Highway Construction Purposes.

ANSI†/AWWA C200—Steel Water Pipe—6 In. (150 mm) and Larger.

ANSI/AWWA C203—Coal-Tar Protective Coatings and Linings for Steel Water Pipe.

ANSI/AWWA C205—Cement–Mortar Protective Lining and Coating for Steel Water Pipe—4 In. (100 mm) and Larger—Shop Applied.

ANSI/AWWA C206—Field Welding of Steel Water Pipe.

* American Association of State Highway and Transportation Officials, 444 North Capitol Street, NW, Suite 249, Washington, DC 20001.

† American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036.