

ANSI/AWWA **C903-21**  
(Revision of ANSI/AWWA C903-16)

AWWA Standard

**Polyethylene–  
Aluminum–Polyethylene  
(PE–AL–PE) Composite  
Pressure Pipe, 12 mm  
(1/2 In.) Through 51 mm  
(2 In.), for Water Service**

**Effective date: Apr. 1, 2022.**

First edition approved by Board of Directors Jan. 20, 2002.

13th edition approved Oct. 25, 2021.

Approved by American National Standards Institute Aug. 31, 2021.



American Water Works  
Association




## AWWA Standard

This document is an American Water Works Association (AWWA) standard. It is not a specification. AWWA standards describe minimum requirements and do not contain all of the engineering and administrative information normally contained in specifications. The AWWA standards usually contain options that must be evaluated by the user of the standard. Until each optional feature is specified by the user, the product or service is not fully defined. AWWA publication of a standard does not constitute endorsement of any product or product type, nor does AWWA test, certify, or approve any product. The use of AWWA standards is entirely voluntary. This standard does not supersede or take precedence over or displace any applicable law, regulation, or code of any governmental authority. AWWA standards are intended to represent a consensus of the water industry that the product described will provide satisfactory service. When AWWA revises or withdraws this standard, an official notice of action will be placed in the Official Notice section of *Journal AWWA*. The action becomes effective on the first day of the month following the month of *Journal AWWA* publication of the official notice.

## American National Standard

An American National Standard implies a consensus of those substantially concerned with its scope and provisions. An American National Standard is intended as a guide to aid the manufacturer, the consumer, and the general public. The existence of an American National Standard does not in any respect preclude anyone, whether that person has approved the standard or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standard. American National Standards are subject to periodic review, and users are cautioned to obtain the latest editions. Producers of goods made in conformity with an American National Standard are encouraged to state on their own responsibility in advertising and promotional materials or on tags or labels that the goods are produced in conformity with particular American National Standards.

**CAUTION NOTICE:** The American National Standards Institute (ANSI) approval date on the front cover of this standard indicates completion of the ANSI approval process. This American National Standard may be revised or withdrawn at any time. ANSI procedures require that action be taken to reaffirm, revise, or withdraw this standard no later than five years from the date of ANSI approval. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036; 212.642.4900, or emailing [info@ansi.org](mailto:info@ansi.org).

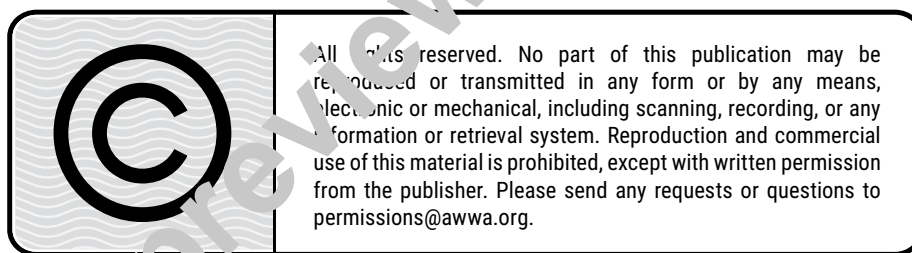

ISBN-13, print: 978-1-64717-001-3

ISBN-13, electronic: 978-1-61300-615-3

DOI: <http://dx.doi.org/10.12999/AWWA.C903.21>

---

All rights reserved. No part of this publication may be reproduced or transmitted in any form or by any means, electronic or mechanical, including scanning, recording, or any information or retrieval system. Reproduction and commercial use of this material is prohibited, except with written permission from the publisher.

Copyright © 2021 by American Water Works Association  
Printed in USA

## Committee Personnel

The AWWA Standards Subcommittee on C903, which reviewed and developed this revision, had the following personnel at the time:

Larry J. Gill, *Chair*

A.J. Ciechanowski, NSF International, Ann Arbor, Mich.

L.J. Gill, IPEX USA LLC, Mississauga, Ont.

B.E. Hauger, Bryan Hauger Consulting, Inc., Boulder, Colo.

H. Svetlik, Harvey Svetlik Consulting, Pipe Creek, Tex.

The AWWA Standards Committee on Polyolefin (PE) Pressure Pipe and Fittings, which reviewed and approved this standard, had the following personnel at the time of approval:

John F. Fishburne, *Chair*

Camille G. Rubeiz, *Secretary*

*General Interest Members*

L. Aguiar, Hazen and Sawyer, Coral Gables, Fla.

E.A. Ambler, AM Trenchless, Sanford, Fla.

J.L. Beaver, Simpson Gumpertz Heger Inc., Waltham, Mass.

J.P. Castronovo, Blue Ridge, Ga.

A. Chastain-Howley (*liaison*), Standards Council Liaison, Black & Veatch, Camden, Maine

K.C. Choquette, Des Moines, Iowa

A.J. Ciechanowski, NSF International, Ann Arbor, Mich.

D.E. Duvall, Engineering Systems Inc., Aurora, Ill.

J.F. Fishburne, Freeman & Nichols Inc., Charlotte, N.C.

D.L. McPherson (*alternate*), HDR, Charlotte, N.C.

P.J. Olson (*liaison*), Standards Engineer Liaison, AWWA, Denver, Colo.

G. Scoby, Cross Bore Consultants, Los Gatos, Calif.

D. A. Stewart, Stewart HDPE Consulting LLC, Lago Vista, Tex.

S.C. Williams, HDR, Atlanta, Ga.

S. Ziobro, FM Approvals, Chepachet, R.I.

*Producer Members*

S. Boros, Pipeline Plastics LLC, Geneva, Ill.  
G.A. Garcia, JM Eagle, Los Angeles, Calif.  
L.J. Gill, IPEX Management Inc., Oakville, Ont.  
R. Houle, Reliance Worldwide Corp., Atlanta, Ga.  
J.S. Johnston Jr., McElroy Manufacturing, Inc., Tulsa, Okla.  
D. Langston, WL Plastics Corp., Cedar City, Utah  
L. MacNevin (*alternate*), Plastics Pipe Institute, Ashburn, Va.  
C.G. Rubeiz, Plastics Pipe Institute, Fairfax, Va.  
S.D. Sandstrum, Borealis Compounds, Inc., Port Murray, N.J.  
J. Wright, Georg Fischer Central Plastics LLC, Shawnee, Okla.

*User Members*

M. Boyce, East Bay Municipal Utilities District, Oakland, Calif.  
H. Link, Colorado Springs, Colo.  
A. Marner, US Bureau of Reclamation, Denver, Colo.  
R. McKaskle, City of Tulsa – Engineering Services Dept., Tulsa, Okla.  
N. Perez-Jacome, City of Miami Beach, Miami Beach, Fla.  
J. Stein, Arlington Water Department, Arlington, Tex.  
M.A. Wirtz, City of Fort Wayne, Fort Wayne, Ind.

# Contents

*All AWWA standards follow the general format indicated subsequently. Some variations from this format may be found in a particular standard.*

SEC.	PAGE	SEC.	PAGE
<b>Foreword</b>		<b>5 Verification</b>	
I	vii	5.1	General ..... 11
I.A	vii	5.2	Tests for Qualification of Materials and Processes..... 11
I.B	vii	5.3	Tests for Product Quality Control..... 12
I.C	vii	5.4	Action After Failure to Meet Requirements ..... 12
II	viii	5.5	Quality Control Records ..... 12
II.A	ix	5.6	Plant Inspection by the Purchaser.... 12
II.B	xi	<b>6 Delivery</b>	
III	xiv	6.1	Marking ..... 13
III.A	xiv	6.2	Shipping and Delivery..... 13
III.A	xiv	6.3	Affidavit of Compliance ..... 13
III.B	xiv	<b>Appendix</b>	
IV	xv	A	Bibliography for Additional Information Regarding Permeation of Polyolefin Pipes..... 15
V	xv	<b>Figures</b>	
<b>Standard</b>		F-1	Dynamic Pressure Rating Chart ..... xi
<b>1 General</b>		1	Illustration of PE-AL-PE Pipe ..... 2
1.1	1	<b>Tables</b>	
1.2	2	F-1	Surge Pressures and Maximum Allowable Instantaneous Change In Velocity In PE-AL-PE (PR 200 PSI) Pipe..... x
1.3	2		
<b>2 References</b>	3		
<b>3 Definitions</b>	4		
<b>4 Requirements</b>			
4.1	5		
4.2	6		
4.3	7		

SEC.		PAGE	SEC.		PAGE
F-2	Minimum Bending Radius for PE-AL-PE Pipe.....	xii	3	Minimum Burst Pressure and Sustained Pressure for PE-AL- PE Pipe .....	10
1	Nominal ID Pipe Size Outside Diameters and Maximum Out-of-Roundness .....	8	4	Pressure Design Basis (PDB) and Pressure Rating (PR) for PE- AL-PE Pipe .....	11
2	Minimum Pipe Wall and Layer Thicknesses .....	8			

---

# Foreword

*This foreword is for information only and is not a part of ANSI/AWWA C903.*

## **I. Introduction.**

I.A. *Background.* This standard describes the dimensions and requirements for polyethylene–aluminum–polyethylene composite pressure pipe (PE–AL–PE) for use primarily as water service lines in the construction of underground water distribution systems.

The pipe consists of a welded aluminum tube jacketed by protective inner and outer layers of polyethylene (PE). The inner and outer PE layers are adhesively bonded to the aluminum tube by a polymeric hot-melt adhesive. This standard describes pipe conforming to inside diameter nominal pipe size from 12 mm (½ in.) through 51 mm (2 in.).

I.B. *History.* In the summer of 1997, the American Water Works Association (AWWA) Committee on Polyolefin Pressure Pipe and Fittings was approached to develop a standard describing PE–AL–PE and PEX–AL–PEX composite pressure pipes for water service. Formal application was made to the AWWA Standards Council for the creation of a new standard. The application was accompanied by a letter of endorsement from the Polyolefin Committee stating that it was willing to manage the creation of the standard.

In the fall of 1997, the AWWA Standards Committee authorized the project and a subcommittee was created under the Polyolefin Pressure Pipe and Fittings Committee to handle the task. The first edition of ANSI/AWWA C903 was approved by the AWWA Board of Directors on Jan. 20, 2002. Subsequent editions were approved on June 12, 2005 and June 19, 2016. This edition was approved on Oct. 25, 2021.

I.C. *Acceptance.* In May 1985, the US Environmental Protection Agency (USEPA) entered into a cooperative agreement with a consortium led by NSF International (NSF) to develop voluntary third-party consensus standards and a certification program for direct and indirect drinking water additives. Other members of the original consortium included the Water Research Foundation (formerly AwwaRF) and the Conference of State Health and Environmental Managers (COSHEM). AWWA and the Association of State Drinking Water Administrators (ASDWA) joined later.

---

\* American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036.

In the United States, authority to regulate products for use in, or in contact with, drinking water rests with individual states.<sup>†</sup> Local agencies may choose to impose requirements more stringent than those required by the state. To evaluate the health effects of products and drinking water additives from such products, state and local agencies may use various references, including

1. Specific policies of the state or local agency.
2. Two standards developed under the direction of NSF<sup>‡</sup>: NSF/ANSI/CAN 60, Drinking Water Treatment Chemicals—Health Effects, and NSF/ANSI/CAN 61, Drinking Water System Components—Health Effects.
3. Other references, including AWWA standards, *Food Chemicals Codex*, *Water Chemicals Codex*,<sup>§</sup> and other standards considered appropriate by the state or local agency.

Various certification organizations may be involved in certifying products in accordance with NSF/ANSI/CAN 61. Individual states or local agencies have authority to accept or accredit certification organizations within their jurisdictions. Accreditation of certification organizations may vary from jurisdiction to jurisdiction.

Annex A to NSF/ANSI/CAN 61, “Toxicology Review and Evaluation Procedures,” does not stipulate a maximum allowable level (MAL) or contaminant for substances not regulated by a USEPA final maximum contaminant level (MCL). The MALs of an unspecified list of “unregulated contaminants” are based on toxicity testing guidelines (noncarcinogens) and risk characterization methodology (carcinogens). Use of Annex A procedures may not always be identical, depending on the certifier.

ANSI/AWWA C903 does not address additives requirements. Users of this standard should consult the appropriate state or local agency having jurisdiction in order to

1. Determine additives requirements, including applicable standards.
2. Determine the status of certifications by parties offering to certify products for contact with, or treatment of, drinking water.
3. Determine current information on product certification.

**II. Special Issues.** Information on product selection and installation is provided in this foreword for the benefit of the users of this standard.

---

<sup>†</sup> Persons outside the United States should contact the appropriate authority having jurisdiction.

<sup>‡</sup> NSF International, 789 North Dixboro Road, Ann Arbor, MI 48105.

<sup>§</sup> Both publications available from The National Academies Press, 500 Fifth Street NW, Keck 360, Washington, DC 20001.

## II.A. Pipe Selection.

II.A.1. Pressure rating. The pipe pressure rating for a specific application should be based on a detailed evaluation of the operating pressure, the installation configuration, joining methods and fitting types, use of coiled or straight products, installed bend radii, working temperature, disinfection type and concentration, and surge pressure.

NOTE: The designer should consider the frequency of surge events and the magnitude of the surge pressure.

The pressure rating of the pipe selected should be equal to or greater than the sum of the maximum expected system operating pressure and maximum surge pressure not to exceed 200 psi (1380 kPa). If the maximum expected system operating pressure and maximum surge pressure exceed 200 psi (1380 kPa), consideration should be given to the removal of the cause of surge pressures, reduction of the surge pressure to an acceptable value, or the incorporation of surge suppressors in the system.

Pressure rating ( $PR$ ), operating pressure ( $P_{operating}$ ), and surge pressure ( $PS$ ), are related by the following equation:

$$PR \geq P_{operating} + PS \quad (\text{Eq F-1})$$

The pressure rating for pipe specified in ANSI/AWWA C903 is given in Table 4 for use with water at 73.4°F (23°C). Consult the manufacturer for ratings at additional temperatures.

II.A.2. Calculation of surge pressure. Surge pressure generated by velocity changes in PE-AL-PE service lines may be estimated using the equations provided in this section. In addition, surges occurring either upstream in mains or downstream in a user's plumbing system should be considered for their effect on the service line. Surge (water hammer) problems are complex; their solutions require specialized knowledge.

The wave velocity and surge pressure that result from abrupt changes in the velocity of a column of water moving through a restrained pipe may be calculated using the following equations:

$$a = \sqrt{\frac{\left(\frac{K}{\rho}\right)}{\left(1 + \frac{Kd}{E_{PE}(t_{PEi} + t_{PEo}) + E_{AL}(t_{AL})}\right)}} \quad (\text{Eq F-2})$$

$$P_s = \rho V_o a \quad (\text{Eq F-3})$$

where:

- $a$  = wave velocity, ft/sec (m/sec)
- $K$  = bulk modulus of water 294,000 lb/in.<sup>2</sup> (2,100 MPa)
- $\rho$  = density of water 0.036 lb/in.<sup>3</sup> (1,000 kg/m<sup>3</sup>)
- $d$  = internal diameter, in. (mm)
- $t$  = equivalent thickness of polyethylene, in. (mm)
- $t_{PEi}$  = inner polyethylene layer thickness, in. (mm)
- $E_{AL}$  = elastic modulus of aluminum, 4.20 × 10<sup>6</sup> psi (30,000 MPa)
- $E_{PE}$  = dynamic modulus of polyethylene, 150,000 psi (1,047 MPa)
- $t_{AL}$  = aluminum layer thickness, in. (mm)
- $t_{PEo}$  = outer polyethylene layer thickness, in. (mm)
- $P_s$  = surge pressure, psig (MPa)
- $v_o$  = change in flow velocity, ft/sec (m/sec)


Table F-1 shows surge pressures resulting from an instantaneous change in velocity of 1 ft/sec (0.3048 m/sec), as calculated from the earlier equations. The anticipated surge and the instantaneous change in velocity are directly related; therefore, the surge resulting from higher velocity changes is a multiple of the values given in this table (i.e., the surge anticipated at a velocity of 5 ft/sec [1.524 m/sec] is five times the value at 1 ft/sec [0.3048 m/sec]).

**Table F-1** Surge pressures and maximum allowable instantaneous change in velocity in PE–AL–PE (PR 200 psi) pipe

Nominal ID Size	Surge Pressure		Maximum Allowable Instantaneous Change in Velocity*	
	psig	(kPa)	ft/sec	(m/sec)
12	29.5	(205.4)	3.4	(1.0)
16	29.0	(201.7)	3.4	(1.0)
20	26.5	(184.3)	3.8	(1.2)
25	25.0	(173.8)	4.0	(1.2)
32	23.3	(161.8)	4.3	(1.3)
41	22.2	(154.2)	4.5	(1.4)
51	19.5	(135.4)	5.1	(1.6)

\* Maximum allowable instantaneous change in velocity is based on a 100-psi maximum surge pressure determined at 1 ft/sec (0.3048m/sec) velocity change.

NOTE: This is a metric-sized pipe product; therefore, the nominal pipe size is metric only.

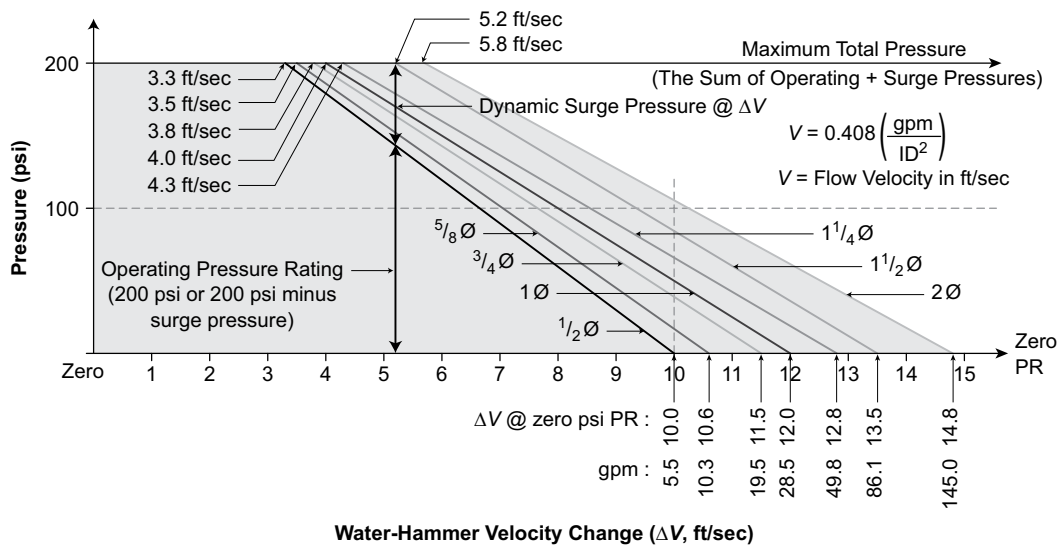

**Figure F-1** Dynamic pressure rating chart

Because the end user cannot determine the rate of extinguished instant velocity (ft/sec or m/sec), the service line designer should assume full flow at an expected delivery pressure, determine the worst-case flow velocity, and determine the operating pressure rating (*PR*) from Figure F-1.

#### II.B Installation.

II.B.1 Storage and handling. PE-AL-PE pipe should be stored and handled using methods that prevent damage caused by crushing, abrasion, piercing, excessive heat, harmful chemicals, or exposure to sunlight.

Therefore, handling operations, trench installation, and backfill should be performed with reasonable care.

To prevent damage by excessive abrasion and cutting, pipe should not be dragged over rough ground or over sharp-edged material. A pipe section that has been damaged such that the aluminum core is exposed shall be removed, discarded, and replaced.

II.B.2. Bending. Bends in PE-AL-PE pipe should be at least 10 diameters from any fitting or valve. The recommended minimum radius of curvature is shown in Table F-2. Observe the manufacturer's instructions and recommendations for bending pipe. Avoid bending in opposite directions as this could damage the pipe; follow manufacturer's instructions. If pipe becomes out of round from mishandling or bending, the section may be rerounded in accordance with manufacturer's instructions. Pipe shall not be kinked either during or after installation. Kinked pipe sections shall be removed, discarded, and replaced.

**Table F-2** Minimum bending radius for PE–AL–PE pipe

Nominal Pipe Size	Minimum Bending Radius*	
	<i>mm</i>	<i>in.</i>
12	3.2	(80)
16	4.0	(100)
20	5.0	(125)
25	6.3	(160)
32	7.5	(190)
41	8.8	(225)
51	11.6	(295)

\* Manufacturer's recommendations, procedures, and equipment should be used when bending the pipe.  
NOTE: This is a metric-sized pipe product; therefore, the nominal pipe size is metric only.

II.B.3. Fittings. PE–AL–PE pipe shall not be flared or threaded. Fittings shall be specifically intended for use with AWWA C903 PE–AL–PE pipe and shall be so identified on packaging, installation instructions, or fitting markings.

The use of a fitting not covered by a nationally accredited standard is subject to the judgment and discretion of the purchaser. Each such fitting should be qualified for use by investigation and by tests when necessary to determine that the fitting is suitable and safe for the intended service.

II.B.4. Earth loads. For small-diameter pipe that is properly installed in accordance with ASTM D2774, the effects of distributed earth loads can usually be disregarded.

NOTE: ASTM D2774 does not strictly cover composites but general guidance can be obtained from ASTM D2774.

II.B.5. Embedment of pipe. In underground installations, PE–AL–PE pipe should be installed in trench bottoms that provide continuous support and are uniform and free from rocks, stones, debris, or any substance that could impinge on the pipe (reference ASTM D2774). The initial backfill material around the pipe from 3 in. (8 cm) below the pipeline to 4–6 in. (10–15 cm) above the pipe should be as permitted in ASTM D2774. Excavated trench material may be used if it meets the requirements of ASTM D2774. To prevent freezing in water lines, pipe should be installed below the frost line. PE–AL–PE pipe should not be installed through auger or bore holes.

II.B.6. Live loads. Pipe should be installed using embedment and installation practices that limit construction loads, earth loads, and any static (structure) and dynamic (traffic) surface loads to the design capabilities of the pipe. If the installation is to be subjected to surface traffic, provide a minimum cover of at least 12 in. (30.5 cm).

Determine embedment soil maximum density in accordance with ASTM D698. Install and compact embedment to at least 90 percent of the laboratory maximum density as determined using field soil density measurement equipment.

II.B.7. Concentrated loads. Pipe installations should be designed and constructed to preclude localized concentrated loadings, such as point contact with stones; the effect of differential earth settlement, particularly at points of connection with rigidly anchored fittings; and excessive bending caused by installation configuration, especially fittings.

II.B.8. Under-slab installation. Properly embedded PE–AL–PE pipe with sufficient cover may be installed under a concrete slab if permitted by the authority having jurisdiction.

II.B.9. Testing. The installation should be tested for leakage in accordance with the applicable code or engineering standard before acceptance by the owner.

II.B.10. Permeation. Composite pipes described in this standard are manufactured with a welded aluminum tube jacketed by inner and outer layers of PE. The inner and outer layers are bonded to the aluminum tube by a polymeric hot-melt adhesive. This aluminum tube provides a barrier to the permeation of external contaminants. If an installation includes buried joints, the ability of the joint to resist permeation shall be considered. Damage that perforates the inner or outer PE layers or absorption by the outer layer of a permeating hydrocarbon may adversely affect the composite structure of the product and may result in increased susceptibility to permeation.

II.C. *Water System Disinfection.* Newly installed or replaced PE–AL–PE pipe should be disinfected in accordance with ANSI/AWWA C651, Disinfecting Water Mains. After disinfecting, the system should be immediately purged, including isolated or stagnant service lines. Highly chlorinated solutions should not be left in the pipeline beyond the few hours needed to provide disinfection.

II.D. *References.* The latest editions of the following documents are referenced in the foreword. These references are provided for information only and are not a part of the foreword of ANSI/AWWA C903.

ANSI/AWWA C651—Disinfecting Water Mains.

ASTM\* D698—Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft<sup>3</sup> [600 kN-m/m<sup>3</sup>]).

---

\* ASTM International, 100 Barr Harbor Drive, West Conshohocken, PA 19428.

ASTM D2774—Standard Practice for Underground Installation of Thermoplastic Pressure Piping.

NSF<sup>†</sup>/ANSI/CAN<sup>‡</sup> 60—Drinking Water Treatment Chemicals—Health Effects.

NSF/ANSI/CAN 61—Drinking Water System Components—Health Effects.

**III. Use of This Standard.** It is the responsibility of the user of an AWWA standard to determine that the products described in that standard are suitable for use in the particular application being considered.

III.A. *Purchaser Options and Alternatives.* The following items should be provided by the purchaser:

1. Standard used—that is, ANSI/AWWA C903, Polyethylene–Aluminum–Polyethylene (PE-AL-PE) Composite Pressure Pipe, 12 mm (½ In.) Through 51 mm (2 In.), for Buried Water Service, of latest revision.

2. Whether compliance with NSF/ANSI/CAN 61, Drinking Water System Components—Health Effects, is required in addition to the requirements of the Safe Drinking Water Act.

3. Details of federal, state, provincial, territorial, and local requirements (Sec. 4.2).

4. Pipe details. The following details should be specified:

- a. Standard code designation of the PE material (Sec. 4.2.1).
- b. Nominal size and pressure rating.
- c. PE–AL–PE pipe material.

5. Specifications. The following requirements should be specified:

- a. Testing frequency, quality control records, and plant inspection.
- b. Marking (Sec. 6.1).
- c. Special shipment (Sec. 6.2).
- d. Affidavit of compliance (Sec. 6.3).

III.B. *Modification to Standard.* Any modifications to the provisions, definitions, or terminology in this standard must be provided by the purchaser.

**IV. Major Revisions.** Major changes made to the standard in this edition include the following:

1. The UV resistance code information for PE compounds have been updated and include reference to ANSI/AWWA C901 requirements (Sec. 4.2.1).

---

<sup>†</sup> NSF International, 789 North Dixboro Road, Ann Arbor, MI 48105.

<sup>‡</sup> Standards Council of Canada, 55 Metcalfe Street, Suite 600, Ottawa, ON K1P 6L5 Canada.

2. Guidance information on fittings has been moved from the foreword (Sec. II.B.3) into the body of the standard as requirements (Sec. 4.3.4).

3. Plant access requirements regarding proprietary processes have been clarified and updated (Sec. 5.6.3).

**V. Comments.** If you have any comments or questions about this standard, please call AWWA Engineering and Technical Services at 303.794.7711, write to the department at 6666 West Quincy Avenue, Denver, CO 80235-3098, or email the group at [standards@awwa.org](mailto:standards@awwa.org).

This page intentionally blank.



**American Water Works  
Association**

*Dedicated to the World's Most Important Resource®*

**ANSI/AWWA C903-21**  
(Revision of ANSI/AWWA C903-16)

**AWWA Standard**

---

# Polyethylene–Aluminum–Polyethylene (PE–AL–PE) Composite Pressure Pipe, 12 mm (½ In.) Through 51 mm (2 In.), for Water Service

---

## SECTION 1: GENERAL

---

### Sec. 1.1 Scope

This standard describes the requirements for composite polyethylene–aluminum–polyethylene pipe (hereinafter referred to as PE–AL–PE) in metric nominal inside diameter (ID) sizes 12 mm (½ in.) through 51 mm (2 in.). The pipe described by this standard is intended to be used for potable cold-water supply outside buildings as buried water main and service pipeline.

This standard specifies the general requirements, material requirements, process fabrication processes, test requirements, and performance requirements. PE–AL–PE pipe is based on five layers consisting of pipe-grade polyethylene thermoplastics adhesively bonded to the seam-welded aluminum tube of specified alloy, composition, and temper.

The PE–AL–PE construction, illustrated in Figure 1, is composed of five layers consisting of (layer 1) a thick stress-bearing inner liner layer of extruded polyethylene fused to (layer 2) a thin melt-laminated or co-extruded maleic-anhydride modified linear low-density (LLD) polyolefin adhesive material layer