



**American Water Works
Association**

Dedicated to the World's Most Important Resource®

ANSI/AWWA C907-17
(Revision of ANSI/AWWA C907-12)

AWWA Standard

Injection-Molded Polyvinyl Chloride (PVC) Pressure Fittings, 4 In. Through 12 In. (100 mm Through 300 mm), for Water, Wastewater, and Reclaimed Water Service

Effective date: Nov. 1, 2017.

First edition approved by AWWA Board of Directors June 23, 1991.

This edition approved June 11, 2017.

Approved by American National Standards Institute May 4, 2017.




AWWA Standard

This document is an American Water Works Association (AWWA) standard. It is not a specification. AWWA standards describe minimum requirements and do not contain all of the engineering and administrative information normally contained in specifications. The AWWA standards usually contain options that must be evaluated by the user of the standard. Until each optional feature is specified by the user, the product or service is not fully defined. AWWA publication of a standard does not constitute endorsement of any product or product type, nor does AWWA test, certify, or approve any product. The use of AWWA standards is entirely voluntary. This standard does not supersede or take precedence over or displace any applicable law, regulation, or code of any governmental authority. AWWA standards are intended to represent a consensus of the water industry that the product described will provide satisfactory service. When AWWA revises or withdraws this standard, an official notice of action will be placed on the first page of the Official Notice section of *Journal – American Water Works Association*. The action becomes effective on the first day of the month following the month of *Journal – American Water Works Association* publication of the official notice.

American National Standard

An American National Standard implies a consensus of those substantially concerned with its scope and provisions. An American National Standard is intended as a guide to aid the manufacturer, the consumer, and the general public. The existence of an American National Standard does not in any respect preclude anyone, whether that person has approved the standard or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standard. American National Standards are subject to periodic review, and users are cautioned to obtain the latest editions. Producers of goods made in conformity with an American National Standard are encouraged to state on their own responsibility in advertising and promotional materials or on tags or labels that the goods are produced in conformity with particular American National Standards.

CAUTION NOTICE: The American National Standards Institute (ANSI) approval mark on the front cover of this standard indicates completion of the ANSI approval process. This American National Standard may be revised or withdrawn at any time. ANSI procedures require that action be taken to reaffirm, revise, or withdraw this standard no later than five years from the date of publication. Purchasers of American National Standards may receive current information on all standards by calling or writing the American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036; 212.642.4900; or emailing info@ansi.org.

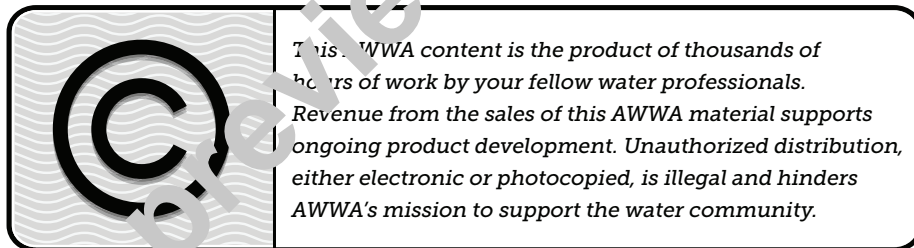

ISBN 987-1-62576-251-0

eISBN 978-1-61300-447-0

DOI: <http://dx.doi.org/10.12999/AWWA.C907.17>

All rights reserved. No part of this publication may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopy, recording, or any information or retrieval system, except in the form of brief excerpts or quotations for review purposes, without the written permission of the publisher.

Copyright © 2017 by American Water Works Association
Printed in USA

Committee Personnel

The Standard C907 subcommittee that developed this standard had the following personnel at the time:

Larry Gill, *Chair*

John Riordan, *Vice-Chair*

General Interest Members

L.J. Gill, IPEX Management Inc., Oakville, Ont., Canada (AWWA)

J. Riordan, HARCO Fittings, Lynchburg, Va. (AWWA)

User Members

K.S. Jeng-Bullock, City of Houston Public Works and Engineering, Houston, Texas (AWWA)

The AWWA Standards Committee on PVC Pressure Pipe and Fittings, which developed and approved this standard, had the following personnel at the time of approval:

Bill Whiddon, *Chair*

Robert P. Walker, *Vice-Chair*

General Interest Members

J.P. Castronovo, Consultant, Blue Ridge, Ga. (AWWA)

A. Chastain-Howley,* Black & Veatch, Frisco, Texas (AWWA)

A.J. Ciechanowski, NSF International, Ann Arbor, Mich. (AWWA)

S.J. Cook, Black & Veatch, Virginia Beach, Va. (AWWA)

S. Ferry, PSILab Inc., Longmont, Colo. (AWWA)

J. Hebenstreit, UL LLC, Northbrook, Ill. (UL)

S.C. Macleod† Melville, N.Y. (AWWA)

M.T. Marino, Nussbaumer & Clarke Inc., Buffalo, N.Y. (AWWA)

T.J. McCandless,* Standards Engineer Liaison, AWWA, Denver, Colo. (AWWA)

S.A.M. Kelvie,† HDR Engineering Inc., Boston, Mass. (AWWA)

I.R. Paschal, Paschal Engineering LLC, Howell, Mich. (AWWA)

* Liaison, nonvoting

† Alternate

J.K. Snyder, Snyder Environmental Engineering Associates, Audubon, Pa. (AWWA)
W.R. Whidden, Woolpert, Winter Park, Fla. (AWWA)

Producer Members

R.R. Bishop, Diamond Plastics Corporation, Grand Island, Neb. (AWWA)
S.E. Cooper, Uni-Bell PVC Pipe Association, Louisville, Ky. (AWWA)
L.J. Gill, IPEX Management Inc., Oakville, Ont., Canada (AWWA)
G. Gundel,* Specified Fittings Inc., Bellingham, Wash. (AWWA)
M. Huynh, JM Manufacturing Company Inc. DBA JM Eagle, Los Angeles, Calif. (AWWA)
R. Magargal,* CertainTeed Corporation, Valley Forge, Pa. (AWWA)
T. Marti,* Underground Solutions Inc., Warrendale, Pa. (AWWA)
J. Riordan, HARCO Fittings, Lynchburg, Va. (AWWA)
L.D. Schmidt,* Diamond Plastics Corporation, Grand Island, Neb. (AWWA)
B. Sukolsky, Specified Fittings, Bellingham, Wash. (AWWA)
R.P. Walker, Underground Solutions Inc., Southlake, Texas (AWWA)

User Members

J.R. Barbier, Denver Water, Denver, Colo. (AWWA)
L.M. Bowles, Bureau of Reclamation, Denver, Colo. (AWWA)
K.S. Jeng-Bulloch, City of Houston Public Works and Engineering, Houston, Texas (AWWA)
A. Korell, City of North Bay, North Bay, Ont., Canada (AWWA)
J. Larson, Marshall Municipal Utilities, Marshall, Minn. (AWWA)
T.E. Layton, Orange County Utilities, Orlando, Fla. (AWWA)
V.B. Sandoval, Natural Resources Conservation Service, Boise, Idaho (AWWA)

* Alternate

Contents

All AWWA standards follow the general format indicated subsequently. Some variations from this format may be found in a particular standard.

SEC.	PAGE	SEC.	PAGE
Foreword			
I	Introduction.....	vii	
I.A	Background.....	vii	
I.B	History.....	vii	
I.C	Acceptance.....	vii	
II	Special Issues.....	viii	
II.A	Proper Design Consideration.....	viii	
II.B	Gasket Materials.....	ix	
III	Use of This Standard.....	ix	
III.A	Purchaser Options and Alternatives.....	ix	
III.B	Modification to Standard.....	x	
IV	Major Revisions.....	x	
V	Comments.....	x	
Standard			
1	General		
1.1	Scope.....	1	
1.2	Purpose.....	2	
1.3	Application.....	2	
2	References	2	
3	Definitions	3	
4	Requirements		
4.1	Permeation.....	5	
4.2	Materials.....	5	
4.3	Fitting Requirements.....	6	
4.4	Pressure Class of Fittings.....	15	
4.5	Pressure Class Thermal Derating Factors.....	15	
4.6	Surge Pressure.....	16	
5	Verification		
5.1	Test Methods.....	17	
5.2	Inspection.....	20	
6	Delivery		
6.1	Making.....	20	
6.2	Shipping and Delivery.....	21	
6.3	Affidavit of Compliance.....	21	
Figures			
1	Typical Bell Designs.....	7	
2	Tees and Reducing Tees.....	8	
3	11¼° Bends (B × B).....	9	
4	22½° Bends (B × B).....	9	
5	45° Bends (B × B).....	9	
6	45° Bends (B × Sp).....	9	
7	90° Bends (B × B).....	10	
8	Increaser/Reducer Coupling (B × Sp).....	10	
9	Line Coupling (B × B).....	10	
10	Repair Coupling (B × B).....	10	
11	Single-Tapped Coupling (B × B × AWWA).....	11	

SEC.	PAGE	SEC.	PAGE	
12	Single-Tapped Coupling (B × B × NPT).....	10	Repair Coupling (B × B).....	
	11	11	Single-Tapped Coupling (B × B × AWWA).....	
13	Double-Tapped Coupling (B × B × AWWA × AWWA).....	12	12	Single-Tapped Coupling (B × B × NPT).....
14	Plug (Sp).....	12	13	Double-Tapped Coupling (B × B × AWWA × AWWA).....
15	Tapped Plug (Sp × NPT).....	13	14	Plug (Sp).....
16	IPS × CI Adapter (B × Sp).....	13	15	Tapped Plug (Sp × NPT).....
17	Cap (B).....	14	16	IPS × CI Adapter (B × Sp).....
18	Hydrant Tees.....	14	17	Cap (B).....
			18	Hydrant Tees.....
			19	Temperature Coefficients.....
			20	Allowable Maximum Occasional Surge Pressure Capacity and Allowable Sudden Changes in Water Velocity for Pipe Operating at 73°F (23°C) at Working Pressures Expressed as Percent of Nominal Pressure Class (PC).....
Tables				
1	Wall Thicknesses, Bell Depths, and Inside Diameters of PVC Fittings.....	7		
2	Tees and Reducing Tees.....	8		
3	11¼° Bends (B × B).....	9		
4	22½° Bends (B × B).....	9		
5	45° Bends (B × B).....	9		
6	45° Bends (B × Sp).....	9		
7	90° Bends (B × B).....	10		
8	Increaser/Reducer Coupling (B × Sp).....	10		
9	Line Coupling (B × B).....	10		

Foreword

This foreword is for information only and is not a part of ANSI/AWWA C907.

I. Introduction.

I.A. *Background.* Injection-molded, gasketed PVC fittings are suitable for use exclusively with PVC pipe for underground pressure applications.

I.B. *History.* This is the third edition of ANSI/AWWA C907. In 1966, AWWA appointed Committee 8350-D to study and report on the adaptability of plastic pipe for use within the water industry. The committee presented its report on June 7, 1967, at AWWA's annual conference. The report included a recommendation that a task group be appointed to prepare standards for the use of plastic materials. The AWWA Standards Committee on Thermoplastic Pressure Pipe was established in 1968. Following years of very productive work, the committee was dissolved in June 1988 and replaced by two committees on plastic products: one for polyolefin and one for polyvinyl chloride (PVC) products. The AWWA Committee on PVC Pressure Pipe and Fittings, which prepared this standard, was formed at that time. The first edition of ANSI/AWWA C907, Polyvinyl Chloride (PVC) Pressure Fittings for Water—4 in. Through 8 in. (100 mm Through 200 mm), was approved by the AWWA Board of Directors on June 23, 1991. The second edition, Injection-Molded Polyvinyl Chloride (PVC) Pressure Fittings, 4 In. Through 12 In. (100 mm Through 300 mm.), for Water Distribution, was approved on June 13, 2004. This third edition was approved on June 11, 2017.

I.C. *Acceptance.* In May 1985, the US Environmental Protection Agency (USEPA) entered into a cooperative agreement with a consortium led by NSF International (NSF) to develop voluntary third-party consensus standards and a certification program for direct and indirect drinking water additives. Other members of the original consortium included the Water Research Foundation (formerly AwwaRF) and the Conference of State Health and Environmental Managers (COSHEM). The American Water Works Association (AWWA) and the Association of State Drinking Water Administrators (ASDWA) joined later.

In the United States, authority to regulate products for use in, or in contact with, drinking water rests with individual states.‡ Local agencies may choose to impose requirements more stringent than those required by the state. To evaluate the health

* American National Standards Institute, 25 West 43rd Street, Fourth Floor, New York, NY 10036.

† NSF International, 789 North Dixboro Road, Ann Arbor, MI 48105.

‡ Persons outside the United States should contact the appropriate authority having jurisdiction.

effects of products and drinking water additives from such products, state, provincial, and local agencies may use various references, including

1. Specific policies of the state, provincial, or local agency.
2. Two standards developed under the direction of NSF: NSF/ANSI 60, Drinking Water Treatment Chemicals—Health Effects, and NSF/ANSI 61, Drinking Water System Components—Health Effects.
3. Other references, including AWWA standards, *Food Chemicals Codex*, *Water Chemicals Codex*,* and other standards considered appropriate by the state, provincial, or local agency.

Various certification organizations may be involved in certifying products in accordance with NSF/ANSI 61. Individual states or local agencies have authority to accept or accredit certification organizations within their jurisdictions. Accreditation of certification organizations may vary from jurisdiction to jurisdiction.

Annex A, “Toxicology Review and Evaluation Procedures,” to NSF/ANSI 61 does not stipulate a maximum allowable level (MAL) of a contaminant for substances not regulated by a USEPA final maximum contaminant level (MCL). The MALs of an unspecified list of “unregulated contaminants” are based on toxicity testing guidelines (noncarcinogens) and risk characterization methodology (carcinogens). Use of Annex A procedures may not always be identical, depending on the certifier.

ANSI/AWWA C907 does not address additives requirements. Users of this standard should consult the appropriate state, provincial, or local agency having jurisdiction in order to

1. Determine additives requirements, including applicable standards.
2. Determine the status of certifications by parties offering to certify products for contact with, or treatment of, drinking water.
3. Determine current information on product certification.

II. Specific Issues.

II.A. *Proper Design Consideration.* Attention should be called to the need for users of this standard to provide proper design consideration for

1. French support.
2. Thrust restraint at areas of unbalanced forces.
3. Long-term effect of any anticipated cyclic transient surge pressures.

* Both publications available from National Academy of Sciences, 500 Fifth Street, NW, Washington, DC 20001.

4. Exact critical external or internal dimensions, which should be obtained from the manufacturer.

II.B. *Gasket Materials.*

II.B.1 Selection of Gasket Materials. The selection of materials is critical for water service and distribution piping in locations where there is a possibility that elastomers will be in contact with chlorine or chloramines. Document research has shown that elastomers such as gaskets, seals, valve seats, and encapsulations may degrade when exposed to chlorine or chloramines. The impact of degradation is a function of the type of elastomeric material, chemical concentration, contact surface area, elastomer cross section, and environmental conditions as well as temperature. Careful selection of and specifications for elastomeric materials and the specifics of their application for each water system component should be considered to provide long-term usefulness and minimum degradation (swelling, loss of elasticity, or softening) of the elastomer specified.

II.B.2 Gasket Degradation Study. A pipe gasket, having the hardness of a compressed elastomer with a large mass relative to the small exposed surface area, thus experiences minimal degradation. This was validated in a research paper reported in *Journal AWWA*, Volume 96, Number 4, April 2004, pages 153–160, where the pipe gasket degradation in a 110 mg/L chloramine solution was found to degrade just the exposed surface.

III. Use of This Standard. It is the responsibility of the user of an AWWA standard to determine that the products described in that standard are suitable for use in the particular application being considered.

Accordingly, each user of this standard is responsible for determining that the standard's provisions are suitable for, and compatible with, that user's intended application.

III.A. *Purchaser Options and Alternatives.* The following items should be provided by the purchaser.

1. Standard to be used—that is, ANSI/AWWA C907, Injection-Molded Polyvinyl Chloride (PVC) Pressure Fittings, 4 in. Through 12 in. (100 mm Through 300 mm), for Water, Wastewater, and Reclaimed Water Service, of latest revision.
2. Whether compliance with NSF/ANSI 61, Drinking Water System Components—Health Effects, is required.
3. Details of other federal, state or provincial, and local requirements (Sec. 4.2).
4. Fittings.

a. Nominal size, for example, 6 in. (150 mm); or, for tees, 6 in. × 6 in. × 4 in. (150 mm × 150 mm × 100 mm) where naming sequence is body size × body size × leg size.

b. Configuration (for example, tee).

c. Quantity of each size and configuration to be provided.

5. Request for change in testing temperature. (Sec. 5.1.1.1).

6. Requested selection of fittings for testing (Sec. 5.1.1.2).

7. Request for test records (Sec. 5.1.4.2).

8. Request for notification of time and date for in-plant inspection (Sec. 5.2).

9. Request for an affidavit of compliance (Sec. 6.3).

III.B. *Modification to Standard.* Any modification of the provisions, definitions, or terminology in this standard must be provided by the purchaser.

IV. Major Revisions. Major changes made to the standard in this revision include the following:

1. 10-in. and 12-in. 90° bend were added to Table 7.

2. 6 × 6 and 8 × 6 hydrant tees were added to Table 8.

3. Added discussion of elastomers and chloramines to foreword.

V. Comments. If you have any comments or questions about this standard, please call AWWA Engineering and Technical Services at 303.794.7711, FAX at 303.795.7603; write to the department at 6666 West Quincy Avenue, Denver, CO 80235-3098; or email at standards@awwa.org.



**American Water Works
Association**

Dedicated to the World's Most Important Resource®

ANSI/AWWA C907-17
(Revision of ANSI/AWWA C907-12)

AWWA Standard

Injection-Molded Polyvinyl Chloride (PVC) Pressure Fittings, 4 In. Through 12 In. (100 mm Through 300 mm), for Water, Wastewater, and Reclaimed Water Service

SECTION 1: GENERAL

Sec. 1.1 Scope

This standard describes Pressure Class 235 (PC235) polyvinyl chloride (PVC) injection-molded fittings with push-on rubber-gasketed joints in nominal sizes 4 in. through 12 in. (100 mm through 300 mm)* for use in water, wastewater, and reclaimed water service. The fittings are for use with PVC and molecularly oriented polyvinyl chloride (PVCO) pressure pipe having an outside diameter conforming to the dimensions of cast-iron pipe and with dimension ratios (DRs) of 18 (Pressure Class 235) or 25 (Pressure Class 165), as described in ANSI/AWWA C900, Polyvinyl Chloride (PVC) Pressure Pipe and Fabricated Fittings, 4 In. Through 60 In. (100 mm Through 1,500 mm), AWWA Manual M23—*PVC Pipe—Design and Installation*,

* Throughout the body of this standard, metric equivalents (rounded) are set in parentheses next to the US customary units.