

Current STANDARDS

American National Standard

# ANSI/BICSI N1-19

Installation Practices for  
Telecommunications and ICT Cabling and  
Related Cabling Infrastructure



# ANSI/BICSI N1-2019

## *Installation Practices for Telecommunications and ICT Cabling and Related Cabling Infrastructure*

Committee Approval: November 4, 2018

ANSI Final Action: December 6, 2018

First Published: June 5, 2019



Currently in preview, click buy full version

## BICSI International Standards

BICSI international standards contain information deemed to be of technical value to the industry and are published at the request of the originating committee. The BICSI International Standards Program subjects all of its draft standards to a rigorous public review and comment resolution process, which is a part of the full development and approval process for any BICSI international standard.

The BICSI International Standards Program reviews its standards at regular intervals. By the end of the fifth year after a standard's publication, the standard will be reaffirmed, rescinded, or revised according to the submitted standards and comments from all interested parties.

Suggestions for revision should be directed to the BICSI International Standards Program, care of BICSI.

### Copyright

This BICSI document is a standard and is copyright protected. Except as permitted under the applicable laws of the user's country, neither this BICSI standard nor any extract from it may be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, photocopying, recording, or otherwise, without prior written permission from BICSI being secured.

Requests for permission to reproduce this document should be addressed to BICSI.

Reproduction may be subject to royalty payments or a licensing agreement.

Violators may be prosecuted.

**Published by:**



BICSI  
8610 Hidden River Parkway  
Tampa, FL 33637-1000 USA

Copyright © 2019 BICSI  
All rights reserved  
Printed in U.S.A.

## Notice of Disclaimer and Limitation of Liability

BICSI standards and publications are designed to serve the public interest by offering information communication and technology systems design guidelines and best practices. Existence of such standards and publications shall not in any respect preclude any member or nonmember of BICSI from manufacturing or selling products not conforming to such standards and publications, nor shall the existence of such standards and publications preclude their voluntary use, whether the standard is to be used either domestically or internationally.

By publication of this standard, BICSI takes no position respecting the validity of any patent rights or copyrights asserted in connection with any item mentioned in this standard. Additionally, BICSI does not assume any liability to any patent owner, nor does it assume any obligation whatever to parties adopting the standard or publication. Users of this standard are expressly advised that determination of any such patent rights or copyrights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard does not purport to address all safety issues or applicable regulatory requirements associated with its use. It is the responsibility of the user of this standard to review any existing codes and other regulations recognized by the national, regional, local, and other recognized authorities having jurisdiction (AHJ) in conjunction with the use of this standard. Where differences occur, those items listed within the codes or regulations of the AHJ supersede any requirement or recommendation of this standard.

All warranties, express or implied, are disclaimed, including without limitation, any and all warranties concerning the accuracy of the contents, its fitness or appropriateness for a particular purpose or use, its merchantability and its non-infringement of any third party's intellectual property rights. BICSI expressly disclaims any and all responsibilities for the accuracy of the contents and makes no representations or warranties regarding the content's compliance with any applicable statute, rule, or regulation.

BICSI shall not be liable for any and all damages, direct or indirect, arising from or relating to any use of the contents contained herein, including without limitation any and all indirect, special, incidental, or consequential damages (including damages for loss of business, loss of profits, litigation, or the like), whether based upon breach of contract, breach of warranty, tort (including negligence, product liability or otherwise, even if advised of the possibility of such damages). The foregoing negation of damages is a fundamental element of the use of the contents hereof, and these contents would not be published by BICSI without such limitations.

## TABLE OF CONTENTS

<b>PREFACE</b> .....		<b>ix</b>
<b>1 Introduction</b> .....		<b>1</b>
<b>1.1 Purpose</b> .....		<b>1</b>
<b>1.2 Categories of Criteria</b> .....		<b>1</b>
<b>2 Scope</b> .....		<b>1</b>
<b>3 Required Standards and Documents</b> .....		<b>3</b>
<b>4 Definitions, Acronyms, Abbreviations, and Units of Measurement</b> .....		<b>5</b>
<b>4.1 Definitions</b> .....		<b>5</b>
<b>4.2 Acronyms and Abbreviations</b> .....		<b>11</b>
<b>4.3 Units of Measurement</b> .....		<b>12</b>
<b>5 Regulatory and Other Requirements</b> .....		<b>13</b>
<b>5.1 Usage</b> .....		<b>13</b>
<b>6 Support Structures</b> .....		<b>15</b>
<b>6.1 Overview</b> .....		<b>15</b>
<b>6.2 Pathways</b> .....		<b>15</b>
6.2.1 General .....		15
6.2.2 Cable Trays.....		15
6.2.3 Distribution Rings and Spools (Mushrooms) .....		17
6.2.4 Conduits.....		17
6.2.5 Supports.....		19
6.2.6 Surface Raceway .....		19
6.2.7 Non-continuous Pathways .....		20
<b>6.3 Spaces</b> .....		<b>20</b>
6.3.1 Plywood.....		20
6.3.2 Floor Mounted Equipment Racks .....		21
6.3.3 Floor Mounted Cabinets.....		21
6.3.4 Wall-Mounted Equipment Racks and Cabinets.....		21
<b>6.4 Bonding Infrastructure</b> .....		<b>21</b>
6.4.1 General .....		21
6.4.2 Bonding Conductors.....		21
<b>6.5 Installing Cable Support Systems</b> .....		<b>22</b>
6.5.1 General .....		22
6.5.2 Steps—Install Cable Support Systems .....		22
<b>7 Pulling Cable</b> .....		<b>25</b>
<b>7.1 General</b> .....		<b>25</b>
<b>7.2 Cable Pulling Setup</b> .....		<b>25</b>
7.2.1 Overview .....		25
7.2.2 Pulling Horizontal Cable in Conduit .....		26
7.2.3 Pulling Horizontal Cable in Open Ceiling.....		26
7.2.4 Pulling Backbone in Vertical Pathway—From Top Down .....		26
7.2.5 Pulling Backbone in Vertical Pathway—From Bottom Up.....		26
7.2.6 Pulling Backbone—Horizontal.....		26
7.2.7 Cable Pulling Precautions.....		26

<b>8</b>	<b>Firestopping</b> .....	<b>27</b>
<b>8.1</b>	<b>General</b> .....	<b>27</b>
<b>8.2</b>	<b>Typical Installations</b> .....	<b>28</b>
8.2.1	Sealing a Floor Penetration with Putty .....	28
8.2.2	Sealing an Outlet Box with Putty.....	29
8.2.3	Steps—Restore Penetrations (General).....	30
<b>9</b>	<b>Cable Terminations</b> .....	<b>33</b>
<b>9.1</b>	<b>General</b> .....	<b>33</b>
<b>9.2</b>	<b>Pre-termination Functions</b> .....	<b>33</b>
<b>9.3</b>	<b>Copper IDC Termination</b> .....	<b>33</b>
9.3.1	General.....	33
9.3.2	Steps—IDC Termination .....	34
<b>9.4</b>	<b>Fiber Termination</b> .....	<b>35</b>
<b>9.5</b>	<b>Copper Cable Splicing</b> .....	<b>37</b>
<b>9.6</b>	<b>Optical Fiber Cable Splicing</b> .....	<b>38</b>
<b>10</b>	<b>Installation Verification</b> .....	<b>39</b>
<b>10.1</b>	<b>Overview</b> .....	<b>39</b>
<b>10.2</b>	<b>Test Result Documentation</b> .....	<b>39</b>
<b>10.3</b>	<b>Field Test Instruments</b> .....	<b>39</b>
10.3.1	Balanced Twisted-Pair Test Instruments .....	39
10.3.2	Multimode Fiber Test Instruments.....	39
10.3.3	Single-Mode Fiber Test Instruments.....	40
<b>10.4</b>	<b>100 Ohm Balanced UTP and ScTP Cabling</b> .....	<b>40</b>
10.4.1	Performance Parameters .....	40
10.4.2	Permanent Link Test Configuration.....	40
<b>10.5</b>	<b>Optical Fiber Cabling</b> .....	<b>42</b>
10.5.1	Overview.....	42
10.5.2	Performance Parameters .....	42
10.5.3	Multimode Cabling Test Configuration.....	42
10.5.4	Single-mode Cabling Test Configuration .....	44
<b>Appendix A</b>	<b>Related Documents (Informative)</b> .....	<b>45</b>

## INDEX OF FIGURES

<b>Section 2</b>	<b>Scope</b>	
Figure 2-1	Example of a Structured Cabling System.....	1
<b>Section 6</b>	<b>Support Structures</b>	
Figure 6-1	ATR Suspended Ladder Tray (Shown with Retaining Posts) .....	16
Figure 6-2	Elevation View of Cable Tray Installed on the Rear Wall of a Telecommunications Room .....	16
Figure 6-3	Example of a Wall Bracket Support.....	17
Figure 6-4	Mesh Cable Tray Corner (Top View) .....	17
Figure 6-5	Spools (Mushrooms) .....	17
Figure 6-6	Typical Backboard Layout Using Distribution Rings .....	18
Figure 6-7	Example of Stub-up Conduit (Ceiling) .....	20
Figure 6-8	Example of a Stub-out Conduit (Wall).....	20
Figure 6-9	Plywood Installation Over Drywall Using Toggle Bolts.....	21
<b>Section 8</b>	<b>Firestopping</b>	
Figure 8-1	Tear Off Putty .....	28
Figure 8-2	Building Bottom of Penetration Seal.....	28
Figure 8-3	Filling the Penetration .....	28
Figure 8-4	Building a Top on the Penetration.....	29
Figure 8-5	Overlap the Pad on Outlet Box .....	29
Figure 8-6	Second Pad of Putty on Outlet Box.....	29
Figure 8-7	Joining the Pads on an Outlet Box .....	30
Figure 8-8	Conduit Penetration Through Masonry Wall or Floor .....	30
Figure 8-9	Example of a Drywall Fire Seal .....	31
Figure 8-10	Example of a Cable Tray Fire Seal .....	31
<b>Section 9</b>	<b>Cable Termination</b>	
Figure 9-1	TIA 568 Modular Connector Wiring Schemes .....	34
Figure 9-2	In-line Splice Configuration.....	37
Figure 9-3	Foldback Splice Configuration.....	38
Figure 9-4	Shielded Connector and Braid.....	38
<b>Section 10</b>	<b>Installation Verification</b>	
Figure 10-1	Permanent Link Test Configuration (Patch Panel).....	40
Figure 10-2	Channel Test Configuration (Patch Panel) .....	41
Figure 10-3	Example of OLTS Reference Measurement ( $P_1$ ) with One Test Jumper (Multimode) .....	43
Figure 10-4	Example of a Measurement ( $P_2$ ) When Verifying OLTS Test Jumpers (Multimode).....	43
Figure 10-5	Example of a Multimode Link Attenuation Measurement ( $P_2$ ) .....	44

*This page intentionally left blank*

Currently in preview, click buy full version

## INDEX OF TABLES

<b>Section 6</b>	<b>Support Structures</b>	
Table 6-1	Minimum Conduit Bend Radius .....	18
<b>Section 7</b>	<b>Pulling Cable</b>	
Table 7-1	Preferred Color Coding Scheme for Premises Cable Jackets (ref. ANSI/TIA-598-D) .....	25
<b>Section 9</b>	<b>Cable Terminations</b>	
Table 9-1	Balanced Twisted-Pair Color-Code Chart (Up to 600 Pair).....	35
Table 9-2	Loose Tube Optical Fiber Color Code Chart (ref. ANSI/TIA-598-D).....	36
Table 9-3	Buffer Tube Optical Fiber Color Code Chart.....	36
<b>Section 10</b>	<b>Installation Verification</b>	
Table 10-1	Acceptable Mandrel Diameters for Common Multimode Cable Types (five wraps).....	39

*This page intentionally left blank*

## **PREFACE**

### **Revision History**

**June 5, 2019** First publication of this standard, titled ANSI/BICSI N1-2019, *Installation Practices for Telecommunications and ICT Cabling and Related Cabling Infrastructure*

### **Translation Notice**

This standard may have one or more translations available as a reference for the convenience of its readers. As that act of translation may contain inconsistencies with the original text, if differences between the translation and the published English version exist, the English text shall be used as the official and authoritative version.

*This page intentionally left blank*

# 1 Introduction

## 1.1 Purpose

This standard specifies best practices for installation of telecommunications and information communication cabling used for communication, signaling, network and related applications. These installation practices are intended to facilitate compliance with applicable codes (e.g., *National Electrical Code*<sup>®</sup>, *Canadian Electrical Code*<sup>®</sup>) and to follow the recommendations and requirements of applicable standards.

## 1.2 Categories of Criteria

Two categories of criteria are specified - mandatory and advisory.


- Mandatory criteria generally apply to protection, performance, administration, and compatibility; they specify the absolute minimum acceptable requirements.
- Advisory or desirable criteria are presented when their attainment will enhance the general performance of system infrastructure in all its contemplated applications.

Mandatory requirements are designated by the word *shall*; advisory recommendations are designated by the words *should*, *may*, or *desirable*, which are used interchangeably in this standard. When possible, recommendations and requirements were separated to aid in clarity.

# 2 Scope

A structured cabling system is a complete collective configuration of cabling and associated hardware on a premise, which when installed provides a comprehensive telecommunications infrastructure. This infrastructure is intended to support a wide range of telecommunications and information communication technology (ICT) services such as telephone and computer networks. Figure 2-1 illustrates an example of components that comprise a structured cabling system.

This standard describes minimum requirements and procedures for installing the infrastructure supporting telecommunication and ICT cabling (e.g., balanced twisted pair copper cabling, optical fiber cabling) used for signal (e.g., voice, data, video) transmission. Installers should always follow applicable codes and manufacturers' instructions. This standard is intended to be used in describing a "neat and workmanlike manner" as referenced by NFPA 70.

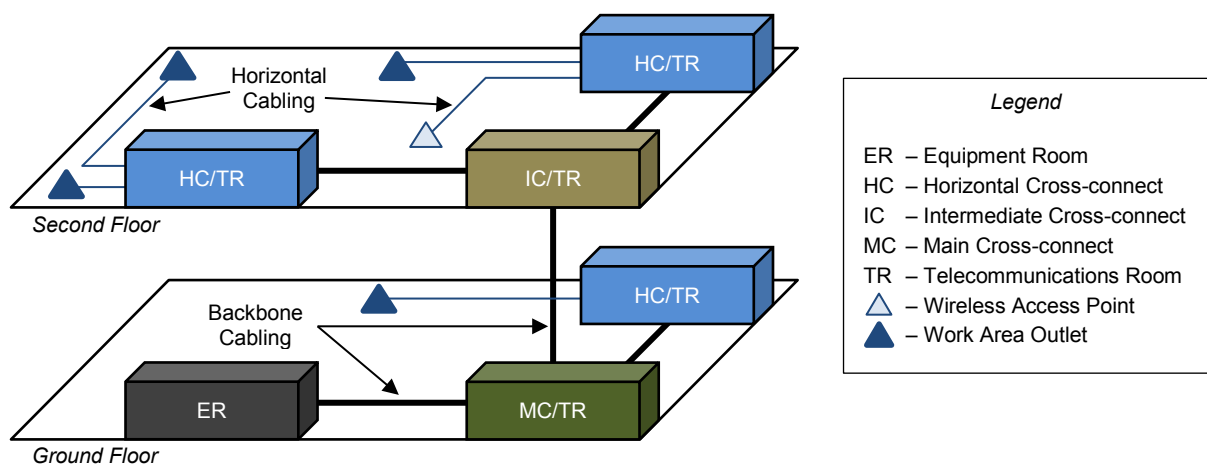

**Figure 2-1**  
**Example of a Structured Cabling System**