

**BS 9999:2017**

*Incorporating Corrigendum No. 1*



**BSI Standards Publication**

**Fire safety in the design,  
management and use of  
buildings – Code of practice**

**bsi.**

**Publishing and copyright information**

The BSI copyright notice displayed in this document indicates when the document was last issued.

© The British Standards Institution 2017

Published by BSI Standards Limited 2017

ISBN 978 0 580 97716 9

ICS 13.220.01; 91.040.01

The following BSI references relate to the work on this document:

Committee reference FSH/14

Draft for comment 16/30314117 DC

**Publication history**

First published October 2008

Second (present) edition, January 2017

**Amendments issued since publication**

Date	Text affected
February 2017	C1. Correction to Table 24

## Contents

Foreword x

### Section 1: General 1

0 Introduction 1

1 Scope 7

2 Normative references 7

3 Terms and definitions 12

4 General recommendations and background 24

4.1 Basis of design 24

4.2 Variation of recommendations 25

4.3 Property protection and business continuity 25

4.4 Environment 25

4.5 Mixed-use buildings incorporating residential use 26

4.6 Additional recommendations for specific building types/occupancies 26

4.7 Inclusive design 26

### Section 2: Risk profiles and assessing risk 28

5 Assessing risk 28

6 Risk profiles 29

6.1 General 29

6.2 Occupancy characteristic 30

6.3 Fire growth rate 30

6.4 Creating the risk profile 32

6.5 Variation of risk profile 33

### Section 3: Ensuring effective fire protection 34

7 Ensuring effective fire protection 34

7.1 General 34

7.2 The design stage 34

7.3 The construction stage 35

7.4 The maintenance stage 36

### Section 4: Designing for the management of fire risk 37

8 Establishing fire risk management systems 37

8.1 General 37

8.2 Management system levels 37

8.3 Implementing fire risk management strategy 38

8.4 Designing fire risk management into buildings 41

9 Fire safety documentation 42

10 Designing so that a building can be managed 42

10.1 General 43

10.2 Management input 43

10.3 Designing for the management of fire prevention 44

10.4 Designing for the management of fire protection 47

### Section 5: Designing means of escape 52

11 Principles of means of escape 52

12 Evacuation strategy 54

12.1 General 54

12.2 Total evacuation 55

12.3 Progressive evacuation 56

<b>13</b>	<b>Internal subdivision and spatial/visual orientation</b>	<b>56</b>
13.1	Compartments	56
13.2	Open spatial (vertical) planning	57
13.3	Atria	57
13.4	High fire risk areas	57
13.5	Process plant and outdoor structures	57
<b>14</b>	<b>Designing means of escape</b>	<b>58</b>
14.1	General	58
14.2	Acceptable means of escape	61
14.3	Generally unacceptable means of escape	62
<b>15</b>	<b>Minimum package of fire protection</b>	<b>62</b>
15.1	General	62
15.2	Fire detection and fire alarm systems	63
15.3	Voice alarms and public address systems	64
15.4	Artificial and emergency escape lighting	64
15.5	Exit signs	64
15.6	Doors	65
15.7	Protected power circuits	67
15.8	Fire protection of lift installations	71
15.9	Mechanical ventilation and air conditioning systems	72
15.10	Refuse chutes and storage	72
<b>16</b>	<b>Horizontal means of escape</b>	<b>72</b>
16.1	General	72
16.2	Number of occupants	73
16.3	Layout and number of escape routes and exits	73
16.4	Travel distance	84
16.5	Cellular plan floors	85
16.6	Width of doors, corridors and escape routes	86
16.7	Methods of horizontal escape for disabled people	88
<b>17</b>	<b>Vertical means of escape</b>	<b>88</b>
17.1	General	88
17.2	Design of escape stairs	89
17.3	Number of escape stairs	91
17.4	Width of escape stairs	92
17.5	Basement stairs	93
17.6	Protected stairs	94
17.7	External escape stairs	95
17.8	Methods of vertical escape for disabled people	97
<b>18</b>	<b>Additional fire protection measures</b>	<b>97</b>
18.1	General	97
18.2	Automatic detection and informative warning systems	102
18.3	Effect of ceiling heights	102
18.4	Maximum acceptable variations	103
<b>Section 6: Access and facilities for fire-fighting</b>		<b>105</b>
<b>19</b>	<b>General recommendations for fire-fighting facilities</b>	<b>105</b>
<b>20</b>	<b>Facilities for fire-fighting</b>	<b>106</b>
20.1	Provision and siting of fire-fighting shafts	106
20.2	Layout of fire-fighting shafts	109
20.3	Construction of fire-fighting shafts	114
20.4	Firefighters lifts	117
<b>21</b>	<b>Vehicle access</b>	<b>123</b>
21.1	General	123
21.2	Buildings not fitted with fire mains	123
21.3	Access for high-reach appliances	125
21.4	Buildings fitted with fire mains	125

<b>22</b>	<b>Water supplies for fire and rescue service use</b>	<b>127</b>
22.1	Fire mains	127
22.2	Location and access to external water supply	127
<b>23</b>	<b>Communications systems for fire and rescue service use</b>	<b>128</b>
<b>24</b>	<b>Fire control centre</b>	<b>128</b>
<b>25</b>	<b>Fire-fighters' emergency switches for discharge lighting installation</b>	<b>130</b>
<b>26</b>	<b>Drawings for fire and rescue service use</b>	<b>130</b>
<b>27</b>	<b>Heat and smoke control</b>	<b>131</b>
27.1	Smoke control for fire-fighting shafts	131
27.2	Venting of smoke and heat from basements	138
27.3	Venting of smoke and heat from covered car parks	139
27.4	Smoke and heat ventilation from loading docks and covered service roadways	139
27.5	Smoke and heat ventilation from protected lobbies and protected corridors	140
<b>28</b>	<b>Electrical services</b>	<b>140</b>
<b>Section 7: Designing the building structure (load-bearing and non-load-bearing elements)</b> 142		
<b>29</b>	<b>Designing the building structure – General</b>	<b>142</b>
<b>30</b>	<b>Fire resistance</b>	<b>143</b>
30.1	Elements of structure	143
30.2	Minimum levels of fire resistance for elements of structure	144
30.3	Glazed fire-resisting elements	151
30.4	Glazing and the effects of sprinklers	155
<b>31</b>	<b>Compartmentation</b>	<b>155</b>
31.1	Fire resistance of compartments	156
31.2	Size of compartments	157
31.3	Provision of compartmentation	157
31.4	Construction of compartment walls and compartment floors	160
<b>32</b>	<b>Openings</b>	<b>167</b>
32.1	Fire doors	167
32.2	Shutter assemblies	171
32.3	Active fire curtain barrier assemblies	172
32.4	Access panels	172
32.5	Mechanical ventilation and air-conditioning systems	172
32.6	Fire-stopping	182
<b>33</b>	<b>Concealed spaces</b>	<b>182</b>
33.1	Provision of cavity barriers	183
33.2	Extensive cavities	186
33.3	Construction and fixings for cavity barriers	188
<b>34</b>	<b>Materials and finishes</b>	<b>189</b>
34.1	Classification and use of internal wall and ceiling linings	189
34.2	Special roof coverings	195
34.3	Insulating core panels	195
<b>35</b>	<b>External fire spread and building separation</b>	<b>198</b>
35.1	Boundaries	199
35.2	Unprotected area	202
35.3	Degree of separation	204
35.4	Roofs	205
35.5	External fire spread over the external faces of buildings	207
<b>36</b>	<b>Accommodation ancillary to the main use of the building</b>	<b>209</b>
36.1	Engineering services installation rooms	209

36.2	Waste storage and treatment	211
36.3	Storage areas (including receiving and dispatch areas)	211
<b>37</b>	<b>Engineering services</b>	<b>211</b>
37.1	Gas services	211
37.2	Electrical services	212
37.3	Enclosure of engineering services	216
37.4	Lighting	216
37.5	Heating systems	217
37.6	Lifts, escalators, moving walks and goods conveyors	218
37.7	Incinerators	218
	<b>Section 8: Special risk protection</b>	<b>219</b>
<b>38</b>	<b>Special risk protection</b>	<b>219</b>
	<b>Section 9: Managing occupied buildings</b>	<b>220</b>
<b>39</b>	<b>Commissioning and handover</b>	<b>220</b>
39.1	Management issues	220
39.2	Approvals and certification	221
<b>40</b>	<b>Managing occupied buildings</b>	<b>222</b>
40.1	Appointment of fire safety manager and other personnel	222
40.2	Management organization and structure	222
40.3	Overview of the fire safety manager's responsibilities	223
40.4	Buildings occupied by more than one organization	225
40.5	Public areas	225
40.6	Tenants, concessionaires and residents	225
40.7	Caretakers	226
40.8	Continuing control and audit procedures	226
40.9	Communications	226
<b>41</b>	<b>Fire prevention</b>	<b>227</b>
41.1	General	227
41.2	Housekeeping	228
41.3	Audience/crowd control	230
41.4	Arson	230
41.5	Conflicts between security and means of escape	230
41.6	Contractors and subcontractors on the premises and hot work	230
41.7	Maintenance of building plant and equipment	231
<b>42</b>	<b>Ensuring that systems respond properly in an emergency</b>	<b>231</b>
42.1	Escape routes	231
42.2	Maintenance of fire safety equipment and provisions	232
<b>43</b>	<b>Planning the response to a fire</b>	<b>233</b>
43.1	General	233
43.2	The fire routine	234
43.3	Provision for people at particular risk	235
43.4	Fire control centre functions	235
43.5	Evacuation management	236
43.6	Test evacuations (fire drills)	237
43.7	False alarms	238
43.8	Contingency planning for business interruption	238
43.9	Protection of building structure, contents, and the environment	239
43.10	Salvage and damage control	239
<b>44</b>	<b>Emergency actions</b>	<b>240</b>
44.1	General	240
44.2	Action on discovery	241
44.3	Warning and evacuation signals	241
44.4	Calling the fire and rescue service	242
44.5	Evacuation procedures	242

- 44.6 Fighting the fire 243
- 44.7 Receiving the fire and rescue service 244
- 44.8 Completion of evacuation 244
- 44.9 Re-entry to the building 244
- 44.10 After the incident 245
- 45 Evacuation of disabled people 245**
  - 45.1 General 245
  - 45.2 Mobility-impaired people 245
  - 45.3 Wheelchair users 246
  - 45.4 People who are Deaf or hard of hearing 246
  - 45.5 Blind and partially sighted people 246
  - 45.6 People with cognitive disabilities 247
  - 45.7 Use of personal emergency evacuation plans 247
  - 45.8 Use of refuges 248
  - 45.9 Evacuation using lifts 248
  - 45.10 Evacuation using stairways 249
  - 45.11 Test evacuations for people requiring assistance 249
  - 45.12 Fire instructions and training 250
- 46 Management of fire safety prior to full occupation of a building 250**
- 47 Building works, alterations, decommissioning and demolition 251**
  - 47.1 General 252
  - 47.2 Hot work 252
  - 47.3 Change of use of buildings 252
  - 47.4 Units in disuse and areas decommissioned 253

#### Annexes

- Annex A (normative) Additional recommendations for property protection and business continuity 255
- Annex B (normative) Recommendations for atria 260
- Annex C (informative) Design solutions and exemplars for atria 271
- Annex D (normative) Recommendations for theatres, cinemas and similar venues 294
- Annex E (normative) Recommendations for shopping complexes 305
- Annex F (normative) Process plant and outdoor structures 325
- Annex G (normative) Recommendations for refuges and evacuation lifts 329
- Annex H (normative) Fire safety manual 339
- Annex I (normative) Routine inspection and maintenance of fire safety installations 346
- Annex J (normative) Fire control centre and evacuation management 351
- Annex K (informative) Fire safety equipment, facilities and systems 353
- Annex L (informative) Signs and signage 356
- Annex M (normative) Phased evacuation 357
- Annex N (informative) Typical arrangements to keep firefighters lift wells free from water 359
- Annex O (normative) Operational information (emergency packs) for the fire and rescue service 362
- Annex P (normative) Commissioning and handover of smoke control systems 363
- Annex Q (normative) Fire safety training 364
- Annex R (normative) Control of conditions in public areas 366
- Annex S (normative) Recommendations for owners of multi-occupancy residential buildings 369
- Annex T (informative) Examples of fire instruction notice text 371
- Annex U (normative) Audience/crowd control 375
- Annex V (normative) Hot work 377
- Annex W (normative) Routine inspection and maintenance of ventilation and air conditioning ductwork 378
- Annex X (informative) Examples of evacuation strategies 379

Bibliography 381

Index 389

### List of figures

- Figure 1 – Example of the application of BS 9999 to a typical design process 4
- Figure 2 – Comparison of fire and time line development 52
- Figure 3 – Occupant response and travel time 53
- Figure 4 – Escape route on associated floor areas 58
- Figure 5 – Designing means of escape 59
- Figure 6 – Merging flow at final exit level 68
- Figure 7 – Escape routes 45° or more apart 75
- Figure 8 – Inner room and access room 77
- Figure 9 – Exits in a central core 78
- Figure 10 – Dead-end corridors and corridors connecting alternative exits 80
- Figure 11 – Recesses off corridors 82
- Figure 12 – Extension of corridor beyond a protected stairway 82
- Figure 13 – Progressive horizontal evacuation 84
- Figure 14 – Measurement of door width 86
- Figure 15 – External protection to protected stairways – Configurations of stairs and external wall 90
- Figure 16 – Fire resistance of areas adjacent to external stairs 95
- Figure 17 – Process for assessing additional fire protection measures 98
- Figure 18 – Hose distances for the location of fire-fighting shafts and additional riser outlets 108
- Figure 19 – Minimum extent of fire-fighting stairs and lifts in tall buildings and buildings with deep basements 109
- Figure 20 – Typical fire-fighting shaft layout at fire and rescue service access level – Fire and rescue service access at lowest storey 110
- Figure 21 – Typical fire-fighting shaft layout at fire and rescue service access level – Fire and rescue service access directly from open air ground level in a building with basements 111
- Figure 22 – Passenger lifts within a fire-fighting shaft 112
- Figure 23 – Protection of the fire-fighting shaft from external fire 115
- Figure 24 – Firefighters lift within escape stair 119
- Figure 25 – Example of fire-fighting shaft layout for a dual-entry firefighters lift 120
- Figure 26 – Example of building footprint and perimeter 124
- Figure 27 – Relationship between building and hard-standing/access road for high-reach fire appliances 126
- Figure 28 – Free area of smoke ventilators 135
- Figure 29 – Compartment floors 159
- Figure 30 – Junction of a compartment wall with a roof 162
- Figure 31 – Ductwork passing through protected routes (Method 2 or Method 3) 174
- Figure 32 – Ductwork passing through protected routes (Method 4) 174
- Figure 33 – Flues and compartment walls and floors 180
- Figure 34 – Enclosure for drainage or water supply pipes 181
- Figure 35 – Provisions for cavity barriers 184
- Figure 36 – Cavity wall excluded from provisions for cavity barriers 185
- Figure 37 – Fire-resisting ceiling below concealed space 186
- Figure 38 – Provisions for cavity barriers in double-skinned insulated roof sheeting 186
- Figure 39 – Layout restrictions on Class 3 plastic rooflights, TP(b) rooflights and TP(b) lighting diffusers 193
- Figure 40 – Layout restrictions on small Class 3 plastic rooflights, TP(b) rooflights and lighting diffusers 193
- Figure 41 – Thermoplastic cored internal wall and ceiling panels – Typical junction 196
- Figure 42 – Relevant boundaries 200

Figure 43 – Notional boundaries	201
Figure 44 – Combustible surface material as unprotected area	202
Figure 45 – Exclusions from unprotected area calculations	203
Figure 46 – Roof covering adjoining line of compartmentation	206
Figure 47 – Provisions for external surfaces of walls	208
Figure C.1 – Occupancy characteristic and atrium height – Initial decisions	272
Figure C.2 – Occupancy characteristic A – Atrium height less than 30 m	273
Figure C.3 – Occupancy characteristic A – Atrium height greater than 30 m	274
Figure C.4 – Exemplar 1 – Occupancy characteristic A – Atrium height less than 30 m simultaneous evacuation	275
Figure C.5 – Exemplar 2 – Occupancy characteristic A – Atrium height less than 30 m phased evacuation	276
Figure C.6 – Exemplar 3 – Occupancy characteristic A – Atrium height greater than 30 m simultaneous evacuation	277
Figure C.7 – Exemplar 4 – Occupancy characteristic A – Atrium height greater than 30 m phased evacuation	278
Figure C.8 – Occupancy characteristic B – Atrium height less than 18 m	279
Figure C.9 – Occupancy characteristic B – Atrium height less than 18 m not open to floor areas	280
Figure C.10 – Occupancy characteristic B – Atrium height greater than 18 m	281
Figure C.11 – Occupancy characteristic B – Atrium any height greater than 18 m not open to floor areas	282
Figure C.12 – Exemplar 5 – Occupancy characteristic B – Atrium height less than 18 m open to floor areas	283
Figure C.13 – Exemplar 6 – Occupancy characteristic B – Atrium height less than 18 m not open to floor areas, not fire-resisting	284
Figure C.14 – Exemplar 7 – Occupancy characteristic B – Atrium height less than 18 m not open to floor areas, minimum 30 min fire-resisting	285
Figure C.15 – Exemplar 8 – Occupancy characteristic B – Atrium height greater than 18 m open to floor areas	286
Figure C.16 – Exemplar 9 – Occupancy characteristic B – Enclosed atrium of any height greater than 18 m, not fire-resisting	287
Figure C.17 – Exemplar 10 – Occupancy characteristic B – Enclosed atrium of any height greater than 18 m, fire-resisting	288
Figure C.18 – Occupancy characteristic Ciii – Atrium any height	289
Figure C.19 – Occupancy characteristic Ciii – Atrium any height escape through the atrium	290
Figure C.20 – Exemplar 11 – Occupancy characteristic Ciii – Atrium any height escape not through atrium	291
Figure C.21 – Exemplar 12 – Occupancy characteristic Ciii – Atrium any height escape through atrium smoke-separated	292
Figure C.22 – Exemplar 13 – Occupancy characteristic Ciii – Atrium any height escape through atrium not smoke-separated	293
Figure D.1 – Determination of seatway	295
Figure D.2 – Example illustrating protection of balconies with fixed seating	296
Figure D.3 – Seatway width and number of seats in a row	297
Figure D.4 – Transverse and radial gangways	299
Figure E.1 – Access to floor areas in complexes with top floor level less than 7.5 m above fire and rescue service access level (without fire main)	310
Figure E.2 – Access to floor areas in complexes with top floor level not greater than 7.5 m above fire and rescue service access level (with fire main)	311
Figure E.3 – Access to floor areas in complexes with top floor level greater than 7.5 m above fire and rescue service access level	312
Figure E.4 – Alternative escape routes from units	313
Figure E.5 – Service corridors and goods lifts	315
Figure E.6 – Escape routes across service areas	317
Figure G.1 – Wheelchair spaces in protected stairways	331
Figure G.2 – Examples of refuges in buildings not provided with evacuation lifts	332

Figure G.3 – Examples of refuges in buildings provided with evacuation lifts	334
Figure N.1 – Raised threshold to lift entrance	360
Figure N.2 – Drainage grid to lift entrance	360
Figure N.3 – Floor sloped away from lift entrance	361
Figure T.1 – Example of text for a suitable fire instruction notice for use in multi-occupancy residential buildings	372
Figure T.2 – Example of text for a suitable fire instruction notice for use in buildings provided with a single-stage alarm system	373
Figure T.3 – Example of text for a suitable fire instruction notice for use in buildings provided with a two-stage alarm system	374

#### List of tables

Table 1 – Basic factors in assessing fire risks	29
Table 2 – Occupancy characteristics	30
Table 3 – Fire growth rates	31
Table 4 – Risk profiles	32
Table 5 – Management system levels	38
Table 6 – Key factors of any fire risk management strategy	39
Table 7 – Minimum level of fire detection and fire alarm system for premises	63
Table 8 – Provisions for emergency escape lighting	65
Table 9 – Examples of typical floor space factors	73
Table 10 – Minimum number of escape routes and exits from a room, tier or storey	74
Table 11 – Maximum travel distance when minimum fire protection measures are provided	85
Table 12 – Exit widths when minimum fire protection measures are provided	86
Table 13 – Minimum width of escape stairs for simultaneous evacuation	93
Table 14 – Permissible variations in travel distance, door width, corridor width and stair width with ceiling height	93
Table 15 – Maximum travel distances when additional fire protection measures are provided	104
Table 16 – Door widths when additional fire protection measures are provided	104
Table 17 – Provision of fire-fighting facilities	106
Table 18 – Tests for partitions	116
Table 19 – Fire and rescue service vehicle access to buildings (excluding dwellings) lower than 11 m not fitted with fire mains	123
Table 20 – Example of measurements for a typical vehicle access route	125
Table 21 – Recommendations for natural smoke ventilation of fire-fighting shafts	141
Table 22 – Minimum fire resistance performance	146
Table 23 – Fire resistance periods for elements of structure (independent of ventilation conditions)	149
Table 24 – Fire resistance periods for elements of structure (based on the ventilation conditions given in Table 25)	149
Table 25 – Ventilation conditions for application of Table 24	150
Table 26 – Provisions for fire-protecting suspended ceilings	151
Table 27 – Limitations of non-insulating fire-resisting glazed elements	154
Table 28 – Maximum dimensions of compartments	157
Table 29 – Structural fire protection of areas of ancillary accommodation	164
Table 30 – Provisions for fire doors	167
Table 31 – Maximum nominal interior diameter of pipes passing through a compartment wall/floor	181

Table 32 – Maximum dimensions of cavities in non-domestic buildings	187
Table 33 – Classification of linings	190
Table 34 – Limitations applied to thermoplastic rooflights and lighting diffusers in suspended ceilings and Class 3 plastic rooflights	192
Table 35 – Small residential unprotected area limits and boundary distances	205
Table 36 – Separation distances for roof coverings	207
Table D.1 – Number of seats in a row	296
Table D.2 – Maximum travel distances	298
Table E.1 – Compartment size limits for shopping complexes	307
Table F.1 – Maximum travel distances for weather housed plant buildings, weather protected plant and external plant	327

### Summary of pages

This document comprises a front cover, an inside front cover, pages i to xiv, pages 1 to 400, an inside back cover and a back cover.

## Foreword

### Publishing information

This British Standard is published by BSI Standards Limited, under licence from The British Standards Institution, and came into effect on 31 January 2017. It was prepared by Technical Committee FSH/14, *Fire precautions in buildings*. A list of organizations represented on this committee can be obtained on request to its secretary.

### Supersession

This British Standard supersedes BS 9999:2008, which is withdrawn.

### Information about this document

This is a full revision of the standard, and introduces the following principal changes:

- inclusion of flowchart showing the sequential steps in the design process, to assist users in the application of the standard;
- revision of management system levels and inclusion of references to PAS 7;
- inclusion of watermist fire suppression systems;
- expansion of fire growth rates table to give more information;
- expansion of guidance on voice alarms;
- revision of recommendations for smoke and heat control;
- addition of recommendations for fire curtain barrier assemblies;
- revision of recommendations for mechanical ventilation and air-conditioning systems;
- revision of recommendations for shopping complexes;
- removal of content now covered by BS 9991;
- general update to take into account new and revised standards published since 2008.

The concept behind the development of BS 9999 and BS 7974 is that technical guidance on fire safety is provided at three different levels. This permits a design approach to be adopted that corresponds to the complexity of the building and to the degree of flexibility required. The three levels are as follows.

- a) **General approach.** This level is applicable to a majority of building work undertaken within the UK. In this case the fire precautions designed into the building usually follow the guidance contained in the documents published by the relevant government departments to support legislative requirements.
- b) **Advanced approach.** This is the level for which BS 9999 is provided. The provisions of this document allow a more transparent and flexible approach to fire safety design through use of a structured approach to risk-based design where designers can take account of varying physical and human factors. Many of the measures recommended in BS 9999 are based on fire safety engineering principles, although it is not intended as a guide to fire safety engineering.
- c) **Fire safety engineering.** This is the level for which BS 7974 is provided. This level provides an alternative approach to fire safety and can be the only practical way to achieve a satisfactory standard of fire safety in some large and complex buildings, and in buildings containing different uses.

There might be circumstances where it is necessary to use one publication to supplement another, but care needs to be taken when using a “pick-and-mix” approach as it is essential to ensure that an integrated approach is used in any one building.

When evaluating an existing building, e.g. when carrying out a fire risk assessment, it is important to review all general fire precautions and not to use parts of the standard in isolation.

Whilst primarily intended for designers, fire engineers and fire safety managers, it is expected that BS 9999 will also be of use to:

- specifiers, contractors, site supervisors and site safety officers;
- owners, tenants, occupants, facility managers, safety officers and security staff;
- regulators and enforcers, including building control bodies, fire authorities, health and safety inspectors, environmental health officers, and environmental agencies.

BS 9999 is designed as a coordinated package covering the four main areas that influence fire safety measures, namely:

- fire safety management;
- the provisions of means of escape;
- the structural protection of escape facilities and the structural stability of the building in the event of a fire;
- the provision of access and facilities for fire-fighting.

Individual recommendations of this British Standard applied in isolation might give little or no benefit, and might even reduce the level of fire safety. Although the basic principles and recommendations for escape from floor areas are described in Section 5, the most conscientious application of these recommendations could be undermined unless supported by other necessary measures.

Whatever fire safety provisions are made, they can be seriously compromised by a lack of management of fire safety (see Section 4 and Section 9); inadequate facilities for fire-fighting (see Section 6); or a lack of appropriate related measures on construction of the building (see Section 7).

It is important therefore that all those involved in either designing or approving the package of fire safety measures appreciate these interactions and influences. In addition it is important that a record is made of the basis for any package of fire safety measures proposed and approved, whether at the initial design stage or at any subsequent alteration to the building and/or its occupancy.

In developing this British Standard, cognisance has been taken of the guidelines given in CEN/CENELEC Guide 6.

These issues will also form essential components of the overall fire safety strategy adopted in the occupied building to ensure compliance with relevant fire safety legislation.

**Assessed capability.** *Users of this British Standard are advised to consider the desirability of quality system assessment and registration against the appropriate standard in the BS EN ISO 9000 series by an accredited third-party certification body.*

Text introduced or altered by Corrigendum No. 1 is indicated in the text by tags C1 C1. Minor editorial corrections are not tagged.

### Further information

Advice is available from a number of bodies, depending on whether they have a direct responsibility for the enforcement of fire safety in the building concerned. The bodies concerned include:

- local authorities;
- fire and rescue authorities;
- the Health and Safety Executive;
- building control bodies;
- environmental health departments;
- social services;
- education authorities;
- health authorities;
- the Environment Agency;
- consumer protection departments;
- petroleum licensing authorities;
- insurers;
- trade associations.

Advice is also available in books and documents published by:

- Communities and Local Government (for planning and building construction matters and compliance with fire safety in occupied buildings) (<http://www.communities.gov.uk><sup>1)</sup>);
- Buildings Regulations Wales (<http://gov.wales><sup>1)</sup>);
- the Health and Safety Executive (for general and specific health and safety matters concerned with work activities) (<http://www.hse.gov.uk><sup>1)</sup>);
- Scottish Government Building Standards (<http://www.gov.scot><sup>1)</sup>);
- the Department of Finance and Personnel (<https://www.finance-ni.gov.uk/><sup>1)</sup>) and the Department of Health, Social Services and Public Safety (<https://www.health-ni.gov.uk/><sup>1)</sup>) in Northern Ireland.

### Use of this document

As a code of practice, this British Standard takes the form of guidance and recommendations. It should not be quoted as if it were a specification and particular care should be taken to ensure that claims of compliance are not misleading.

Any user claiming compliance with this British Standard is expected to be able to justify any course of action that deviates from its recommendations. Some variation from the recommendations might be necessary for certain specialist buildings or areas of buildings, e.g. areas of lawful detention.

It has been assumed in the preparation of this British Standard that the execution of its provisions will be entrusted to appropriately qualified and experienced people, for whose use it has been produced.

---

<sup>1)</sup> Last accessed 4 January 2017.

## Presentational conventions

The provisions in this standard are presented in roman (i.e. upright) type. Its recommendations are expressed in sentences in which the principal auxiliary verb is “should”.

*Commentary, explanation and general informative material is presented in smaller italic type, and does not constitute a normative element.*

Where words have alternative spellings, the preferred spelling of the Shorter Oxford English Dictionary is used (e.g. “organization” rather than “organisation”).

The word “should” is used to express recommendations of this standard. The word “may” is used in the text to express permissibility, e.g. as an alternative to the primary recommendation of the clause. The word “can” is used to express possibility, e.g. a consequence of an action or an event.

Notes and commentaries are provided throughout the text of this standard. Notes give references and additional information that are important but do not form part of the recommendations. Commentaries give background information.

## Contractual and legal considerations

*NOTE* References are made throughout this British Standard to legislation and guidance applicable in the UK. It is recognized, however, that the standard might be used outside the UK, and in such circumstances, readers of the standard need to be aware of the legislative requirements and sources of further information applicable in their own countries.

Broadly speaking, fire safety legislation in the UK sets out fire safety objectives for various types of premises and their associated activities, and specifies who is responsible for ensuring that they are met. Individual items of legislation generally refer to, and give legal force to, named sets of regulations that are more detailed than the parent legislation. They either specify how certain activities are to be performed, and duties discharged, or they state functional requirements, i.e. they describe the outcome(s) required. When functional requirements are given, the regulations usually refer to other technical guidance and/or standards, including British Standards. Reference is made throughout the text to legislative material of which users of this British Standard need to be aware.

Attention is drawn to regulatory requirements in respect of the following principal stages in the lifetime of a building:

- a) planning – type, size, use, appearance, access and location of a proposed building;
- b) construction – materials, methods, nature and extent of both structural and installed fire safety features, internal and external arrangements for access, and proximity to other buildings;
- c) use – occupants’ activities including storage and use of materials, provision of first aid fire-fighting equipment and fire safety training for occupants, and maintaining means of escape;
- d) maintenance – maintenance of fire safety systems and equipment in occupied and unoccupied buildings;
- e) material alterations and extensions – changes in fire risk or fire safety provisions; fire safety arrangements during construction work;
- f) change of use – changes in fire risk or fire safety provisions;
- g) demolition – fire safety arrangements during demolition work;
- h) when empty – empty buildings are particularly vulnerable to arson.

Attention is drawn to the following specific regulations:

- Building Regulations 2010 [1];
- Regulatory Reform (Fire Safety) Order 2005 [2];
- Building (Amendment) (Wales) Regulations 2014 [3];
- Building (Scotland) Regulations 2004 [4];
- Building Regulations (Northern Ireland) 2012 [5];
- Fire Safety (Scotland) Regulations 2006 [6];
- Fire Safety Regulations (Northern Ireland) 2010 [7].

Particular attention is drawn to the legal requirement under Regulation 38 of the Building Regulations 2010 [1] for relevant fire safety information to be provided to the responsible person on completion of the building, and to the requirements of the Construction Products Regulations 2013 [8].

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

**Compliance with a British Standard cannot confer immunity from legal obligations.**

# Section 1: General

## 0 Introduction

### 0.1 General principles

The design of buildings for fire safety relies upon an understanding of the sources of fire, materials and systems likely to be involved in fire, how people use buildings, and the likely spread of fire.

The recommendations and guidance given in this British Standard are based on the assumption that under normal circumstances (i.e. except in the case of arson) a fire is unlikely to start in two different places in a building.

All fire safety measures, procedures, etc. need to take into account the particular circumstances of the individual building or complex concerned. The same recommendations generally apply to both existing and new buildings, but existing buildings, especially historic buildings, often pose problems which are unlikely to arise in new buildings. In assessing the fire safety management needs of an existing building which is being modified, it is essential to have a full understanding of the existing structure and any fire safety provisions incorporated, and to take into account all of the following:

- a) any change in use of the premises which could affect the fire risk profile (e.g. increased fire load and process risks, introducing the public, changes to sleeping risk, seasonal changes);
- b) how the necessary fire safety levels can be practicably achieved in the existing premises and whether they are appropriate;
- c) historic and environmental aspects of the premises and to what extent they need to be disturbed;
- d) legislation and guidance introduced since the premises were originally constructed, or last altered, or since their fire safety was last assessed;
- e) the interrelationship between life safety and measures to protect property/contents;
- f) business continuity.

Historic buildings present particular challenges, as many are listed and permitted material alterations are therefore limited without the agreement of the appropriate authorities. For such buildings, it is advisable to seek the advice of consultative bodies, such as Historic England, Cadw, Historic Scotland and the Northern Ireland Environment Agency, in the early stages of design.

The appropriate authorities sometimes agree to limited modifications to improve life safety where, in turn, there will be added long-term protection and preservation of the original building fabric.

*NOTE* *Historic Scotland Guides for Practitioners 6 [9] and 7 [10] contain guidance on, respectively, conversion and fire safety management of traditional buildings.*

Specific issues relating to historic buildings can be divided into four areas:

- 1) the preservation of the ambience and important features of the building such as timber linings to accommodation stairs and slender cast iron structure, both of which can sometimes conflict with the desired fire safety construction but can be accommodated with suitable compensating features;
- 2) the existing construction of the building, including hidden features such as the extent of cavities through which fire could spread and the quality of walls, partitions and floors (the fire resistance of which might be unknown

or questionable). Life safety can often be addressed by the use of suitable compensating features, but these do not always cover property protection and business interests;

- 3) the fire performance of the building structure. Although modern construction standards seldom apply to historic buildings, action to improve the level of fire and life safety might be necessary based on change of use or due to the need to reduce the fire risk and potential for loss of the structure and/or interior in any other context;
- 4) the sensitivity of historic structures and interiors (finishes and contents) to fire and smoke damage.

In both new construction and upgrading existing buildings, the various aspects of fire precautions are interrelated and weaknesses in some areas can be compensated for by strengths in others. A higher standard under one of the areas might be of benefit in respect of one or more of the other areas. BS 9999 provides a level of flexibility that allows the fire protection measures and the risks to be assessed to enable reasonable practical solutions to be designed.

Fire precautions in all premises – however old – need to be seen as a whole, a package aimed at achieving an acceptable standard of fire safety. In modifying existing structures, if the new work can be shown not to have a negative impact on the remainder, it is possible that no work will be needed on the remainder, although it might be possible to offer improvement as good practice. Whilst existing buildings need not be retrospectively subject to the same standards as new buildings, however, it is important that designers apply the general principle that the safest practicable design is to be sought, and that the prior existence of an unsafe situation is not allowed to persist if it is practicable to provide remedy.

The principles and recommendations in this British Standard apply straightforwardly where premises have a single main use and are contained in a single, separate building. Complications might arise, however, where a building comprises two or more different main uses. In such cases it is important to consider the effect of one risk on another. A fire in a shop or unattended office could have serious consequences on, for example, a residential or hotel use in the same building. Similarly, a high fire risk in one part of a building could seriously affect other areas in another part of that building.

Amongst the factors that need to be taken into account in establishing a minimum package of fire protection measures are:

- i) the potential users of the building;
- ii) the hazard posed by one occupancy to another;
- iii) provision for giving warning in the event of fire, including any automatic fire detection;
- iv) the provision of automatic fire suppression systems and smoke control arrangements;
- v) the overall management and control of the building or development, from a fire safety point of view;
- vi) structural fire protection and compartmentation;
- vii) the security of and access to the building.

BS 9999 provides recommendations and guidance on the provision of measures to control or mitigate the effects of fire. The primary objective is to ensure that an adequate standard of life safety can be achieved in the event of fire in the building. A secondary objective is to provide a level of protection for property and businesses against the impact of fire, e.g. in close proximity to residential buildings or as part of the same building or building complex. These can also have the effect of assisting the fire and rescue service and/or of providing environmental protection. There are references throughout this British Standard to occupant safety, fire-fighter safety and property protection, to draw attention to the different issues these could raise. It is, however, important to be aware that provisions solely for life safety are unlikely to provide the full level of protection for buildings and property in a fully developed fire scenario.

Section 2 sets out the principles behind the recommendations and introduces the concept of the risk profile. The recommendations for the provision of means of escape and on construction have been developed to reflect the nature of the occupants and the use of the buildings as well as the likely fire growth and resulting risks associated with that use – the risk profile.


## 0.2 Application of BS 9999 to the design process

Users of this British Standard will usually be working within the design environment associated with a particular construction project, governed by legislation, processes, constraints, programmes and deliverables that might vary depending on premises type, location, client and regulatory requirements. Having said this, it is possible to propose a framework for the application of this standard that might help the user to optimize its contribution to a typical project, by offering guidance regarding the stages in that project when certain fire engineering and fire protection design activities might most usefully take place. As an example, it is often important that means of escape and fire-fighting access and facilities are considered reasonably early in the design process, as these often significantly influence the structural engineering and architectural design. If fire safety design input is sought or offered too late, it might prove difficult, time-consuming or costly to rectify.

It is also the case that by its nature this standard cannot be configured to present all the guidance applicable to any particular type of premises in the same place: it offers general recommendations and asks the user to cross-refer to different parts of the standard for situation-specific content (often contained in the annexes). Because of this, there is a risk that users might refer to parts of the general recommendations without acknowledging the existence of the specific recommendations, or might use only the specific recommendations without considering the general recommendations in the body of the standard. It is important that users of this standard use it as a whole; the use of individual parts in isolation (e.g. to justify variation from other codes or standards) might not necessarily result in acceptably safe design solutions.

Figure 1 seeks to assist users in the application of this standard to a typical construction project by suggesting when certain activities might most usefully and constructively be carried out, and by guiding the designer as to which parts of the document would usually be consulted at those stages. It uses as a reference the Royal Institute of British Architects (RIBA) Plan of Work 2013 [11], which describes eight work stages for construction projects from business case and strategic brief through to handover into occupation and use. Each stage has defined boundaries, and the RIBA Plan of Work details the tasks and outputs required at that stage.

Figure 1 Example of the application of BS 9999 to a typical design process

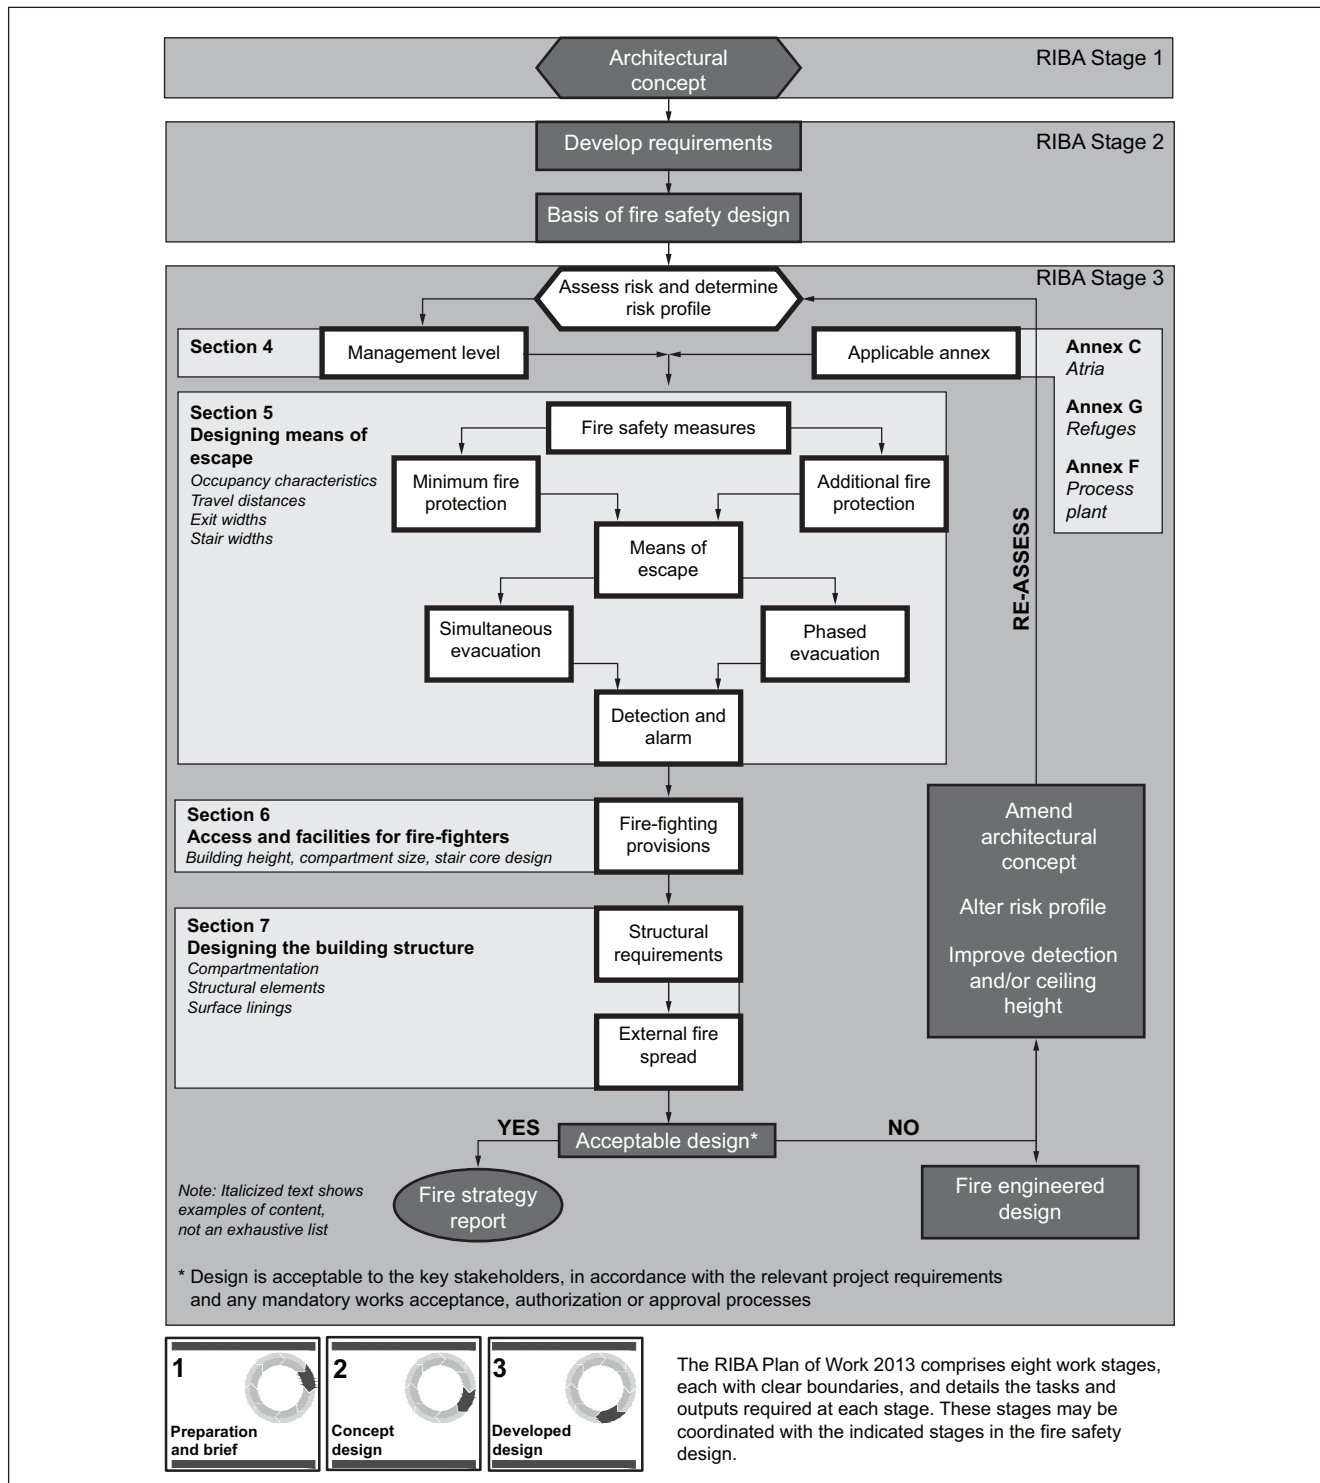

Whilst other project frameworks will be used according to need, with the RIBA plan not being used in many circumstances, it is widely applied and is included to illustrate how the fire-related design activities might most usefully and efficiently be coordinated with civil, architectural and building service design. It is an example of a typical design management process for a building – the activities in the chart will vary from project to project and it is not to be inferred that compliance with this British Standard requires the adoption of the RIBA plan, nor that the stages depicted are to be rigidly applied. The intention is that the principles therein can be adapted to suit the particular design management framework that is to be applied to the building.

Whilst the key components of the fire safety design can be established within the stages represented in the chart, it can be prudent to retain the services of any specialist fire engineering designer responsible for producing the fire strategy beyond these activities. Their support and advice during subsequent work stages up until and including completion and handover can contribute significantly to the safe, successful and timely delivery of the project.

### 0.3 Tall and very tall buildings

The recommendations in this British Standard can be applied to buildings of any height.

However, the increased design demands on structural integrity, services, fire safety systems, means of fire-fighting and evacuation generated by buildings in excess of 50 m high might mean that specific evaluation of all fire safety provisions is needed using a qualitative design review in accordance with BS 7974. This is to determine whether the recommendations in BS 9999 are appropriate, or whether a full fire engineered solution is required.

### 0.4 Management of fire safety

It is a fundamental assumption that features described in this British Standard will require management and maintenance throughout the life of the building.

Managing fire safety is the whole process throughout the life of a building, starting with the initial design, which is intended both to minimize the incidence of fire and to ensure that, when a fire does occur, appropriate fire safety systems (including active, passive, and procedural systems) are in place and are fully functional. Fire safety procedures and maintenance schedules are developed at the design stage and included in the fire safety manual, which is handed over to the person responsible for fire safety of the building in order to enable a suitable and sufficient fire risk assessment to be carried out.

*NOTE Attention is drawn to Regulation 38 of the Building Regulations 2010 [1]. Attention is also drawn to the Regulatory Reform (Fire Safety) Order 2005 [2] and to the equivalent regulations in Scotland [6] and Northern Ireland [7].*

The management of fire safety is thus an essential element in averting the loss of life in the event of a fire. Although many buildings will never have a serious life-threatening fire, it is essential for fire safety procedures to be planned for every building. There are usually numerous elements which contribute to multi-fatality fires, one being that, when fire is discovered or when the alarm is raised, the occupants of premises, be they staff or members of the public, react and respond in ways which are different from those assumed or expected by the building designer. There are a number of stages by which people react to a fire alarm. Initially they tend to seek information regarding the validity of the warning. They then gather belongings or seek associates or family. Only then do they seek to travel to a place of ultimate safety. The management of fire safety is intended to increase awareness and increase the probability of appropriate behaviour, to minimize the threat from the fire.

There have been numerous fire incidents, both large and small, where there have been lives lost or put at risk as a result of the safety systems provided being inappropriate or not being used effectively. In some occupancies (such as football grounds), fire is not always seen as the biggest safety problem and care is needed to avoid it becoming a neglected issue.

It is now widely acknowledged that the design and engineering put into a building for life safety can only do its job properly if it can be managed, maintained and tested over the whole life of the building, and if any staff who might be present are trained to handle incidents and operate effective and tested emergency plans.

Once the designer or engineer has handed over the building, then good management of fire safety becomes the key element to fire safety for the life of the building.

Effective management of fire safety can contribute to the protection of the building occupants in many ways:

- a) by working to prevent fires occurring in the first place;
- b) by carrying out effective risk assessments and reviewing the adequacy of fire safety precautions and built-in measures, including compartmentation and essential elements such as fire doors and fire-resisting walls and screens;
- c) by monitoring the fire risks on an ongoing basis and taking appropriate action to eliminate or reduce the risk;
- d) by being aware of the types of people in the building (such as disabled people, elderly people, children, pregnant women, etc.) and any special risks or needs;
- e) by ensuring that all of the fire safety measures in the building are kept in working order, and in particular that the means of escape are always available;
- f) by training staff and organizing the evacuation plan, to ensure that occupants leave quickly if a fire occurs;
- g) by taking command in the event of a fire until the fire and rescue service arrives.

These tasks differ in detail depending on the occupancy of the building.

## 1 Scope

This British Standard gives recommendations and guidance on the design, management and use of buildings to achieve reasonable standards of fire safety for all people in and around buildings.

This British Standard is not applicable to the following types of building, which are covered in BS 9991:

- a) dwellings (single-family dwelling houses, self-contained flats or maisonettes);
- b) residential accommodation blocks (e.g. for students or hospital staff), with individual bedrooms and the provision of kitchen/sanitary facilities constructed within a fire compartment;
- c) specialized housing.

It is not applicable to houses of multiple occupancy (HMOs) or buildings in which occupants receive medical care. It might have only limited applicability to certain specialist buildings and areas of buildings (e.g. areas of lawful detention).

This British Standard is applicable to the design of new buildings, and to material alterations, extensions and material change of use of an existing building.

*NOTE Attention is drawn to the Building Regulations 2010 [1] and equivalent national variations ([3] to [5]) in respect of the definition of material alterations, extensions and material change of use.*

It also provides recommendations and guidance on the ongoing management of fire safety in a building throughout the entire life cycle of the building, including measures for designers to ensure that the overall design of a building assists and enhances the management of fire safety. It can be used as a tool for assessing existing buildings, although fundamental change in line with its recommendations might be limited or not practicable.

The recommendations and guidance given in this British Standard are intended to safeguard the lives of building occupants and fire-fighters. Whilst some of the recommendations and guidance might also assist in the achievement of other fire safety objectives – such as protection of property, the environment, communities and business/service viability – additional measures might be necessary which are outside the scope of this British Standard.

This British Standard does not cover fire safety design strategies for extreme events such as terrorist actions.

## 2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

### Standards publications

BS 476 (all parts), *Fire tests on building materials and structures*

BS 799-5, *Oil burning equipment – Part 5: Carbon steel oil storage tanks – Specification*

BS 1635, *Recommendations for graphic symbols and abbreviations for fire protection drawings*