


Environmental management of nuclear facilities: Common requirements of the CSA N288 series of Standards

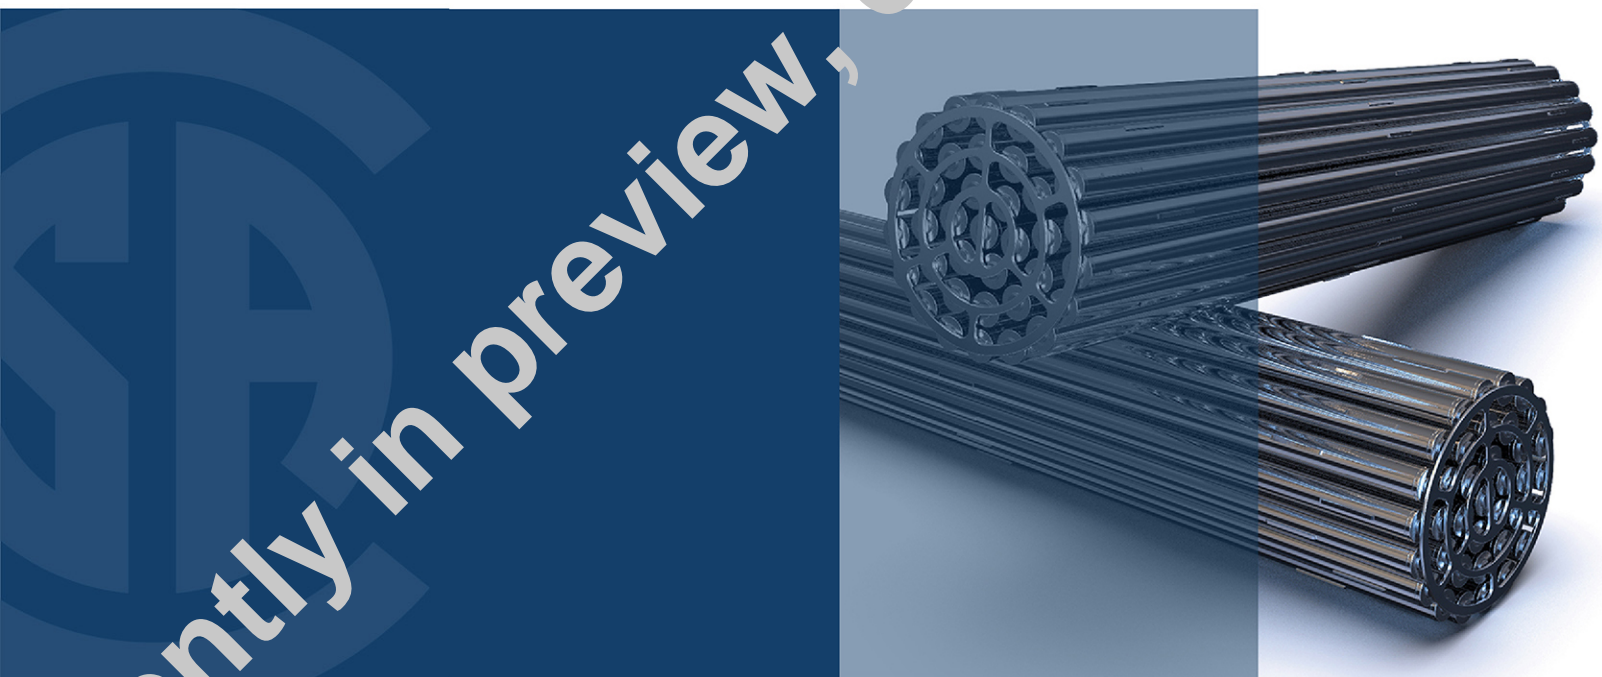

Legal Notice for Standards

Canadian Standards Association (operating as “CSA Group”) develops standards through a consensus standards development process approved by the Standards Council of Canada. This process brings together volunteers representing varied viewpoints and interests to achieve consensus and develop a standard. Although CSA Group administers the process and establishes rules to promote fairness in achieving consensus, it does not independently test, evaluate, or verify the content of standards.

Disclaimer and exclusion of liability

This document is provided without any representations, warranties, or conditions of any kind, express or implied, including, without limitation, implied warranties or conditions concerning this document’s fitness for a particular purpose or use, its merchantability, or its non-infringement of any third party’s intellectual property rights. CSA Group does not warrant the accuracy, completeness, or currency of any of the information published in this document. CSA Group makes no representations or warranties regarding this document’s compliance with any applicable statute, rule, or regulation.

IN NO EVENT SHALL CSA GROUP, ITS VOLUNTEERS, MEMBERS, SUBSIDIARIES, OR AFFILIATED COMPANIES, OR THEIR EMPLOYEES, DIRECTORS, OR OFFICERS, BE LIABLE FOR ANY DIRECT, INDIRECT, OR INCIDENTAL DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES, HOWSOEVER CAUSED, INCLUDING BUT NOT LIMITED TO SPECIAL OR CONSEQUENTIAL DAMAGES, LOST REVENUE, BUSINESS INTERRUPTION, LOST OR DAMAGED DATA, OR ANY OTHER COMMERCIAL OR ECONOMIC LOSS, WHETHER BASED IN CONTRACT, TORT (INCLUDING NEGLIGENCE), OR ANY OTHER THEORY OF LIABILITY, ARISING OUT OF OR RESULTING FROM ACCESS TO OR POSSESSION OR USE OF THIS DOCUMENT, EVEN IF CSA GROUP HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES.

In publishing and making this document available, CSA Group is not undertaking to render professional or other services for or on behalf of any person or entity or to perform any duty owed by any person or entity to another person or entity. The information in this document is directed to those who have the appropriate degree of experience to use and apply its contents, and CSA Group accepts no responsibility whatsoever arising in any way from any and all use of or reliance on the information contained in this document.

CSA Group is a private not-for-profit company that publishes voluntary standards and related documents. CSA Group has no power, nor does it undertake, to enforce compliance with the contents of the standards or other documents it publishes.

Intellectual property rights and ownership

As between CSA Group and the users of this document (whether it be in printed or electronic form), CSA Group is the owner, or the authorized licensee, of all works contained herein that are protected by copyright, all trade-marks (except as otherwise noted to the contrary), and all inventions and trade secrets that may be contained in this document, whether or not such inventions and trade secrets are protected by patents and applications for patents. Without limitation, the unauthorized use, modification, copying, or disclosure of this document may violate laws that protect CSA Group’s and/or others’ intellectual property and may give rise to a right in CSA Group and/or others to seek legal redress for such use, modification, copying, or disclosure. To the extent permitted by treaty or by law, CSA Group reserves all intellectual property rights in this document.

Patent rights

Attention is drawn to the possibility that some of the elements of this standard may be the subject of patent rights. CSA Group shall not be held responsible for identifying any or all such patent rights. Users of this standard are expressly advised that determination of the validity of any such patent rights is entirely their own responsibility.

Authorized use of this document

This document is being provided by CSA Group for informational and non-commercial use only. The user of this document is authorized to do only the following:

If this document is in electronic form:

- load this document onto a computer for the sole purpose of reviewing it;
- search and browse this document; and
- print this document if it is in PDF form.

Limited copies of this document in print or paper form may be distributed only to persons who are authorized by CSA Group to have such copies, and only if this Legal Notice appears on each such copy.

In addition, users may not and may not permit others to

- alter this document in any way, or remove this Legal Notice from the attached standard;
- sell this document without authorization from CSA Group; or
- make an electronic copy of this document.

If you do not agree with any of the terms and conditions contained in this Legal Notice, you may not load or use this document or make any copies of the contents hereof, and if you do make such copies, you are required to destroy them immediately. Use of this document constitutes your acceptance of the terms and conditions of this Legal Notice.



Standards Update Service

CSA N288.0:22 January 2022

Title: *Environmental management of nuclear facilities: Common requirements of the CSA N288 series of Standards*

To register for e-mail notification about any updates to this publication

- go to www.csagroup.org/store/
- click on **Product Updates**

The **List ID** that you will need to register for updates to this publication is **129-46**.

If you require assistance, please e-mail techsupport@csagroup.org or call 416-747-2233.

Visit CSA Group's policy on privacy at www.csagroup.org/legal to find out how we protect your personal information.

CSA N288.0:22

***Environmental management of
nuclear facilities: Common
requirements of the CSA N288 series
of Standards***



®A trademark of the Canadian Standards Association, operating as "CSA Group"

*Published in January 2022 by CSA Group
A not-for-profit private sector organization
178 Rexdale Boulevard, Toronto, Ontario, Canada M9W 1R3*

*To purchase standards and related publications, visit our Online Store at www.csagroup.org/store/
or call toll-free 1-800-463-6727 or 416-747-4044.*

*ICS 13.020.10
ISBN 978-1-4883-3792-5*

*© 2022 Canadian Standards Association
All rights reserved. No part of this publication may be reproduced in any form whatsoever
without the prior permission of the publisher.*

Contents

Technical Committee on Environmental Management for Nuclear Facilities	4
Subcommittee on General Requirements for the Environmental Management of Nuclear Facilities	7
Preface	10
0 Introduction	11
0.1 Purpose	11
0.2 CSA N288 series of Standards	11
0.3 Interrelationship of environmental programs	12
0.3.1 Facility interactions with the environment	12
0.3.2 Environmental protection framework	12
0.3.3 Exclusions	12
0.4 Relationships of the CSA N288 Standards	13
0.4.1 General	13
0.4.2 Relationships of the CSA N288 series of Standards among other environmental systems and programs	14
0.4.3 Common overarching concepts	21
1 Scope	21
1.1 General	21
1.2 Facilities	22
1.3 Operating conditions	22
1.4 Terminology	22
2 Reference publications	23
3 Definitions and abbreviations	29
3.1 Definitions	29
3.2 Abbreviations	34
4 Design of monitoring program	35
4.1 General criteria for determining the need to establish a monitoring program	35
4.2 Additional criteria	35
4.3 Scope and complexity	36
4.4 Design of a monitoring program	36
4.4.1 General	36
4.4.2 Systematic planning process for the design of a monitoring program	36
5 Sampling and analytical procedures	38
6 Interpretation of data	39
6.1 General	39
6.2 Statistical analysis	40
6.3 Uncertainty	42
6.4 Exposure and dose assessment	43

7	QA and QC	44
7.1	General	44
7.1.1	Quality measures	44
7.1.2	QA program	44
7.2	QA program personnel	44
7.2.1	Roles and responsibilities	44
7.2.2	Competence	45
7.2.3	Authorities	45
7.3	Measurements and QC	45
7.3.1	Equipment maintenance	45
7.3.2	Non-conformance	45
7.3.3	Performance verification	46
7.4	Model applications and other calculations	47
7.5	Records	47
7.5.1	Quality	47
7.5.2	Contents	47
7.5.3	Retention period	47
8	Reporting, review, and audit	48
8.1	General	48
8.2	Reporting	48
8.2.1	Reporting requirements	48
8.2.2	Report contents	48
8.3	Annual assessment of the program addressed	49
8.3.1	Requirement	49
8.3.2	Scope	49
8.3.3	Assessor	49
8.3.4	Documentation	49
8.4	Periodic review of the program addressed	49
8.4.1	General	49
8.4.2	Frequency and triggers of periodic review	49
8.4.3	Review	49
8.4.4	Program review outcome	50
8.4.5	Program review documentation	50
8.4.6	Requirements for revision	50
8.4.7	Reviewer	50
8.5	Audits	50
8.5.1	Frequency and scope	50
8.5.2	Auditors	50
8.5.3	Audit documentation	50
9	Staff qualifications and training	50
9.1	Personnel qualifications	50
9.2	Training	51
10	Documentation	51
10.1	Program documentation	51
10.2	Supporting documentation	51
10.3	Details	51

10.4	Summary	51
10.5	Site map	51

Annex A (informative)	— Relationship of CSA N288.0 to the CSA N288 series of Standards	52
Annex B (informative)	— Uncertainty analysis	53
Annex C (normative)	— Additional guidance for sampling and analysis techniques	68
Annex D (informative)	— Decision thresholds and detection limits	87
Annex E (informative)	— Meteorological data	99

Technical Committee on Environmental Management for Nuclear Facilities

K. T. Nagy	Cameco Corporation, Saskatoon, Saskatchewan, Canada <i>Category: Supplier/Fabricator/Contractor</i>	<i>Chair</i>
R. McCalla	Ontario Power Generation, Pickering, Ontario, Canada <i>Category: Owner/Operator/Producer</i>	<i>Vice-Chair</i>
N. Ali	Environment and Climate Change Canada, Toronto, Ontario, Canada <i>Category: Government and/or Regulatory Authority</i>	
D. B. Chambers	ARCADIS Canada Inc., Richmond Hill, Ontario, Canada	<i>Non-voting</i>
D. Chin-Cheong	Toronto, Ontario, Canada <i>Category: General Interest</i>	
E. D. Dagher	Canadian Nuclear Safety Commission (CNSC), Ottawa, Ontario, Canada	<i>Non-voting</i>
C. De Waele	Canadian Nuclear Laboratories Limited (CNL), Chalk River, Ontario, Canada	<i>Non-voting</i>
J. DeWilde	Golden Associates, Whitby, Ontario, Canada	<i>Non-voting</i>
G. M. Dolinar	Canadian Nuclear Laboratories Limited (CNL), Chalk River, Ontario, Canada	<i>Non-voting</i>
C. Elwood	Bruce Power, Tiverton, Ontario, Canada <i>Category: Owner/Operator/Producer</i>	
K. E. England	Cameco Corporation, Saskatoon, Saskatchewan, Canada	<i>Non-voting</i>
P. C. Ernst	CANDU Owners Group Inc., Toronto, Ontario, Canada	<i>Non-voting</i>

A. Esmaily	Ontario Power Generation, Pickering, Ontario, Canada	<i>Non-voting</i>
C. M. Fietsch	Bruce Power, Tiverton, Ontario, Canada	<i>Non-voting</i>
C. Gallagher	Canadian Nuclear Laboratories Limited (CNL), Chalk River, Ontario, Canada <i>Category: Owner/Operator/Producer</i>	
N. C. Garisto	ARCADIS Canada Inc., Richmond Hill, Ontario, Canada <i>Category: Supplier/Fabricator/Contractor</i>	
M. Gerchikov	AECOM, Guelph, Ontario, Canada <i>Category: Service Industry</i>	
M. G. Grey	Kinectrics Inc., Toronto, Ontario, Canada <i>Category: Service Industry</i>	
M. Hamlat	Canadian Nuclear Safety Commission, Ottawa, Ontario, Canada <i>Category: Government and/or Regulatory Authority</i>	
D. R. Hart	EcoMetrix Incorporated, Mississauga, Ontario, Canada <i>Category: Supplier/Fabricator/Contractor</i>	
Y. Le	CANDU Owners Group/COG, Toronto, Ontario, Canada <i>Category: General Interest</i>	
F. J. Lemay	Calian Ltd., Ottawa, Ontario, Canada <i>Category: Service Industry</i>	
J. McClellan	NB Power Corporation, Fredericton, New Brunswick, Canada <i>Category: Owner/Operator/Producer</i>	
J. Mildenerger	TRIUMF, Vancouver, British Columbia, Canada <i>Category: General Interest</i>	

I. Mitchell	Ontario Ministry of the Environment, Owen Sound, Ontario, Canada <i>Category: Government and/or Regulatory Authority</i>	
S. T. Moulding	Saskatchewan Ministry of Environment, Saskatoon, Saskatchewan, Canada <i>Category: Government and/or Regulatory Authority</i>	
R. Parker	EcoMetrix Incorporated, Mississauga, Ontario, Canada	<i>Non-voting</i>
T. Repaso-Subang	WSP Global Inc., Thornhill, Ontario, Canada	<i>Non-voting</i>
A. Rosaasen	Orano Canada, Saskatoon, Saskatchewan, Canada	<i>Non-voting</i>
C. Seymour	McMaster University, Hamilton, Ontario, Canada <i>Category: General Interest</i>	
P. Simpson	Orano Canada Inc., Saskatoon, Saskatchewan, Canada <i>Category: Supplier/Fabricator/Contractor</i>	
J. Lee	CSA Group, Toronto, Ontario, Canada	<i>Project Manager</i>

Subcommittee on General Requirements for the Environmental Management of Nuclear Facilities

C. Elwood	Bruce Power , Tiverton, Ontario, Canada <i>Category: Owner/Operator/Producer</i>	<i>Chair</i>
N. Ali	Environment and Climate Change Canada, Toronto, Ontario, Canada	
B. Balicki	Cameco Corporation, Saskatoon, Saskatchewan, Canada	
D. B. Chambers	ARCADIS Canada Inc., Richmond Hill, Ontario, Canada	
D. Chin-Cheong	Toronto, Ontario, Canada	
E. D. Dagher	Canadian Nuclear Safety Commission (CNSC), Ottawa, Ontario, Canada	
C. De Waele	Canadian Nuclear Laboratories Limited (CNL), Chalk River, Ontario, Canada	
J. DeWilde	Golder Associates, Whitby, Ontario, Canada	
K. England	Cameco Corporation, Saskatoon, Saskatchewan, Canada	
P. C. Ernst	CANDU Owners Group Inc., Toronto, Ontario, Canada	
A. Esmaeily	Ontario Power Generation, Pickering, Ontario, Canada	
C. M. Fietsch	Bruce Power, Tiverton, Ontario, Canada	

C. Gallagher	Canadian Nuclear Laboratories Limited (CNL), Chalk River, Ontario, Canada
N. C. Garisto	ARCADIS Canada Inc., Richmond Hill, Ontario, Canada
M. Gerchikov	AECOM, Guelph, Ontario, Canada
M. G. Grey	Kinectrics Inc., Toronto, Ontario, Canada
M. Hamlat	Canadian Nuclear Safety Commission, Ottawa, Ontario, Canada
D. R. Hart	EcoMetrix Incorporated, Mississauga, Ontario, Canada
D. Kim	Environment and Climate Change Canada, Toronto, Ontario, Canada
Y. Le	CANDU Owners Group/COG, Toronto, Ontario, Canada
F. J. Lemay	Calian Ltd., Ottawa, Ontario, Canada
R. McCalla	Ontario Power Generation, Pickering, Ontario, Canada
J. McCulley	NB Power Corporation, Fredericton, New Brunswick, Canada
J. Mildenberger	TRIUMF, Vancouver, British Columbia, Canada
S. T. Moulding	Saskatchewan Ministry of Environment, Saskatoon, Saskatchewan, Canada
R. Parker	EcoMetrix Incorporated, Mississauga, Ontario, Canada
A. Rosaasen	Orano Canada, Saskatoon, Saskatchewan, Canada

C. Seymour

McMaster University,
Hamilton, Ontario, Canada

P. Simpson

Orano Canada Inc.,
Saskatoon, Saskatchewan, Canada

E. Thomas

Kinectrics Inc.,
Toronto, Ontario, Canada

J. Lee

CSA.Group,
Toronto, Ontario, Canada

Project Manager

Preface

This is the first edition of CSA N288.0, *Environmental management of nuclear facilities: Common requirements of the CSA N288 series of Standards*.

This Standard is part of the N288 series of Standards and Guidelines on environmental management for nuclear facilities. The CSA N-Series Standards provide an interlinked set of requirements for the management of nuclear facilities and activities. This Standard captures the common elements of the CSA N288 series of Standards for the purposes of minimizing duplication of requirements within the series. Integration of CSA N288.0 will optimize the implementation of the series as well as facilitate optimal maintenance of the series as a whole.

CSA N286 provides overall direction to management to develop and implement sound management practices and controls, while the other CSA Group nuclear Standards provide technical requirements and guidance that support the management system. This Standard works in harmony with CSA N286 and does not duplicate the generic requirements of CSA N286; however, it can provide more specific direction for those requirements.

Users of this Standard are reminded that the design, manufacture, construction, commissioning, operation, and decommissioning of nuclear facilities in Canada are subject to the provisions of the *Nuclear Safety and Control Act* and its supporting Regulations.

This Standard was prepared by the Subcommittee on General Requirements for the Environmental Management of Nuclear Facilities, under the jurisdiction of the Technical Committee on Environmental Management for Nuclear Facilities and the Strategic Steering Committee, and has been formally approved by the Technical Committee.

Notes:

- 1) *Use of the singular does not exclude the plural (and vice versa) when the sense allows.*
- 2) *Although the intended primary application of this Standard is stated in its Scope, it is important to note that it remains the responsibility of the users of the Standard to judge its suitability for their particular purpose.*
- 3) *This Standard was developed by consensus, which is defined by CSA Policy governing standardization — Code of good practice for standardization as “substantial agreement. Consensus implies much more than a simple majority, but not necessarily unanimity”. It is consistent with this definition that a member may be included in the Technical Committee list and yet not be in full agreement with all clauses of this Standard.*
- 4) *To submit a request for interpretation of this Standard, please send the following information to inquiries@csagroup.org and include “Request for interpretation” in the subject line:*
 - a) *define the problem, making reference to the specific clause, and, where appropriate, include an illustrative sketch;*
 - b) *provide an explanation of circumstances surrounding the actual field condition; and*
 - c) *where possible, phrase the request in such a way that a specific “yes” or “no” answer will address the issue.*

Committee interpretations are processed in accordance with the CSA Directives and guidelines governing standardization and are available on the Current Standards Activities page at standardsactivities.csa.ca.
- 5) *This Standard is subject to review within five years from the date of publication. Suggestions for its improvement will be referred to the appropriate committee. To submit a proposal for change, please send the following information to inquiries@csagroup.org and include “Proposal for change” in the subject line:*
 - a) *Standard designation (number);*
 - b) *relevant clause, table, and/or figure number;*
 - c) *wording of the proposed change; and*
 - d) *rationale for the change.*

CSA N288.0:22

Environmental management of nuclear facilities: Common requirements of the CSA N288 series of Standards

0 Introduction

0.1 Purpose

The purpose of the nuclear environmental management Standards, CSA N288 series of Standards, is to provide a framework for environmental protection associated with nuclear facilities. The Standards include elements of environmental protection such as modelling, pathways analysis, dose assessment, monitoring equipment performance, emissions, effluent, environmental and groundwater monitoring, and risk assessment. The Standards address nuclear and hazardous substances and physical stressors in airborne emissions and waterborne effluents, fugitive emissions, and other physical impacts on biota over the life cycle of the nuclear facility. The operational phase of the life cycle includes normal operation as well as anticipated operational occurrences (AOO); it does not include acute risks associated from releases under accident scenarios, with the exception of CSA N288.2.

The CSA N288 series of Standards are developed for implementation at nuclear facilities including, but not limited to power production reactors, uranium mines and mills, research facilities, and processing and fuel fabrication. The application of a Standard is defined within each Standard. Dependent on the specific requirements of each type of nuclear facility, all of the Standards or a subset of the Standards might be applicable to that facility type. For example, of the current Standards within the series, ten Standards apply to power production reactors while eight Standards apply to uranium mines and mills. Each Standard has been developed to support one or more of the key elements of a nuclear facility's overall environmental protection program.

The purpose of this Standard is to create an umbrella Standard for the CSA N288 series of Standards that consolidates the requirements for the common program elements under an environmental management system (EMS) and eliminates conflicts and inconsistencies. This Standard will provide efficiencies in the implementation of the CSA N288 series of Standards, as well as allow the individual Standards to become more concise. Users of this Standard can design and implement common elements (i.e., training) for the whole EMS, as they pertain to EMS sub-programs under the various Standards of the CSA N288 series of Standards.

0.2 CSA N288 series of Standards

The CSA N288 series of Standards includes the following:

- a) CSA N288.0, *Environmental Management of Nuclear Facilities: Common requirements of the CSA N288 series of Standards*;
- b) CSA N288.1, *Guidelines for modelling radionuclide environmental transport, fate, and exposure associated with the normal operation of nuclear facilities*;
- c) CSA N288.2, *Guidelines for calculating the radiological consequences to the public of a release of airborne radioactive material for nuclear reactor accident*;
- d) CSA N288.3.4, *Performance testing of nuclear air-cleaning systems at nuclear facilities*;