

INTERNATIONAL STANDARD

NORME INTERNATIONALE



Surge arresters –

Part 8: Metal-oxide surge arresters with external series gap (EGLA) for overhead transmission and distribution lines of a.c. systems above 1 kV

Parafoudres –

Partie 8: Parafoudres à oxyde métallique avec éclateur extérieur en série (EGLA) pour lignes aériennes de transmission et de distribution de réseaux à courant alternatif de plus de 1 kV



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2017 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

IEC Catalogue - webstore.iec.ch/catalogue

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just published details all new publications released. Available online and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing 21 000 terms and definitions in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Catalogue IEC - webstore.iec.ch/catalogue

Application autonome pour consulter tous les renseignements bibliographiques sur les Normes internationales, Spécifications techniques, Rapports techniques et autres documents de l'IEC. Disponible pour PC, Mac OS, tablettes Android et iPad.

Recherche de publications IEC -

webstore.iec.ch/advsearchform

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

Electropedia - www.electropedia.org

Le premier dictionnaire en ligne de termes électroniques et électriques. Il contient 21 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans 16 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

Glossaire IEC - std.iec.ch/glossary

67 000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: sales@iec.ch.

INTERNATIONAL STANDARD

NORME INTERNATIONALE



Surge arresters –

Part 8: Metal-oxide surge arresters with external series gap (EGLA) for overhead transmission and distribution lines of a.c. systems above 1 kV

Parafoudres –

Partie 8: Parafoudres à oxyde métallique avec éclateur extérieur en série (EGLA) pour lignes aériennes de transmission et de distribution de réseaux à courant alternatif de plus de 1 kV

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 29.240.10

ISBN 978-2-8322-6106-4

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD.....	6
INTRODUCTION.....	8
1 Scope.....	9
2 Normative references	9
3 Terms and definitions	10
4 Identification and classification	13
4.1 EGLA identification	13
4.2 EGLA classification.....	13
5 Standard ratings and service conditions	14
5.1 Standard rated voltages	14
5.2 Standard rated frequencies.....	14
5.3 Standard nominal discharge currents	14
5.4 Service conditions.....	14
5.4.1 Normal service conditions.....	14
5.4.2 Special service conditions	14
6 Requirements	15
6.1 Insulation withstand of the SVU and the complete E.....	15
6.1.1 Insulation withstand of the housing of the SVU	15
6.1.2 Insulation withstand of EGLA with shorted (failed) SVU	15
6.2 Residual voltages	15
6.3 High current duty	15
6.4 Lightning discharge capability	15
6.5 Short-circuit performance of the SVU.....	15
6.6 Mechanical performance	16
6.7 Weather aging of SVU	16
6.8 Reference voltage of the SVU	16
6.9 Internal partial discharges.....	16
6.10 Coordination between insulator withstand and EGLA protective level.....	16
6.11 Follow current interrupting	17
6.12 Electromagnetic compatibility.....	17
6.13 End of life	17
7 General testing procedure	17
7.1 Measuring equipment and uncertainty	17
7.2 Test samples	17
8 Type tests	18
8.1 General.....	18
8.2 Insulation withstand tests on the SVU housing and on the EGLA with failed SVU.....	18
8.2.1 General	18
8.2.2 Insulation withstand test on the SVU housing	19
8.2.3 Insulation withstand tests on EGLA with failed SVU	19
8.3 Residual voltage tests.....	20
8.3.1 General	20
8.3.2 Procedure for correction and calculation of inductive voltages	20
8.3.3 Lightning current impulse residual voltage test	21

8.3.4	High current impulse residual voltage test	22
8.4	Standard lightning impulse sparkover test	22
8.5	High current impulse withstand test.....	23
8.5.1	Selection of test samples	23
8.5.2	Test procedure	23
8.5.3	Test evaluation	24
8.6	Test to verify the repetitive charge transfer rating, Q_{RS} with lightning discharges	24
8.6.1	MO resistors	24
8.6.2	Series gap	26
8.7	Short-circuit tests.....	27
8.7.1	General	27
8.7.2	Preparation of the test samples	28
8.7.3	Mounting of the test sample.....	29
8.7.4	High-current short-circuit tests.....	30
8.7.5	Low-current short-circuit test	32
8.7.6	Evaluation of test results	32
8.8	Follow current interrupting test.....	38
8.8.1	General	38
8.8.2	"Test method A".....	38
8.8.3	"Test method B".....	40
8.9	Mechanical load tests on the SVU.....	42
8.9.1	General	42
8.9.2	Bending test	42
8.9.3	Vibration test	51
8.10	Weather aging tests	52
8.10.1	General	52
8.10.2	Sample preparation	52
8.10.3	Test procedure	52
8.10.4	Test evaluation.....	52
8.10.5	Additional test procedure for polymer (composite and cast resin) housed SVUs	53
8.11	Radio interference voltage (RIV) test	53
9	Routine tests	53
9.1	General.....	53
10	Acceptance tests	54
10.1	General.....	54
10.2	Reference voltage measurement of SVU.....	54
10.3	Internal partial discharge test of SVU.....	55
10.4	Radio interference voltage (RIV) test	55
10.5	Test for coordination between insulator withstand and EGLA protective level.....	55
10.5.1	General	55
10.5.2	Steep front impulse test.....	55
10.5.3	Standard lightning impulse sparkover test.....	56
10.6	Follow current interrupting test.....	56
10.6.1	General	56
10.6.2	Test procedure	57
10.6.3	Test sequence.....	57
10.6.4	Test evaluation	57

10.7	Vibration test on the SVU with attached electrode	57
10.7.1	General	57
10.7.2	Sample preparation	57
10.7.3	Test procedure and test condition	57
10.7.4	Test evaluation	58
Annex A (informative)	Example of a test circuit for the follow current interrupting test	59
Annex B (normative)	Mechanical considerations	60
B.1	Test of bending moment	60
B.2	Definition of mechanical loads	61
B.3	Definition of seal leak rate	62
B.4	Calculation of wind-bending-moment	62
B.5	Flow chart – Procedures of tests of bending moment for porcelain/cast resin and polymer-housed SVUs	64
Annex C (normative)	Special service conditions	65
C.1	General	65
C.2	Temperature in excess of +40 °C or below –40 °C	65
C.3	Application at altitudes higher than 1 000 m	65
C.4	Fumes or vapours that may cause deterioration of insulating surface or mounting hardware	65
C.5	Excessive contamination by smoke, dirt, salt spray or other conducting materials	65
C.6	Excessive exposure to moisture, humidity, dripping water, or steam	65
C.7	Live washing of arrester	65
C.8	Unusual transportation or storage	65
C.9	Non-vertical erection and suspended erection	66
C.10	Wind speed > 34 m/s	66
C.11	Earthquake	66
C.12	Torsional loading of the arrester	66
Bibliography	67
Figure 1	– Configuration of a ECLA with insulator and arcing horn	8
Figure 2	– Test procedure to verify the repetitive charge transfer rating, Q_{RS}	25
Figure 3	– Test procedure to verify the repetitive charge withstand of the series gap	27
Figure 4	– Examples of SVU units	36
Figure 5	– Short circuit test setup	37
Figure 6	– Example of a test circuit for re-applying pre-failing circuit immediately before applying the short-circuit test current	38
Figure 7	– Thermo-mechanical test	46
Figure 8	– Example of the test arrangement for the thermo-mechanical test and application of the cantilever load	47
Figure 9	– Test sequence of the water immersion test	48
Figure A.1	– Example of a test circuit for the follow current interrupting test	59
Figure B.1	– Bending moment – Multi-unit SVU	60
Figure B.2	– Definition of mechanical loads	61
Figure B.3	– SVU unit	62
Figure B.4	– SVU dimensions	63

Figure B.5 – Procedures of tests of bending moment for porcelain/cast resin and polymer-housed SVUs	64
Table 1 – EGLA classification – “Series X” and “Series Y”	13
Table 2 – Steps of rated voltages (r.m.s. values)	14
Table 3 – Type tests (all tests to be performed with or without insulator assembly; by manufacturer's decision)	18
Table 4 – Test requirements	34
Table 5 – Required currents for short-circuit tests	35
Table 6 – Acceptance tests	54
Table 7 – Virtual steepness of wave front of steep front impulses	55

Currently in preview, click buy full version.

INTERNATIONAL ELECTROTECHNICAL COMMISSION

SURGE ARRESTERS –**Part 8: Metal-oxide surge arresters with external series gap (EGLA)
for overhead transmission and distribution lines
of a.c. systems above 1 kV**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60099-8 has been prepared by IEC technical committee 37: Surge arresters.

The bilingual version (2018-10) corresponds to the monolingual English version, published in 2017-11.

This second edition cancels and replaces the first edition published in 2011. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) The Lightning discharge capability test has been completely re-written and re-named to Test to verify the repetitive charge transfer rating, Qrs with lightning discharges to reflect

changes introduced in IEC 60099-4 Ed. 3 (2014) regarding new methods for rating the energy and charge handling capability of metal-oxide arresters. In addition to testing to evaluate the performance of the MO resistors, procedures for evaluating the performance of the EGLA series gaps have been introduced.

- b) Omissions from Ed. 1 of this standard have been included, notably an RIV test and a means for determining the thermal time constant of the SUV portion of the EGLA.
- c) Definitions for new terms have been added
- d) A number of NOTES in Ed. 1 have been converted to normative requirements

A number of editorial changes have been made throughout the document to improve grammar and general flow of information.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
37/436/FDIS	37/438/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

The French version of this standard has not been voted upon.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts of IEC 60098 series, under the general title *Surge arresters*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.


INTRODUCTION

This part of IEC 60099 applies to the externally gapped line arrester (EGLA)

This type of surge arrester is connected directly in parallel with an insulator assembly. It comprises a series varistor unit (SVU), made up from non-linear metal-oxide resistors encapsulated in a polymer or porcelain housing, and an external series gap (see Figure 1).

The purpose of an EGLA is to protect the parallel-connected insulator assembly from lightning-caused over-voltages. The external series gap, therefore, should spark over only due to fast-front over-voltages. The gap should withstand all power-frequency and slow-front over-voltages occurring on the system.

In the event of SVU failure, the external series gap should be able to isolate the SVU from the system.

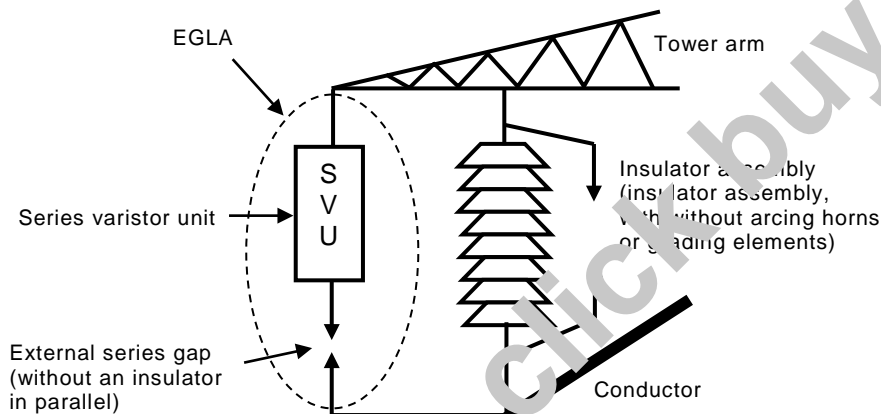

IEC

Figure 1 – Configuration of an EGLA with insulator and arcing horn

SURGE ARRESTERS –

Part 8: Metal-oxide surge arresters with external series gap (EGLA) for overhead transmission and distribution lines of a.c. systems above 1 kV

1 Scope

This part of IEC 60099 covers metal-oxide surge arresters with external series gap (externally gapped line arresters (EGLA)) that are applied on overhead transmission and distribution lines, only to protect insulator assemblies from lightning-caused flashovers.

This document defines surge arresters to protect the insulator assembly from lightning-caused over-voltages only. Therefore, and since metal-oxide resistors are not permanently connected to the line, the following items are not considered for this document:

- switching impulse spark-over voltage;
- residual voltage at steep current and switching current impulse;
- thermal stability;
- long-duration current impulse withstand duty;
- power-frequency voltage versus time characteristics of an arrester;
- disconnecter test;
- aging duties by power-frequency voltage.

Considering the particular design concept and the special application on overhead transmission and distribution lines, some unique requirements and tests are introduced, such as the verification test for coordination between insulator withstand and EGLA protective level, the follow current interrupting test, mechanical load tests, etc.

Designs with the EGLA's external series gap installed in parallel to an insulator are not covered by this document.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60060-1:2010, *High-voltage test techniques – Part 1: General definitions and test requirements*

IEC 60060-2:2010, *High-voltage test techniques – Part 2: Measuring systems*

IEC 60068-2-11:1981, *Basic environmental testing procedures – Part 2-11: Tests – Test Ka: Salt mist*

IEC 60068-2-14:2009, *Environmental testing – Part 2-14: Tests – Test N: Change of temperature*