

IEEE Standard for Metal-Enclosed Low-Voltage (1000 Vac and below, 3200 Vdc and below) Power Circuit Breaker Switchgear

IEEE Power and Energy Society

Sponsored by the
Switchgear Committee

IEEE
3 Park Avenue
New York, NY 10016-5997
©SA

IEEE Std C37.20.1™-2015
(Revision of
IEEE Std C37.20.1-2002)

Currently in preview, click buy full version

IEEE Standard for Metal-Enclosed Low-Voltage (1000 Vac and below, 3200 Vdc and below) Power Circuit Breaker Switchgear

Sponsor

Switchgear Committee
of the
IEEE Power and Energy Society

Approved 26 March 2015

IEEE-SA Standards Board

Abstract: Metal-enclosed, low-voltage switchgear—which contains either stationary or drawout, manually or electrically operated low-voltage ac or dc power circuit breakers in individual metal compartments, in three-pole, four-pole, two-pole, or single-pole construction—is covered. Rated maximum voltage levels are 254 V, 508 V, 635 V, 730 V, or 1058 Vac; and 300/325 V, 600 V, 800 V, 1000 V, 1200 V, 1500 V, 1600 V, or 3200 Vdc. The preferred continuous current ratings of the main bus in ac designs are 1600 A, 2000 A, 3000 A, 3200 A, 4000 A, 5000 A, 6000 A, 8000 A, or 10 000 A. For dc designs, the preferred ratings are 1600 A, 2000 A, 2500 A, 3000 A, 4000 A, 5000 A, 6000 A, 8000 A, 10 000 A, or 12 000 A. The switchgear may also contain associated control, instruments, metering, protective, and regulating devices as necessary. The standard deals with service conditions, ratings, temperature limitations, and classification of insulating materials, insulation (dielectric) withstand voltage requirements, test procedures, and application.

Keywords: circuit breaker, control, cumulative loading, current transformers, drawout, IEEE C37.20.1™, indoor, instrumentation, load current-carrying, metal-enclosed, metering, outdoor, protection, stationary, switchgear

The Institute of Electrical and Electronics Engineers, Inc.
3 Park Avenue, New York, NY 10016-5997, USA

Copyright © 2015 by The Institute of Electrical and Electronics Engineers, Inc.
All rights reserved. Published 13 July 2015. Printed in the United States of America.

IEEE is a registered trademark in the U.S. Patent & Trademark Office, owned by The Institute of Electrical and Electronics Engineers, Incorporated.

PDF: ISBN 978-0-7381-9784-5 STD20270
Print: ISBN 978-0-7381-9785-2 STDPD20270

IEEE prohibits discrimination, harassment, and bullying.

For more information, visit <http://www.ieee.org/web/aboutus/whatis/policies/p9-26.html>.

No part of this publication may be reproduced in any form, in an electronic retrieval system or otherwise, without the prior written permission of the publisher.

Important Notices and Disclaimers Concerning IEEE Standards Documents

IEEE documents are made available for use subject to important notices and legal disclaimers. These notices and disclaimers, or a reference to this page, appear in all standards and may be found under the heading “Important Notice” or “Important Notices and Disclaimers Concerning IEEE Standards Documents.”

Notice and Disclaimer of Liability Concerning the Use of IEEE Standards Documents

IEEE Standards documents (standards, recommended practices, and guides), both full-use and trial-use, are developed within IEEE Societies and the Standards Coordinating Committees of the IEEE Standards Association (“IEEE-SA”) Standards Board. IEEE (“the Institute”) develops its standards through a consensus development process, approved by the American National Standards Institute (“ANSI”), which brings together volunteers representing varied viewpoints and interests to achieve the final product. Volunteers are not necessarily members of the Institute and participate without compensation from IEEE. While IEEE administers the process and establishes rules to promote fairness in the consensus development process, IEEE does not independently evaluate, test, or verify the accuracy of any of the information or the soundness of any judgments contained in its standards.

IEEE does not warrant or represent the accuracy or content of the material contained in its standards, and expressly disclaims all warranties (express, implied and statutory) not included in this or any other document relating to the standard, including, but not limited to, the warranties of: merchantability; fitness for a particular purpose; non-infringement; and quality, accuracy, effectiveness, currency, or completeness of material. In addition, IEEE disclaims any and all conditions relating to: results; and workmanlike effort. IEEE standards documents are supplied “AS IS” and “WITH ALL FAULTS.”

Use of an IEEE standard is wholly voluntary. The existence of an IEEE standard does not imply that there are no other ways to produce, test, measure, purchase, make, or provide other goods and services related to the scope of the IEEE standard. Furthermore, the viewpoint expressed at the time a standard is approved and issued is subject to change brought about through developments in the state of the art and comments received from users of the standard.

In publishing and making its standards available, IEEE is not suggesting or rendering professional or other services for, or on behalf of, any person or entity nor is IEEE undertaking to perform any duty owed by any other person or entity to another. Any person utilizing any IEEE Standards document, should rely upon his or her own independent judgment in the exercise of reasonable care in any given circumstances or, as appropriate, seek the advice of a competent professional in determining the appropriateness of a given IEEE standard.

IN NO EVENT SHALL IEEE BE LIABLE FOR ANY DIRECT, INDIRECT, INCIDENTAL, SPECIAL, EXEMPLARY, OR CONSEQUENTIAL DAMAGES (INCLUDING, BUT NOT LIMITED TO: PROCUREMENT OF SUBSTITUTE GOODS OR SERVICES; LOSS OF USE, DATA, OR PROFITS; OR BUSINESS INTERRUPTION) HOWEVER CAUSED AND ON ANY THEORY OF LIABILITY, WHETHER IN CONTRACT, STRICT LIABILITY, OR TORT (INCLUDING NEGLIGENCE OR OTHERWISE) ARISING IN ANY WAY OUT OF THE PUBLICATION, USE OF, OR RELIANCE UPON ANY STANDARD, EVEN IF ADVISED OF THE POSSIBILITY OF SUCH DAMAGE AND REGARDLESS OF WHETHER SUCH DAMAGE WAS FORESEEABLE.

Translations

The IEEE consensus development process involves the review of documents in English only. In the event that an IEEE standard is translated, only the English version published by IEEE should be considered the approved IEEE standard.

Official statements

A statement, written or oral, that is not processed in accordance with the IEEE-SA Standards Board Operations Manual shall not be considered or inferred to be the official position of IEEE or any of its committees and shall not be considered to be, or be relied upon as, a formal position of IEEE. At lectures, symposia, seminars, or educational courses, an individual presenting information on IEEE standards shall make it clear that his or her views should be considered the personal views of that individual rather than the formal position of IEEE.

Comments on standards

Comments for revision of IEEE Standards documents are welcome from any interested party, regardless of membership affiliation with IEEE. However, IEEE does not provide consulting information or advice pertaining to IEEE Standards documents. Suggestions for changes in documents should be in the form of a proposed change of text, together with appropriate supporting comments. Since IEEE standards represent a consensus of concerned interests, it is important that any responses to comments and questions also receive the concurrence of a balance of interests. For this reason, IEEE and the members of its societies and Standards Coordinating Committees are not able to provide an instant response to comment or questions except in those cases where the matter has previously been addressed. For the same reason, IEEE does not respond to interpretation requests. Any person who would like to participate in revisions to an IEEE standard is welcome to join the relevant IEEE working group.

Comments on standards should be submitted to the following address:

Secretary, IEEE-SA Standards Board
445 Hoes Lane
Piscataway, NJ 08854 USA

Laws and regulations

Users of IEEE Standards documents should consult all applicable laws and regulations. Compliance with the provisions of any IEEE Standards document does not imply compliance to any applicable regulatory requirements. Implementers of the standard are responsible for observing or referring to the applicable regulatory requirements. IEEE does not, by the publication of its standards, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

IEEE draft and approved standards are copyrighted by IEEE under U.S. and international copyright laws. They are made available by IEEE and are adopted for a wide variety of both public and private uses. These include both use by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of engineering practices and methods. By making these documents available for use and adoption by public authorities and private users, IEEE does not waive any rights in copyright to the documents.

Photocopies

Subject to payment of the appropriate fee, IEEE will grant users a limited, non-exclusive license to photocopy portions of any individual standard for company or organizational internal use or individual, non-commercial use only. To arrange for payment of licensing fees, please contact Copyright Clearance Center, Customer Service, 222 Rosewood Drive, Danvers, MA 01923 USA; +1 978 750 8400. Permission to photocopy portions of any individual standard for educational classroom use can also be obtained through the Copyright Clearance Center.

Updating of IEEE Standards documents

Users of IEEE Standards documents should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of amendments, corrigenda, or errata. An official IEEE document at any point in time consists of the current edition of the document together with any amendments, corrigenda, or errata then in effect.

Every IEEE standard is subjected to review at least every ten years. When a document is more than ten years old and has not undergone a revision process, it is reasonable to conclude that its contents, although still of some value, do not wholly reflect the present state of the art. Users are cautioned to check to determine that they have the latest edition of any IEEE standard.

In order to determine whether a given document is the current edition and whether it has been amended through the issuance of amendments, corrigenda, or errata, visit the IEEE-SA Website at <http://ieeexplore.ieee.org/xpl/standards.jsp> or contact IEEE at the address listed previously. For more information about the IEEE-SA or IEEE's standards development process, visit the IEEE-SA Website at <http://standards.ieee.org>.

Errata

Errata, if any, for all IEEE standards can be accessed on the IEEE-SA Website at the following URL: <http://standards.ieee.org/findstds/errata/index.html>. Users are encouraged to check this URL for errata periodically.

Patents

Attention is called to the possibility that implementation of this standard may require use of subject matter covered by patent rights. By publication of this standard, no position is taken by the IEEE with respect to the existence or validity of any patent rights in connection therewith. If a patent holder or patent applicant has filed a statement of assurance via an Accepted Letter of Assurance, then the statement is listed on the IEEE-SA Website at <http://standards.ieee.org/about/sasb/patcom/patents.html>. Letters of Assurance may indicate whether the Submitter is willing or unwilling to grant licenses under patent rights without compensation or under reasonable rates, with reasonable terms and conditions that are demonstrably free of any unfair discrimination to applicants desiring to obtain such licenses.

Essential Patent Claims may exist for which a Letter of Assurance has not been received. The IEEE is not responsible for identifying Essential Patent Claims for which a license may be required, for conducting inquiries into the legal validity or scope of Patents Claims, or determining whether any licensing terms or conditions provided in connection with submission of a Letter of Assurance, if any, or in any licensing agreements are reasonable or non-discriminatory. Users of this standard are expressly advised that determination of the validity of any patent rights, and the risk of infringement of such rights, is entirely their own responsibility. Further information may be obtained from the IEEE Standards Association.

Participants

At the time this IEEE standard was completed, the IEEE Standard for Metal-Enclosed Low-Voltage Power Circuit Breaker Switchgear Working Group had the following membership:

Ted Burse, *Chair*
T. W. Olsen, *Vice Chair*

Paul Barnhart
James Bowen
David Dunne
Douglas J. Edwards
Michael Flack
Keith Flowers
Paul Grein
Brian Gerzeny
David Groves
Thomas Hawkins
Dan Hrcir
Anurag Jivanani

Harry Josten
Chad Kennedy
Michael Lafond
Albert Livshitz
Frank Mayle
John McClelland
Jeffery Mizener
Daleep Mohla
Darryl Moser
Miklos Orosz
Owen Parks
Raghunath Parthasarathi

Molson Parvin
Edward Peters
Robert Puckett
Samala Santosh Reddy
Richard Rohr
Amy Rowell
Carl Schneider
Mike Seabrook
John Shullaw
Paul Sullivan
Richard T. Yonck
Larry Yonce

The following members of the individual balloting committee voted on this standard. Balloters may have voted for approval, disapproval, or abstention.

Roy Ayers
Paul Barnhart
Robert Beavers
George Becker
Robert Behl
Seth Benson
Thomas Blair
William Bloethe
Chris Brooks
David Burns
Ted Burse
Eldridge Byron
Paul Cardinal
Suresh Channarasappa
Gary Donner
Randall Dotson
Neal Dowling
Donald Dunn
David Dunne
Douglas J. Edwards
Ronald Esco
Robert Fisher
Keith Flowers
Paul Forquer
Frank Gerleve
Michael Glinkowski
Lyle Grant
Paul Grein
David Hall Groves
Ajit Gwal
Jeff Hanson
Thomas Hawkins
Jeffrey Helzer
Reid Herzog

Gary Heuston
David Horvath
Dan Hrcir
David Jackson
Derick Jackson
Anurag Jivanani
Andrew Jones
Harry Josten
Chad Kennedy
Yuri Karsensky
Boleslogan
Jim Kulchisky
Suman Kundra
Chung-Yiu Lam
Albert Livshitz
Frank Mayle
William McBride
John McClelland
James Mitchem
Jeffery Mizener
Daleep Mohla
Charles Morse
Darryl Moser
Jerry Murphy
Dennis Neitzel
Michael Newman
Joe Nims
T. W. Olsen
Lorraine Padden
Edward Peters
Christopher Petrola
Mark Pfeiffer
Julian Profir
Samala Santosh Reddy

Michael Roberts
Charles Rogers
Richard Rohr
Charles Ross
Thomas Rozek
Bartien Sayogo
Mike Seabrook
Robert Seitz
Suresh Shrivavle
John Shullaw
Michael Sigmon
David Singleton
Veselin Skendzic
Jerry Smith
James Stage
Ralph Stell
Rick Straubel
Raymond Strittmatter
Paul Sullivan
Donald Swing
David Tepen
Dennis Thonsgard
Wayne Timm
Joe Uchiyama
Marcelo Valdes
John Vergis
Michael Wactor
John Webb
Kenneth White
James Wilson
Robert Wilson
Larry Yonce
Jian Yu
Matthew Zeedyk

When the IEEE-SA Standards Board approved this standard on 26 March 2015, it had the following membership:

John D. Kulick, *Chair*
Jon Walter Rosdahl, *Vice Chair*
Richard H. Hulett, *Past Chair*
Konstantinos Karachalios, *Secretary*

Masayuki Ariyoshi
Ted Burse
Stephen Dukes
Jean-Philippe Faure
J. Travis Griffith
Gary Hoffman
Michael Janezic

Joseph L. Koepfinger*
David J. Law
Hung Ling
Andrew Myles
T. W. Olsen
Glenn Parsons
Ronald C. Petersen
Annette D. Reilly

Stephen J. Shellhammer
Adrian P. Stephens
Yatin Trivedi
Phillip Winston
Don Wright
Yu Yuan
Daidi Zhong

*Member Emeritus

Penny Stanton
IEEE-SA Content Production and Management

Erin Spiewak
IEEE-SA Operational Program Management

Introduction

This introduction is not part of IEEE Std C37.20.1™-2015, IEEE Standard for Metal-Enclosed Low-Voltage (1000 Vac and below, 3200 Vdc and below) Power Circuit Breaker Switchgear.

This standard has been revised to reflect needed technical changes that have been suggested since the last revision to IEEE Std C37.20.1™ that was published in 2002. Major editorial and technical changes have been incorporated. The more significant changes include the following:

- a) Expansion of maximum voltage ratings to include 730 Vac and 1058 Vac, plus 600 Vdc and 1000 Vdc, to coordinate with changes being made to the NEC, IEEE Std C37.13™, and IEEE Std C37.14™.
- b) The historic altitude correction factors in previous editions have been retained.

This standard includes only the requirements for metal-enclosed low-voltage power circuit breaker switchgear. These requirements were previously a part of IEEE Std C37.20™-1969 (Reaff 1981), IEEE Standard for Switchgear Assemblies Including Metal-Enclosed Bus (1974 consolidated edition). Other types of equipment previously included in IEEE Std C37.20-1969 are incorporated in separate publications.

The IEEE Switchgear Assemblies subcommittee of the IEEE Power and Energy Switchgear Committee was responsible for this revision.

The working group expresses its deep appreciation to Christina Long for her work in creating and editing this document.

This publication is one of a series covering switchgear assemblies as follows:

- a) IEEE Std C37.20.1™, IEEE Standard for Metal-Enclosed Low-Voltage (1000 Vac and below, 3200 Vdc and below) Power Circuit Breaker Switchgear.
- b) IEEE Std C37.20.2™, IEEE Standard for Metal-Clad Switchgear.
- c) IEEE Std C37.20.3™, IEEE Standard for Metal-Enclosed Interrupter Switchgear (1 kV-38 kV).
- d) IEEE Std C37.20.7™, IEEE Guide to Testing Switchgear Rated 38 kV or below for Internal Arcing Faults
- e) IEEE Std C37.21™, IEEE Standard for Control Switchboards.
- f) IEEE Std C37.23™, IEEE Standard for Metal-Enclosed Bus.
- g) PC37.20.9, IEEE Standard for Metal-Enclosed Switchgear Rated 1 kV–52 kV Incorporating Gas Insulation Systems^a

^a Numbers preceded by P are IEEE authorized standards projects that were not approved by the IEEE-SA Standards Board at the time this publication went to press. For information about obtaining drafts, contact the IEEE. Note that PC37.20.9 is in process.

Figure A depicts types of switchgear assemblies and standards pertinent to switchgear assemblies.

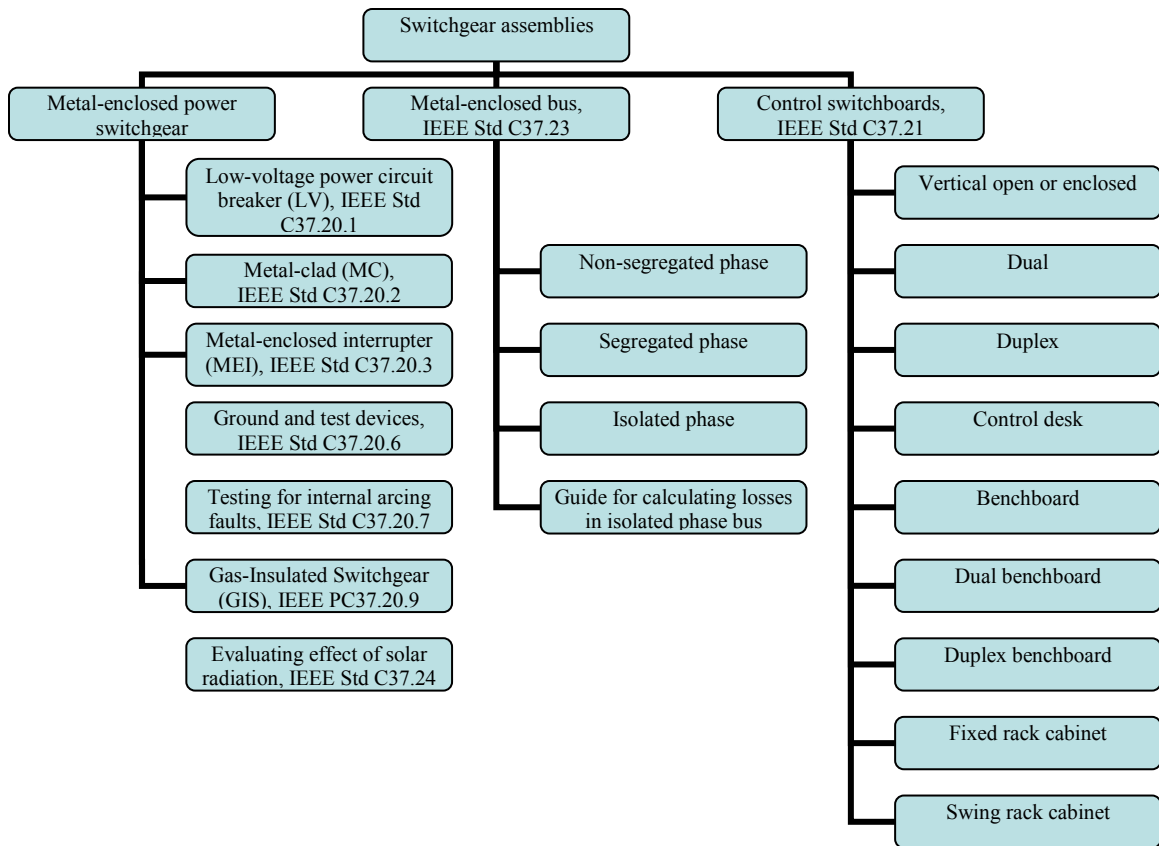


Figure A—Types of switchgear assemblies

Contents

1. Scope	1
2. Normative references	2
3. Definitions	4
4. Normal (usual) service conditions	5
5. Ratings	6
5.1 General	6
5.2 Voltage and insulation levels	7
5.3 Rated power frequency	8
5.4 Rated current	8
5.5 Temperature limitations	10
5.6 Current transformer ratings (LV ac switchgear)	12
5.7 Phase current transformer accuracies	13
5.8 Instrument shunts for use in LV dc switchgear	14
6. Tests	14
6.1 General	14
6.2 Design tests	14
6.3 Production tests	33
6.4 Conformance tests	34
6.5 Field dielectric tests	34
7. Construction	34
7.1 General requirements	34
7.2 Materials and finish	43
7.3 Barriers	44
7.4 Buses and connections	45
7.5 Access doors and covers	45
7.6 Closing and tripping	45
7.7 Indoor LV switchgear	45
7.8 Outdoor LV switchgear	46
7.9 Pull box	46
7.10 Arrangements with stationary circuit breakers	47
7.11 Arrangements with drawout circuit breakers	47
7.12 Primary cable space	48
7.13 Precautionary labels	49
7.14 Lifting devices	49
Annex A (informative) Bibliography	50
Annex B (informative) Application Guide for LV switchgear	51
Annex C (informative) Guide for handling, storage, and installation	65

IEEE Standard for Metal-Enclosed Low-Voltage (1000 Vac and below, 3200 Vdc and below) Power Circuit Breaker Switchgear

IMPORTANT NOTICE: IEEE Standards documents are not intended to ensure safety, security, health, or environmental protection, or ensure against interference with or from other devices or networks. Implementers of IEEE Standards documents are responsible for determining and complying with all appropriate safety, security, environmental, health, and interference protection practices and all applicable laws and regulations.

This IEEE document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notice” or “Important Notices and Disclaimers Concerning IEEE Documents.” They can also be obtained on request from IEEE or viewed at <http://standards.ieee.org/IPR/disclaimers.html>.

1. Scope

This standard covers metal-enclosed low-voltage power circuit breaker switchgear assemblies containing, but not limited to, such devices as low-voltage power circuit breakers (fused or unfused); other interrupting devices; switches, control, instrumentation, and metering; and protective and regulating equipment.

This standard is concerned with enclosed, rather than open, indoor and outdoor switchgear assemblies. It includes types of equipment that are part of secondary unit substations. It does not apply to equipment covered by industrial control standards, communication switchboards, communication switching equipment, switchboards for use on board ships, or dead-front distribution switchboards.

In this standard, metal-enclosed low-voltage power circuit breaker switchgear shall be called LV switchgear. For LV ac switchgear, the nominal system voltage shall be 1000 Vac or below; for LV dc switchgear, the rated maximum voltage shall be 3200 Vdc or below.