

C62.41.1™

IEEE Guide on the Surge Environment in Low-Voltage (1000 V and Less) AC Power Circuits

IEEE Power Engineering Society

Sponsored by the
Surge Protective Devices Committee



Published by
The Institute of Electrical and Electronics Engineers, Inc.
3 Park Avenue, New York, NY 10016-5997, USA

11 April 2003

Print: SH95030
PDF: SS95030

Recognized as an
American National Standard (ANSI)

IEEE Std C62.41.1™-2002(R2008)

IEEE Guide on the Surge Environment in Low-Voltage (1000 V and Less) AC Power Circuits

Sponsor

**Surge Protective Devices Committee
of the
IEEE Power Engineering Society**

Reaffirmed 10 December 2008
Approved 11 November 2002

IEEE-SA Standards Board

Reaffirmed 30 April 2009
Approved 4 April 2003

American National Standards Institute

IEEE thanks the International Electrotechnical Commission (IEC) for permission to reproduce information from its International Standards, Technical Reports and Technical Specifications: IEC 62066:2002—Figure 15, Figure 16, Figure A.13, Figure A.14, Figure A.23, Table A.4, Figure A.24, Figure A.25, Table A.5, and Figure A.31; IEC 61000-4-4:1995—Figure B.7 and Figure B.8. All such extracts are copyright of IEC, Geneva, Switzerland. All rights reserved. Further information on the IEC is available from www.iec.ch. IEC has no responsibility for the placement and context in which the extracts and contents are reproduced by IEEE; nor is IEC in any way responsible for the other content or accuracy therein.

IEEE also thanks the following organizations or individuals for permission to reproduce figures from their publications, appearing respectively as Figure 3 (Global Atmospheric, Inc.); Figure 17 (K. Berger); Figure A.15, Figure A.21, Figure A.22, and Figure A.30 (F. D. Martzloff); Figure A.16 (T. Shaunessy); Figure A.17, and Figure A.20 (A. McEachern); Figure A.18 (H. Rauworth); Figure A.19 (J. G. Dalton); Table A.C.D. 7 (D. Dorr); Figure A.26 (M. B. Hughes); Figure A.27 (V. A. Rakov); Figure A.28 (K. L. Cummins); Figure A.33 and Figure A.34 (J. Weisinger); Figure B.1 (J. J. Goedbloed).

Abstract: This is a guide describing the surge voltage, surge current, and temporary overvoltages (TOV) environment in low-voltage [up to 1000 V root mean square (rms)] ac power circuits. This scope does not include other power disturbances, such as notches, sags, and noise.

Keywords: lightning surges, low-voltage ac power circuit, surge environment, surge testing, surge withstand level, switching surges

The Institute of Electrical and Electronics Engineers, Inc.
3 Park Avenue, New York, NY 10016-5997, USA

Copyright © 2003 by the Institute of Electrical and Electronics Engineers, Inc.
All rights reserved. Published 11 April 2003. Printed in the United States of America.

National Electrical Code® and NEC® are both registered trademarks owned by the National Fire Protection Association, Inc.
National Electrical Safety Code® and NESC® are both registered trademarks and service marks owned by the Institute of Electrical and Electronics Engineers, Inc.

Print: ISBN 0-7381-3391-4 SH95030
PDF: ISBN 0-7381-3392-5 SS95030

No part of this publication may be reproduced in any form, in an electronic retrieval system or otherwise, without the prior written permission of the publisher.

IEEE Standards documents are developed within the IEEE Societies and the Standards Coordinating Committees of the IEEE Standards Association (IEEE-SA) Standards Board. The IEEE develops its standards through a consensus development process, approved by the American National Standards Institute, which brings together volunteers representing varied viewpoints and interests to achieve the final product. Volunteers are not necessarily members of the Institute and serve without compensation. While the IEEE administers the process and establishes rules to promote fairness in the consensus development process, the IEEE does not independently evaluate, test, or verify the accuracy of any of the information contained in its standards.

Use of an IEEE Standard is wholly voluntary. The IEEE disclaims liability for any personal injury, property or other damage, of any nature whatsoever, whether special, indirect, consequential, or compensatory, directly or indirectly resulting from the publication, use of, or reliance upon this, or any other IEEE Standard document.

The IEEE does not warrant or represent the accuracy or content of the material contained herein, and expressly disclaims any express or implied warranty, including any implied warranty of merchantability or fitness for a specific purpose, or that the use of the material contained herein is free from patent infringement. IEEE Standards documents are supplied "AS IS."

The existence of an IEEE Standard does not imply that there are no other ways to produce, test, measure, purchase, market, or provide other goods and services related to the scope of the IEEE Standard. Furthermore, the viewpoint expressed at the time a standard is approved and issued is subject to change brought about through developments in the state of the art and comments received from users of the standard. Every IEEE Standard is subjected to review at least every five years for revision or reaffirmation. When a document is more than five years old and has not been reaffirmed, it is reasonable to conclude that its contents, although still of some value, do not wholly reflect the present state of the art. Users are cautioned to check to determine that they have the latest edition of any IEEE Standard.

In publishing and making this document available, the IEEE is not suggesting or endorsing professional or other services for, or on behalf of, any person or entity. Nor is the IEEE undertaking to perform any duty owed by any other person or entity to another. Any person utilizing this, and any other IEEE Standards document, should rely upon the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

Interpretations: Occasionally questions may arise regarding the meaning of portions of standards as they relate to specific applications. When the need for interpretations is brought to the attention of IEEE, the Institute will initiate action to prepare appropriate responses. Since IEEE Standards represent a consensus of concerned interests, it is important to ensure that any interpretation has also received the concurrence of a balance of interests. For this reason, IEEE and the members of its societies and Standards Coordinating Committees are unable to provide an instant response to interpretation requests except in those cases where the matter has previously received formal consideration.

Comments for revision of IEEE Standards are welcome from any interested party, regardless of membership affiliation with IEEE. Suggestions for changes in documents should be in the form of a proposed change of text, together with appropriate supporting comments. Comments on standards and requests for interpretations should be addressed to:

Secretary, IEEE-SA Standards Board
445 Jones Lane
P. O. Box 1331
Cataway, NJ 08855-1331
USA

Note: Attention is called to the possibility that implementation of this standard may require use of subject matter covered by patent rights. By publication of this standard, no position is taken with respect to the existence or validity of any patent rights in connection therewith. The IEEE shall not be responsible for identifying patents for which a license may be required by an IEEE standard or for conducting inquiries into the legal validity or scope of those patents that are brought to its attention.

Authorization to photocopy portions of any individual standard for internal or personal use is granted by the Institute of Electrical and Electronics Engineers, Inc., provided that the appropriate fee is paid to Copyright Clearance Center. To arrange for payment of licensing fee, please contact Copyright Clearance Center, Customer Service, 222 Rosewood Drive, Danvers, MA 01923 USA; +1 978 750 8400. Permission to photocopy portions of any individual standard for educational classroom use can also be obtained through the Copyright Clearance Center.

Introduction

[This introduction is not part of IEEE Std C62.41.1-2002, IEEE Guide on the Surge Environment in Low-Voltage (1000 V and Less) AC Power Circuits.]

This guide is the result of 20 years of evolution from the initial 1980 document, IEEE Std 587™, IEEE Guide for Surge Voltages in Low-Voltage AC Power Circuits, which promptly became IEEE Std C62.41™ with the same title. The guide was updated in 1991 as IEEE Std C62.41-1991, IEEE Recommended Practice on Surge Voltages in Low-Voltage AC Power Circuits, reflecting new data on the surge environment and experience in the use (and misuse) of the original guide. The purpose of the document was and still is to provide information on the surge environment and offer recommendations to interested parties involved in developing application standards related to surge protective devices (SPDs) as well as recommendations to product designers and users.

The 1980 version, based on data available up to 1979, proposed two novel concepts:

- 1) The reduction of a complex database to two representative surges: a new “Ring Wave” featuring a decaying 100 kHz oscillation, and the combination of the classic, well-accepted 1.2/50 μ s voltage waveform and 8/20 μ s current waveform into a “Combination Wave” to be delivered by a surge generator having well-defined open-circuit voltage and short-circuit current.
- 2) The concept that location categories could be defined within an installation where surge voltages impinging upon the service entrance of an installation or generated within an installation would propagate, unabated, in the branch circuits, while the associated currents, impeded by (mostly) the inductance of the conductors, would be reduced from the values observed in circuits located close to the service entrance to lower values observed in circuits located at the end of long branch circuits.

The 1991 version, based on additional data as well as experience in the use of the 1980 guide, maintained the concepts of the location categories and the recommendation of representative surge waveforms.

The two seminal surges, Ring Wave and Combination Wave, were designated as “standard surge-testing waveforms,” and three new “additional surge-testing waveforms” were added to the “menu.” Meanwhile, a companion document, IEEE Std C62.45™-1992, IEEE Guide on Surge Testing for Equipment Connected to Low-Voltage AC Power Circuits, was developed, outlining procedures for error-free application of the waveforms defined by IEEE Std C62.41™-1991, while enhancing operator safety.

The perceived need to justify the expansion of the two-only waveforms to a menu of five led to the growth in the document volume, from the 55-page IEEE Std 587-1980 to the 111-page IEEE Std C62.41-1991.

Additional data collected toward an update of the 1991 version (which was reaffirmed in 1996) would have increased further the volume of the document. Instead, a new approach was selected: to create a “Trilogy” by separating the information into three distinct documents, making their use more reader-friendly while maintaining the credibility of the recommendations:

- A guide on the surge environment in low-voltage ac power circuits (the present document)
- A recommended practice on characterization of surges in low-voltage ac power circuits (IEEE Std C62.41.2™-2002)
- A recommended practice on surge testing for equipment connected to low-voltage ac power circuits (IEEE Std C62.45™-2002)

In this manner, interested parties will have a faster, simpler access to the recommendations for selecting representative surges relevant to their needs. A comprehensive database will be available for parties desiring to gain a deeper understanding of the surge environment and an up-to-date set of recommendations on surge testing procedures.

Participants

At the time this recommended practice was completed, the Working Group on Surge Characterization on Low-Voltage Circuits had the following membership:

Hans Steinhoff, *Chair*
James Funke, *Co-Chair*
Raymond Hill, *Secretary*
François D. Martzloff, *Technical Editor*

Richard Bentinger
William Bush
Ernie Gallo
Andrea Turner Haa
Jim Harrison

Michael Hopkins
Deborah Jennings-Conner
Philip J. Jones
Wilhem H. Kapp
Joesph L. Koepfinger

Richard Odenberg
Alan W. Rebeck
Michael Stringfello
S. Frank Waterer
Don Worden

Other individuals who contributed review and comments in developing this recommended practice are

P. P. Barker
J. Birkel
B. Connatser
T. R. Conrad
C. Dhooze
D. Dorr
H. E. Foelker
G. L. Goedde

W. Goldbach
P. Hasse
T. S. Key
G. Kohn
D. Lacey
J. Levine
W. A. Maguire
A. Mansoor

D. McQuinn
R. V. Rebbapragada
T. O. Shipp
I. D. Posey
V. A. Rakov
A. Rousseau
S. G. Whisenant
W. J. Zischank

The following members of the balloting committee voted on the standard. Balloters may have voted for approval, disapproval, or abstention.

Richard Bentinger
James Case
Chrys Chrysanthou
Bryan R. Cole
Bill Curry
Douglas C. Dawson
E. P. Dick
Clifford C. Erven
Ernie Gallo
Gary Goedde
Jim Harrison
Steven P. Hensley

Andrew Robert Hileman
David W. Jackson
Philip J. Jones
Wilhem H. Kapp
Joseph L. Koepfinger
Benny H. Lee
Carl E. Lindquist
William A. Maguire
François D. Martzloff
Nigel P. McQuinn
Gary L. Michel
Richard Odenberg
Joseph C. Osterhout
Michael Parente

Percy E. Pool
R. V. Rebbapragada
Alan W. Rebeck
Tim E. Royster
Mark S. Simon
Hans Steinhoff
Antony J. Surtees
Donald B. Turner
S. Frank Waterer
James W. Wilson
Jonathan J. Woodworth
Donald M. Worden

At the time this document was sent to ballot, the Accredited Standards Committee on Surge Arresters, C62, had the following members:

Joseph L. Keepfinger, Chair
S. Choinski, Secretary
Vacant, NEMA Co-Secretary
Naeem Ahmad, IEEE Co-Secretary

<i>Organization Represented</i>	<i>Name of Representative</i>
Electric Light & Power (EEL)	J. S. Case
.....	T. Field
.....	W. A. Maguire
.....	L. F. Vogt
.....	J. Wilson
.....	T. A. Wolfe
.....	C. G. Crawford
IEEE	M. J. Comber
.....	W. H. Kapp
.....	J. L. Keepfinger
.....	R. Odenberg
.....	T. Rozek
.....	K. B. Stump
.....	E. Taylor
NEMA	L. Block
.....	Vacant
.....	P. Jeffries
.....	D. W. Lenk
.....	Vacant
.....	J. J. Woodworth
Association of American Railroads (AARR)	W. Etter
Bonneville Power Administration (BPA)	G. E. Lee
Canadian Standards	D. M. Smith
International Electrical Testing Association (NETA)	A. Peterson
.....	M. R. Jordan
NIST	F. D. Martzloff
Rural Electrification Administration (REA)	E. Cameron
Telecommunications Information Systems (TCIS)	C. Chrysanthou
Underwriters Laboratories	D. Jennings-Conner
Individuals	J. Osterhout
.....	S. G. Whisenant
.....	H. J. Steinhoff

When the IEEE-SA Standards Board approved this standard on 11 November 2002, it had the following membership:

James T. Carlo, *Chair*

James H. Gurney, *Vice Chair*

Judith Gorman, *Secretary*

Sid Bennett
H. Stephen Berger
Clyde R. Camp
Richard DeBlasio
Harold E. Epstein
Julian Forster*
Howard M. Frazier

Toshio Fukuda
Arnold M. Greenspan
Raymond Hapeman
Donald M. Heirman
Richard H. Hulett
Lowell G. Johnson
Joseph L. Koepfinger*
Peter H. Lips

Nader Mehravari
Daleep C. Mohla
William J. Moylan
Malcolm V. Thaden
Geoffrey O. Thompson
Howard L. Wolfman
Don Wright

*Member Emeritus

Also included is the following nonvoting IEEE-SA Standards Board liaison:

Alan Cookson, *NIST Representative*
Satish K. Aggarwal, *NRC Representative*

Don Messina, *IEEE Standards Project Editor*

Contents

1.	Overview	1
1.1	Scope	1
1.2	Purpose	2
1.3	Contents	3
2.	References	4
2.1	General	4
2.2	Reference documents	4
3.	Definitions	4
4.	The origins of surge voltages and surge currents	4
4.1	General	4
4.2	Lightning surges	5
4.3	Switching surges	8
4.4	Multiple-system interaction overvoltages	11
5.	Propagation, dispersion, and inherent mitigation of surges	13
5.1	General	13
5.2	Current dispersion	13
5.3	Voltage surge propagation	14
5.4	Location categories—Scenario I	15
5.5	Scenario II—Direct flash to the structure	16
6.	Summary of the database	17
6.1	General	17
6.2	Notations and definitions	19
6.3	Site surveys of power quality	20
6.4	Effect of SPD proliferation on survey results	22
6.5	Equipment field experience	22
6.6	Summary of surge characteristics in Scenario I	23
6.7	Surge characteristics in Scenario II	29
7.	TOVs	31
7.1	General	31
7.2	Magnitude of TOVs due to medium-voltage and low-voltage faults	31
7.3	Probability of occurrence	33
7.4	TOVs' impact on SPDs	34
8.	Development of recommended selection of representative surges	34

Annex A (informative) Detailed database	35
Annex B (informative) Complementary information	81
Annex C (informative) Glossary.....	110
Annex D (informative) Annotated bibliography	116
Index	150

Currently in preview, click buy full version

IEEE Guide on the Surge Environment in Low-Voltage (1000 V and Less) AC Power Circuits

1. Overview

This guide is divided into eight clauses. Clause 1 provides the scope of this guide and its context with respect to other IEEE standards directly related to the subject. Clause 2 lists references to other standards that are useful in assessing the surge environment described in this guide. Clause 3 states that no new definitions have been generated for this guide; however, for the convenience of the reader, important definitions already in existence are cited in the glossary (Informative Annex C). Clause 4 provides a tutorial description of the origins of surge voltages and surge currents. Clause 5 provides information on the propagation of surges. Clause 6 provides a summary of the database, drawn from the comprehensive data listed in Informative Annex A. Clause 7 provides basic information on the occurrence of temporary overvoltages (TOVs). Clause 8 suggests how this complex database can be simplified toward selecting a few representative surge waveforms that will be more specifically defined in the recommended practice IEEE Std C62.41.2TM-2002,¹ which is a companion to this guide within the Trilogy.


This guide also contains four informative annexes. Informative Annex A describes the results of surge measurements performed in the field, as well as the results of numerical simulations performed to supplement the recording of surge events. Useful inferences on the surge environment that can be drawn from equipment field success and failures are also discussed in this annex. Informative Annex B provides further tutorial information on the occurrence and propagation of surges. Informative Annex C lists some well-established definitions of terms used in this guide, complemented by further comments. Informative Annex D is an annotated listing of bibliographic references used to develop this guide and provides suggestions for further detailed reading on the surge environment.

1.1 Scope

This is a guide describing the surge voltage, surge current, and TOV environment in low-voltage [up to 1000 V root mean square (rms)] ac power circuits. This scope does not include other power disturbances, such as notches, sags, and noise.

¹Information on references can be found in Clause 2.

The surges considered in this guide do not exceed one-half period of the normal mains waveform (fundamental frequency) in duration. They can be periodic or random events and can appear in any combination of line, neutral, or grounding conductors. They include surges with amplitudes, durations, or rates of change sufficient to cause equipment damage or operational upset (see Figure 1). While surge protective devices (SPDs) acting primarily on the amplitude of the voltage are often applied to divert the damaging surges, the upsetting surges may require other remedies. The rationale for including a description of TOVs in this guide on the surge environment is given in 1.2.

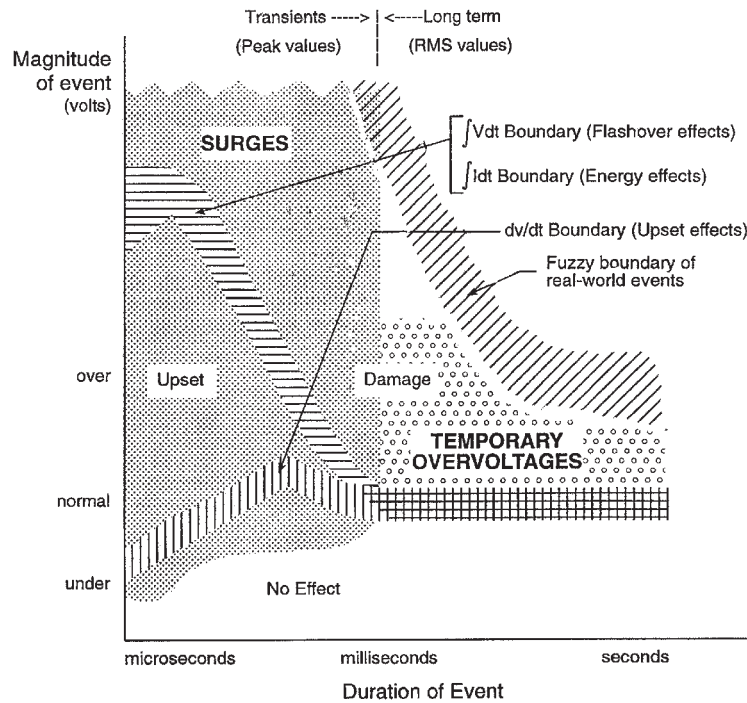

NOTES

- 1—The graph shows the relative position of effects and the order of magnitude of the amplitude and duration. Do not attempt to read numerical values from this graph.
- 2—The scope of the guide is shown by the two dot-pattern areas. The fine pattern relates to surges, the prime scope of this guide. The coarse pattern relates to TOVs, the secondary scope of this guide. For surges, the upper limit for the duration is one half-cycle of the applicable power frequency. Swells—overvoltage events longer in duration than a surge, but lasting only a few seconds—are considered to be a subset of TOVs.
- 3—The values or positions of the boundaries between “no effect” and “upset” and between “upset” and “damage” vary with the withstand characteristics of the equipment exposed to the surges.
- 4—The boundary between “upset” and “damage” in the microsecond range is shown as the integral of Vdt to reflect the upturn in the volt-time characteristic of sparkover. Equipment responses that do not involve a sparkover are more likely to be influenced by the simple magnitude of voltage V .
- 5—This figure shows only one measure of surge severity emphasizing voltage and time relationships. Other possible measures include current peak and duration, rise time, and energy transfer.

Figure 1—Simplified relationships among voltage, duration, rate of change, and effects on equipment

1.2 Purpose

This guide, the first of a Trilogy of three IEEE standards addressing surges in low-voltage ac power circuits, focuses on the surge environment and on the TOV environment. This part provides readers with basic information on the occurrence of surges, as a database for the second document of the Trilogy, IEEE Std C62.41.2-2002 where recommendations are presented on the selection of representative surge