



Approved as an American National Standard
ANSI Approval Date: December 16, 2017

ANSI/NEMA 61800-9-2-2017

Adjustable Speed Electrical Power Drive Systems

Part 9-2: Ecodesign for power drive systems, motor starters, power electronics and their driven applications - Energy efficiency indicators for power drive systems and motor starters

Published by

National Electrical Manufacturers Association

1300 North 17th Street, Suite 900
Rosslyn, Virginia 22209

www.nema.org

© 2013 National Electrical Manufacturers Association. All rights including translation into other languages, reserved under the Universal Copyright Convention, the Berne Convention for the Protection of Literary and Artistic Works, and the International and Pan American Copyright Conventions.

These materials are subject to copyright claims of IEC and NEMA. No part of this publication may be reproduced in any form, including an electronic retrieval system, without the prior written permission of NEMA. All requests pertaining to the ANSI/NEMA 61800-9-2-2017 standard should be submitted to NEMA.

NOTICE AND DISCLAIMER

The information in this publication was considered technically sound by the consensus of persons engaged in the development and approval of the document at the time it was developed. Consensus does not necessarily mean that there is unanimous agreement among every person participating in the development of this document.

The National Electrical Manufacturers Association (NEMA) standards and guideline publications, of which the document contained herein is one, are developed through a voluntary consensus standards development process. This process brings together volunteers and/or seeks out the views of persons who have an interest in the topic covered by this publication. While NEMA administers the process and establishes rules to promote fairness in the development of consensus, it does not write the document and it does not independently test, evaluate, or verify the accuracy or completeness of any information or the soundness of any judgments contained in its standards and guideline publications.

NEMA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential, or compensatory, directly or indirectly resulting from the publication, use of, application, or reliance on this document. NEMA disclaims and makes no warranty or warranty, expressed or implied, as to the accuracy or completeness of any information published herein, and disclaims and makes no warranty that the information in this document will fulfill any of your particular purposes or needs. NEMA does not undertake to guarantee the performance of any individual manufacturer or seller's products or services by virtue of this standard or guideline.

In publishing and making this document available, NEMA is not undertaking to render professional or other services for or on behalf of any person or entity, nor is NEMA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances. Information and other standards on the topic covered by this publication may be available from other sources, which the user may wish to consult for additional views or information not covered by this publication.

NEMA has no power, nor does it undertake to police or enforce compliance with the contents of this document. NEMA does not certify, test, or inspect products, designs, or installations for safety or health purposes. Any certification or other statement of compliance with any health or safety-related information in this document shall not be attributable to NEMA and is solely the responsibility of the certifier or maker of the statement.

Currently in preview, click buy full version

CONTENTS

| | |
|---|-----|
| FOREWORD | vii |
| INTRODUCTION | ix |
| 1 Scope | 1 |
| 2 Normative references | 2 |
| 3 Terms, definitions, symbols and abbreviated terms | 3 |
| 3.1 Terms and definitions | 3 |
| 3.2 Symbols and abbreviated terms | 6 |
| 4 Reference PDS (RPDS), reference CDM (RCDM) and reference motor (RM) | 13 |
| 4.1 General | 13 |
| 4.2 Reference operating points of the RPDS, RCDM, RM and associated losses | 16 |
| 4.3 Combining PDS losses with the driven equipment – Workflow for the semi-analytical model (SAM) | 18 |
| 4.4 IE classes of line-fed motors | 20 |
| 4.5 IE classes of converter-fed motors | 20 |
| 4.6 IE Classes of frequency converters (complete drive module, CDM) | 21 |
| 4.7 IES Classes of a PDS | 21 |
| 4.8 Consistency of IE and IES classes | 21 |
| 4.9 Determination of the IES class of a PDS by application of "reference" and "test" devices and guidance for the manufacturers | 22 |
| 5 Mathematical model of CDM, motor and PDS | 23 |
| 5.1 General | 23 |
| 5.2 CDM losses | 24 |
| 5.2.1 General procedure and definition of the CDM and the test load | 24 |
| 5.2.2 Output inverter losses | 26 |
| 5.2.3 Input converter losses | 29 |
| 5.2.4 Input choke losses | 30 |
| 5.2.5 DC link losses | 31 |
| 5.2.6 Current conductor losses | 31 |
| 5.2.7 Control and standby losses | 32 |
| 5.2.8 Cooling loss factor | 32 |
| 5.2.9 Other CDM losses | 33 |
| 5.2.10 Overall CDM losses | 33 |
| 5.3 Motor losses | 34 |
| 5.3.1 General | 34 |
| 5.3.2 Additional harmonic losses of three-phase asynchronous motors fed by a CDM | 34 |
| 5.3.3 Reference motor (RM) data | 35 |
| 5.4 Reference PDS (RPDS) | 35 |
| 5.4.1 Reference PDS losses | 35 |
| 5.4.2 PDS losses at different switching frequencies | 37 |
| 5.5 PDS losses for regenerative operation | 38 |
| 5.6 Losses of motor starters | 39 |

| | | |
|-----------------------|--|----|
| 6 | Limits of IE and IES classes | 39 |
| 6.1 | General | 39 |
| 6.2 | CDM | 39 |
| 6.3 | Motor | 42 |
| 6.4 | PDS | 42 |
| 7 | Loss determination | 44 |
| 7.1 | General | 44 |
| 7.2 | Type testing of CDM for IE classification | 44 |
| 7.3 | Type testing of PDS for IES classification | 45 |
| 7.4 | Determination procedures for CDM and PDS losses in part load operation | 45 |
| 7.5 | CDM loss calculation | 45 |
| 7.6 | PDS loss calculation | 46 |
| 7.7 | Input-output measurement method | 47 |
| 7.7.1 | Input-output measurement of CDM losses | 47 |
| 7.7.2 | Input-output measurement of PDS losses | 47 |
| 7.7.3 | Requirements of input-output measurement methods | 48 |
| 7.8 | Calorimetric measurement of CDM losses | 51 |
| 7.9 | Testing conditions for CDM testing | 51 |
| 7.10 | Testing conditions for PDS testing | 52 |
| 7.11 | Flowcharts for test procedures | 53 |
| 8 | Requirements for the user's documentation | 56 |
| 8.1 | General | 56 |
| 8.2 | Information for selection | 57 |
| 8.3 | Information for determination of energy efficiency classification | 57 |
| 8.4 | Information on the determination of additional energy losses and part load conditions | 58 |
| 8.4.1 | General | 58 |
| 8.4.2 | Losses in part load conditions | 58 |
| 8.4.3 | Losses of auxiliaries and options | 58 |
| 8.4.4 | Losses in stand-by mode | 59 |
| 8.4.5 | Losses in regenerative mode | 59 |
| Annex A (normative) | Losses of RCDM, RM and RPDS | 60 |
| A.1 | Relative loss tables | 60 |
| Annex B (informative) | Description of the elements of an extended product using PDS with regard to their impact on losses | 65 |
| B.1 | General | 65 |
| B.2 | Losses in the mains cabling and feeding section | 65 |
| B.3 | Input filter | 67 |
| B.3.1 | High frequency EMI filter | 67 |
| B.3.2 | Low frequency line harmonics filter | 67 |
| B.4 | Input converter | 68 |
| B.4.1 | General | 68 |
| B.4.2 | Diode rectifier | 68 |
| B.4.3 | Active infeed converter | 69 |

| | | |
|-----------------------|---|----|
| B.4.4 | Power factor of the input converter | 70 |
| B.5 | DC link | 71 |
| B.6 | Output inverter | 73 |
| B.7 | Output filter and motor cables..... | 74 |
| B.7.1 | General..... | 74 |
| B.7.2 | Sine wave filters..... | 74 |
| B.7.3 | dV/dt filters and motor chokes | 75 |
| B.7.4 | High frequency EMI motor filters | 76 |
| B.7.5 | Motor cables | 76 |
| B.8 | Motor..... | 76 |
| B.9 | Mechanical load | 76 |
| B.10 | Control and standby losses..... | 76 |
| B.11 | Cooling losses..... | 77 |
| B.11.1 | Primary cooling losses | 77 |
| B.11.2 | Secondary cooling losses..... | 77 |
| Annex C (informative) | Converter topology | 78 |
| C.1 | General | 78 |
| C.2 | Voltage source output inverter topologies different from those mathematically described in 5.2.2 | 78 |
| C.3 | Voltage source input converter topologies different from those mathematically described in 5.2.3..... | 78 |
| C.4 | CDM topologies different from voltage source type | 79 |
| Annex D (informative) | Motor model and loss interpolation | 80 |
| D.1 | Overview | 80 |
| D.2 | Losses of AC motors | 80 |
| D.2.1 | General..... | 80 |
| D.2.2 | Stator and rotor winding I^2R losses ($P_{LS} + P_{LR}$ (for induction or wound rotor motors)) | 80 |
| D.2.3 | Additional losses (P_{LL}) | 80 |
| D.2.4 | Iron losses (P_{Lfe}) | 81 |
| D.2.5 | Friction and windage losses (P_{Lfw}) | 81 |
| D.2.6 | Additional parasitic losses (P_{LHL}) | 82 |
| D.3 | Interpolation formula..... | 82 |
| D.4 | Analytical determination of the interpolation coefficients | 83 |
| D.4.1 | General..... | 83 |
| D.4.2 | Additional losses due to frequency converter voltage drop | 85 |
| D.4.3 | Alternate operating points to determine interpolation coefficients | 85 |
| D.4.4 | Motors for square-torque applications | 86 |
| D.5 | Determination of interpolation error | 87 |
| D.6 | Numerical determination of the interpolation coefficients | 87 |
| D.7 | Typical IE2 induction motor efficiency..... | 87 |
| Annex E (informative) | Application example for loss calculations of a CDM and a PDS..... | 91 |
| E.1 | General | 91 |
| E.2 | CDM loss determination | 91 |
| E.2.1 | General..... | 91 |

| | | |
|-----------------------|--|-----|
| E.2.2 | Loss determination by maximum losses of neighbouring loss points | 92 |
| E.2.3 | Loss determination by two-dimensional interpolation of losses of neighbouring loss points..... | 92 |
| E.2.4 | Loss determination by the mathematical model described in 5.2..... | 96 |
| E.3 | Loss determination of the motor | 97 |
| E.4 | Loss determination of the PDS | 98 |
| Annex F (informative) | Uncertainty of loss determination method..... | 99 |
| F.1 | General | 99 |
| F.2 | Calculation of uncertainty at randomly occurring errors..... | 99 |
| F.3 | Comparison of uncertainties for different loss determination methods..... | 99 |
| Annex G (informative) | Calorimetric measurement for CDM losses | 100 |
| G.1 | General | 100 |
| G.2 | Calorimeter with two chambers with air as a cooling medium..... | 100 |
| G.3 | Calorimeter with one chamber with air as a cooling medium | 101 |
| G.4 | Calorimeter with liquid as a cooling medium | 102 |
| Bibliography | | 104 |

| | | |
|-----------|--|----|
| Figure 1 | – Illustration of core requirements of energy efficiency standardization | ix |
| Figure 2 | – Illustration of the extended product with included motor system | 4 |
| Figure 3 | – Torque-speed-characteristic of servo PDS..... | 6 |
| Figure 4 | – Illustration of the operating points (shaft speed, torque) for the determination of relative losses of the power drive system (RPDS)..... | 16 |
| Figure 5 | – Illustration of the operating points (shaft speed, torque) for the determination of relative losses of the reference motor (RM) | 17 |
| Figure 6 | – Illustration of the operating points (relative motor stator frequency, relative torque-producing current) for the determination of losses of the reference complete drive module (RCDM)..... | 18 |
| Figure 7 | – Illustration of the workflow to determine the energy efficiency index (EEI) of an extended product..... | 19 |
| Figure 8 | – Illustration how to combine different data sources to determine the energy efficiency index (EEI) of an extended product..... | 20 |
| Figure 9 | – Metrical relation of IE, IES classes | 22 |
| Figure 10 | – Guidance for CDM and Motor manufacturers for the usage of "test" and "reference" devices to determine the IE/IES classes..... | 23 |
| Figure 11 | – Illustration of the CDM and the test load | 24 |
| Figure 12 | – Relative losses $p_{L,CDM}$ of the 9,95 kVA RCDM | 33 |
| Figure 13 | – Example of the relative power losses of PDS as function of speed and torque .. | 37 |
| Figure 14 | – Example of the relative power losses versus switching frequency | 38 |
| Figure 15 | – Example of a CDM with resistor for dissipating generated power | 38 |
| Figure 16 | – Illustration of IE classes for a CDM | 41 |
| Figure 17 | – Illustration of IES classes of a PDS..... | 42 |
| Figure 18 | – Losses of CDM are provided as the sum of the determined losses plus the uncertainty of the determination method | 45 |

| | |
|--|-----|
| Figure 19 – Input-output measurement setup for determination of CDM losses | 47 |
| Figure 20 – Input-output measurement setup for PDS losses..... | 48 |
| Figure 21 – Order of CDM measurements from [1] to [8]..... | 49 |
| Figure 22 – Order of PDS measurements from [1] to [8] | 50 |
| Figure 23 – Calorimetric measurement setup for determining CDM losses..... | 51 |
| Figure 24 – Determination of IE classification for CDM and loss determination for part load operating points | 55 |
| Figure 25 – Determination of IES classification for PDS and loss determination for part load operating points | 56 |
| Figure B.1 – Overview of the extended product and energy flow | 65 |
| Figure B.2 – Equivalent circuit of the mains and mains cabling | 66 |
| Figure B.3 – Illustration of a single phase line harmonics filter..... | 67 |
| Figure B.4 – PDS with a diode rectifier input converter | 68 |
| Figure B.5 – PDS with a standard AIC input converter | 69 |
| Figure B.6 – PDS with a F3E-AIC input converter without line choke | 70 |
| Figure B.7 – Typical waveform of a diode rectifier line current | 70 |
| Figure B.8 – DC link circuit | 71 |
| Figure B.9 – DC link circuit with additional DC chokes | 72 |
| Figure B.10 – Output inverter of the PDS..... | 73 |
| Figure B.11 – Motor cable and optional output filter of the PDS | 74 |
| Figure B.12 – Typical waveform of inverter output voltage and motor voltage when using a sine wave output filter | 75 |
| Figure D.1 – Normative operating points..... | 84 |
| Figure E.1 – Segments of operating points | 91 |
| Figure E.2 – Two-dimensional interpolation | 93 |
| Figure G.1 – One-step calorimetric measurement setup for comparative loss measurement (CDM and heating resistor are loaded simultaneously) | 101 |
| Figure G.2 – Two-step calorimetric measurement setup for comparative loss measurement (CDM and heating resistor are not loaded simultaneously) | 102 |
| Figure G.3 – Liquid cooled calorimetric measurement setup for CDM loss measurement | 103 |
| Table 1 – Minimum test lead currents at different points of operation..... | 25 |
| Table 2 – Test lead displacement factor between fundamental output current and fundamental output voltage at different points of operation | 25 |
| Table 3 – Reference parameters for Formula (5) | 27 |
| Table 4 – Variables for Formula (5) | 27 |
| Table 5 – Reference parameters for Formula (6) | 27 |
| Table 6 – Reference parameters for Formula (7) | 28 |
| Table 7 – Reference parameters for Formula (8) | 29 |
| Table 8 – Reference parameters for Formula (10) | 30 |
| Table 9 – Variables for Formula (10) | 30 |

| | |
|--|----|
| Table 10 – Reference parameters for Formula (11): | 31 |
| Table 11 – Reference parameters for Formula (12) | 31 |
| Table 12 – Reference parameters for Formula (13) | 32 |
| Table 13 – Reference parameter for Formula (15) | 32 |
| Table 14 – Reference parameter for Formula (14) | 32 |
| Table 15 – Relative losses of the 400 V/9,95 kVA reference CDM at the operating points described in Figure 6 | 34 |
| Table 16 – Reference parameter for Formula (19) | 36 |
| Table 17 – Relative losses of the 400 V/7,5 kW RPDS | 36 |
| Table 18 – Reference CDM losses for class IE1 definition | 40 |
| Table 19 – Reference PDS losses of IES class 1 definition | 43 |
| Table 20 – Information requirements | 57 |
| Table A.1 – Relative losses (%) of reference CDMs at different power ratings at the operating points described in Figure 6 | 60 |
| Table A.2 – Relative losses (%) of reference motors at different power ratings at the operating points described in Figure 5 | 61 |
| Table A.3 – Relative losses (%) for a reference PDS at different power ratings at the operating points described in Figure 4 | 62 |
| Table B.1 – Typical values of λ for different input converter topologies | 71 |
| Table D.1 – Recommended split of windage and friction losses for IC 411 self-ventilated motors | 82 |
| Table D.2 – Normative operating points with graphical representation | 84 |
| Table D.3 – Non-normative alternate operating points | 86 |
| Table D.4 – Interpolation coefficients of typical 4-pole reference IE2 induction machines | 88 |
| Table D.5 – Interpolation coefficients of typical 2-pole reference IE2 induction machines | 89 |
| Table E.1 – Relative losses of a 400 V/9,95 kVA example CDM at the predefined operating points | 92 |
| Table E.2 – Parameters of the example CDM | 96 |
| Table E.3 – Results of the CDM calculation according to the mathematical model | 97 |
| Table E.4 – Comparison of different loss evaluation methods | 97 |
| Table E.5 – Loss data of the 7,5kW reference motor | 98 |

INTERNATIONAL ELECTROTECHNICAL COMMISSION

ADJUSTABLE SPEED ELECTRICAL POWER DRIVE SYSTEMS –

**Part 9-2: Ecodesign for power drive systems,
motor starters, power electronics and their driven applications –
Energy efficiency indicators for power drive systems and motor starters**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, accept to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 61800-9-2 has been prepared by subcommittee 22G: Adjustable speed electric drive systems incorporating semiconductor power converters, of IEC technical committee 22: Power electronic systems and equipment.

The text of this document is based on the following documents:

| | |
|--------------|------------------|
| FDIS | Report on voting |
| 22G/349/FDIS | 22G/352/RVD |

Full information on the voting for the approval of this document can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 61800 series, published under the general title *Adjustable speed electrical power drive systems*, can be found on the IEC website.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

Note: The user's attention is called to the possibility that compliance with this standard could require use of an invention covered by patent rights.

By publication of this standard, no position is taken with respect to the validity of any such claim(s) or of any patent rights in connection therewith. If a patent holder has filed a statement of willingness to grant a license under these rights on reasonable and non-discriminatory terms and conditions to applicants desiring to obtain such a license, then details may be obtained from the Secretary.

INTRODUCTION

This part of IEC 61800 has been developed to allow evaluation of power losses of CDMs (complete drive modules) and PDSs (power drive systems).

The requirements for measuring energy efficiency of motors with non-sinusoidal supply are under the responsibility of IEC/TC 2 and will be published under the IEC 60034 series.

IEC SC 22G includes the standardization task force for dealing with this topic. It has close collaboration with several other technical committees (for example, IEC TC 2, IEC SC 121A).

IEC SC 22G maintains responsibility for all relevant aspects in the field of energy efficiency and ecodesign requirements for power electronics, switchgear, control gear and power drive systems and their industrial applications.

The core requirements of energy efficiency standardization are illustrated in Figure 1. The work has been agreed to provide the reasonable target as a best compromise.

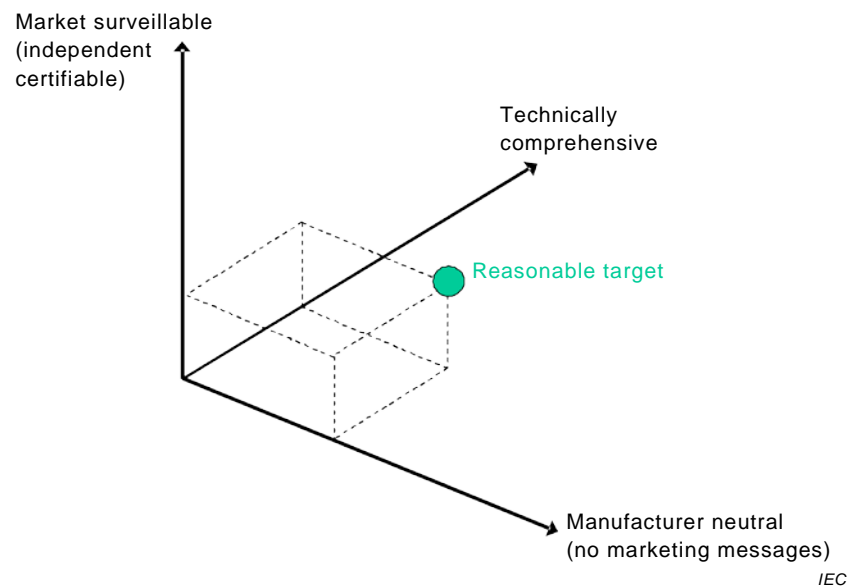


Figure 1 – Illustration of core requirements of energy efficiency standardization

IEC 61800 (all parts) does not deal with mechanical engineering components.

NOTE Geared motors (motors with directly adapted gearboxes) are treated like power drive systems (converter plus motor). See IEC 60034-30-1 for classification of the losses of a geared motor. The efficiency classes of gearboxes as individual components are under consideration.

IEC 61800-9-2 is a subpart of the IEC 61800 series, which has the following structure:

- *Part 1: General requirements – Rating specifications for low voltage adjustable speed DC power drive systems*
- *Part 2: General requirements – Rating specifications for low voltage adjustable speed AC power drive systems*

- *Part 3: EMC requirements and specific test methods*
- *Part 4: General requirements – Rating specifications for AC power drive systems above 1 000 V AC and not exceeding 35 kV*
- *Part 5: Safety requirements*
- *Part 6: Guide for determination of types of load duty and corresponding current ratings*
- *Part 7: Generic interface and use of profiles for power drive systems*
- *Part 8: Specification of voltage on the power interface*
- *Part 9: Ecodesign for power drive systems, motor starters, power electronics and their driven applications*

Each part is further subdivided into several subparts, published either as International Standards or as Technical Specifications or Technical Reports, some of which have already been published. Other will be published with the part number followed by a dash and a second number identifying the subdivision (example: IEC 61800-9-2).

It considers basic requirements from the EN 50598-2 CENELEC standard published on 2014-12-19 and considers also the following key points in cooperation with relevant technical committees.

It has been developed in close collaboration with other technical committees (IEC TC 2, IEC SC 121A) and with a customer's stakeholder committee CEN/TC 197 in order to provide a comprehensive standard for energy efficiency and ecodesign requirements.

Key points:

- Requirements for energy-efficient design of electric drive systems in accordance with the driven load
- Requirements and IE-classification of complete drive modules (CDM)
- Requirements and IES-classification of power drive systems (PDS)
- Determination of PDS losses and requirements for the link to the driven equipment for the determination of energy efficiency classification/evaluation of the extended product
- Requirements for an environmentally conscious system design and environmental declaration of a motor system

ADJUSTABLE SPEED ELECTRICAL POWER DRIVE SYSTEMS –

Part 9-2: Ecodesign for power drive systems, motor starters, power electronics and their driven applications – Energy efficiency indicators for power drive systems and motor starters

1 Scope

This part of IEC 61800 specifies energy efficiency indicators of power electronics (complete drive modules, CDM), power drive systems (PDS) and motor starters, all used for motor driven equipment.

It specifies the methodology for the determination of losses of the complete drive module (CDM), the power drive system (PDS) and the motor system.

It defines IE and IES-classes, their limit values and provides test procedures for the classification of the overall losses of the motor system.

Furthermore, this document proposes a methodology for the implementation of the best energy efficiency solution of drive systems. This depends on the architecture of the motor driven system, on the speed/load profile and on the operating points over time of the driven equipment.

The methodology of the extended product approach and the semi analytical models are defined in IEC 61800-9-1.

The structure of this document is as follows:

- the losses of standardized reference PDS (RPDS), standardized reference CDM (RCDM) and the mathematical model for their calculation are given and classified;
- the reference motor (RM) and the reference CDM (RCDM) are defined and can be used to determine the efficiency class of a motor system when one of its constituents is unknown;
- the requirements for the determination of the losses of a real PDS and a real CDM are given and compared to the reference RPDS and RCDM;
- the requirements for type testing and user documentation are given;
- some exemplary losses of an overall system are illustrated in annexes;
- information about system and drive topologies are given in annexes.

Specific data for power losses of RCDM, RM, RPDS and IE/IES-classes are given for low voltage (100 V up to and equal to 1 000 V), single axis AC/AC power drive systems with three-phase motors. Geared motors are treated as standard motors when motor and gearbox can be separated.

All provided reference data is derived from PDS with induction motors. It may be used for all types of PDS with other types of motors as well.

The application of this document to the following equipment may be technically possible but is not mandatory: