



ANSI/TIA-568.3-E 2022
APPROVED: SEPTEMBER 29, 2022

TIA STANDARD

Optical Fiber Cabling and Components Standard

ANSI/TIA-568.3-E
(Revision of TIA-568.3-D)

September 2022

TIAONLINE.ORG

NOTICE

TIA Engineering Standards and Publications are designed to serve the public interest through eliminating misunderstandings between manufacturers and purchasers, facilitating interchangeability and improvement of products, and assisting the purchaser in selecting and obtaining with minimum delay the proper product for their particular need. The existence of such Standards and Publications shall not in any respect preclude any member or non-member of TIA from manufacturing or selling products not conforming to such Standards and Publications. Neither shall the existence of such Standards and Publications preclude their voluntary use by non-TIA members, either domestically or internationally.

Standards and Publications are adopted by TIA in accordance with the American National Standards Institute (ANSI) patent policy. By such action, TIA does not assume any liability to any patent owner, nor does it assume any obligation whatever to parties adopting the Standard or Publication.

This Standard does not purport to address all safety problems associated with its use or all applicable regulatory requirements. It is the responsibility of the user of this Standard to establish appropriate safety and health practices and to determine the applicability of regulatory limitations before its use.

Any use of trademarks in this document are for information purposes and do not constitute an endorsement by TIA or this committee of the products or services of the company.

(From Standards Proposal No. ANSI/TIA-PN-568.3-E-D1 formulated under the cognizance of the TIA TR-42 Telecommunications Cabling Systems, TR-42.1 Subcommittee on Optical Systems (568).

Published by
©TELECOMMUNICATIONS INDUSTRY ASSOCIATION
Technology and Standards Department
1310 N. Courthouse Road, Suite 190
Arlington, VA 22201 U.S.A.

**PRICE: Please refer to current Catalog of
TIA TELECOMMUNICATIONS INDUSTRY ASSOCIATION STANDARDS
AND ENGINEERING PUBLICATIONS
or call IHS, USA and Canada
(1-800-854-7179) International (303-397-2896)
or search online at www.TIAonline.org**

All rights reserved
Printed in U.S.A.

NOTICE OF COPYRIGHT

This document is copyrighted by the TIA.

Reproduction of these documents either in hard copy or soft copy (including posting on the web) is prohibited without copyright permission. For copyright permission to reproduce portions of this document, please contact the TIA Standards Department or go to the TIA website (www.tiaonline.org) for details on how to request permission. Details are located at:

[Standards Procedures and Guidelines](#)

or

Telecommunications Industry Association
Technology & Standards Department
1310 N. Courthouse Road, Suite 890
Arlington, VA 22201 USA
+1.703.907.7700

Organizations may obtain permission to reproduce a limited number of copies by entering into a license agreement. For information, contact:

IHS
15 Inverness Way East
Englewood, CO 80112-5704
or call
USA and Canada (1.800.525.7052)
International (303.790.0600)

PATENT IDENTIFICATION

The reader's attention is called to the possibility that compliance with this document may require the use of one or more inventions covered by the patent rights.

By publication of this document, no position is taken with respect to the validity of those claims or any patent rights in connection therewith. The patent holders so far identified have, we believe, filed statements of willingness to grant licenses under those rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such licenses for the purpose of implementing this TIA Publication. Details regarding the filed statements may be obtained from TIA.

The following patent holders and patents have been identified in accordance with the TIA intellectual property rights policy:

- Corning Optical Communications LLC
4200 Corning Place
Charlotte, NC 28216
Patent Holder Website: www.corning.com

TIA shall not be responsible for identifying patents for which licenses may be required by this document or for conducting inquiries into the legal validity or scope of those patents that are brought to its attention.

NOTICE OF DISCLAIMER AND LIMITATION OF LIABILITY

The document to which this Notice is affixed (the "Document") has been prepared by one or more Engineering Committees or Formulating Groups of the Telecommunications Industry Association ("TIA"). TIA is not the author of the Document contents, but publishes and claims copyright to the Document pursuant to licenses and permission granted by the authors of the contents.

TIA Engineering Committees and Formulating Groups are expected to conduct their affairs in accordance with the TIA Procedures for American National Standards and TIA Engineering Committee Operating Procedures, the current and predecessor versions of which are available at [Standards Procedures and Guidelines](#). TIA's function is to administer the process, but not the content, of document preparation in accordance with the Manual and, when appropriate, the policies and procedures of the American National Standards Institute ("ANSI"). TIA does not evaluate, test, verify or investigate the information, accuracy, soundness, or credibility of the contents of the Document. In publishing the Document, TIA disclaims any undertaking to perform any duty owed to or for anyone.

If the Document is identified or marked as a project number (PN) document, or as a standards proposal (P) document, persons or parties reading or in any way interested in the Document are cautioned that: (a) the Document is a proposal; (b) there is no assurance that the Document will be approved by any Committee of TIA or any other body in its present or any other form; (c) the Document may be amended, modified or changed in the standards development or any editing process.

The use or practice of contents of this Document may involve the use of intellectual property rights ("IPR"), including pending or issued patents, or copyrights, owned by one or more parties. TIA makes no search or investigation for IPR. When IPR consisting of patents and published pending patent applications are claimed and called to TIA's attention, a statement from the holder thereof is requested, all in accordance with the Manual. TIA takes no position with reference to, and disclaims any obligation to investigate or inquire into, the scope or validity of any claims of IPR. TIA will neither be a party to discussions of any licensing terms or conditions, which are instead left to the parties involved, nor will TIA opine or judge whether proposed licensing terms or conditions are reasonable or non-discriminatory. TIA does not warrant or represent that procedures or practices suggested or provided in the Manual have been complied with as respects the Document or its contents.

If the Document contains one or more Normative References to a document published by another organization ("other SSO") engaged in the formulation, development or publication of standards (whether designated as a standard, specification, recommendation or otherwise), whether such reference consists of mandatory, alternate or optional elements (as defined in the TIA Procedures for American National Standards) then (i) TIA disclaims any duty or obligation to search or investigate the records of any other SSO for IPR or letters of assurance relating to any such Normative Reference; (ii) TIA's policy of encouragement of voluntary disclosure (see TIA Procedures for American National Standards Annex C.1.2.3) of Essential Patent(s) and published pending patent applications shall apply; and (iii) Information as to claims of IPR in the records or publications of the other SSO shall not constitute identification to TIA of a claim of Essential Patent(s) or published pending patent applications.

TIA does not enforce or monitor compliance with the contents of the Document. TIA does not certify, inspect, test or otherwise investigate products, designs or devices or any claims of compliance with the contents of the Document.

ALL WARRANTIES, EXPRESS OR IMPLIED, ARE DISCLAIMED, INCLUDING WITHOUT LIMITATION, ANY AND ALL WARRANTIES CONCERNING THE ACCURACY OF THE CONTENTS, ITS FITNESS OR APPROPRIATENESS FOR A PARTICULAR PURPOSE OR USE, ITS MERCHANTABILITY AND ITS NONINFRINGEMENT OF ANY THIRD PARTY'S INTELLECTUAL PROPERTY RIGHTS. TIA EXPRESSLY DISCLAIMS ANY AND ALL RESPONSIBILITIES FOR THE ACCURACY OF THE CONTENTS AND MAKES NO REPRESENTATIONS OR WARRANTIES REGARDING THE CONTENT'S COMPLIANCE WITH ANY APPLICABLE STATUTE, RULE OR REGULATION, OR THE SAFETY OR HEALTH EFFECTS OF THE CONTENTS OR ANY PRODUCT OR SERVICE REFERRED TO IN THE DOCUMENT OR PRODUCED OR RENDERED TO COMPLY WITH THE CONTENTS. TIA SHALL NOT BE LIABLE FOR ANY AND ALL DAMAGES, DIRECT OR INDIRECT, ARISING FROM OR RELATING TO ANY USE OF THE CONTENTS CONTAINED HEREIN, INCLUDING WITHOUT LIMITATION ANY AND ALL INDIRECT, SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES (INCLUDING DAMAGES FOR LOSS OF BUSINESS, LOSS OF PROFITS, LITIGATION, OR THE LIKE), WHETHER BASED UPON BREACH OF CONTRACT, BREACH OF WARRANTY, TORT (INCLUDING NEGLIGENCE), PRODUCT LIABILITY OR OTHERWISE, EVEN IF ADVISED OF THE POSSIBILITY OF SUCH DAMAGES. THE FOREGOING NEGATION OF DAMAGES IS A FUNDAMENTAL ELEMENT OF THE USE OF THE CONTENTS HEREOF, AND THESE CONTENTS WOULD NOT BE PUBLISHED BY TIA WITHOUT SUCH LIMITATIONS.

OPTICAL FIBER CABLING AND COMPONENTS STANDARD

Table of Contents

FOREWORD.....	vii
1 SCOPE.....	1
2 NORMATIVE REFERENCES.....	1
3 DEFINITIONS, ABBREVIATIONS AND ACRONYMS, UNITS OF MEASURE.....	2
3.1 General.....	2
3.2 Definitions.....	2
3.3 Abbreviations and acronyms.....	6
3.4 Units of measure.....	7
4 OPTICAL FIBER CABLE.....	7
4.1 General.....	7
4.2 Cable transmission performance.....	8
4.3 Physical requirements.....	9
4.3.1 Inside plant cable.....	9
4.3.2 Indoor-outdoor cable.....	9
4.3.3 Outside plant cable.....	9
4.3.4 Drop cable.....	9
4.3.5 Outside plant microduct cable.....	9
5 CONNECTING HARDWARE.....	10
5.1 General.....	10
5.2 Connectors and adapters.....	10
5.2.1 Simplex and duplex connectors.....	10
5.2.1.1 Physical design.....	10
5.2.1.2 Performance.....	10
5.2.1.3 Keying and fiber positions.....	10
5.2.1.3.1 LC Connector.....	10
5.2.1.3.2 Other duplex connectors.....	11
5.2.2 Array connectors.....	11
5.2.2.1 Physical design.....	11
5.2.2.2 Performance.....	11
5.2.2.3 Keying and fiber positions.....	11
5.2.2.4 Adapters.....	11
5.2.2.4.1 Type-A adapters.....	11
5.2.2.4.2 Type-B adapters.....	12
5.2.3 Multimode and single-mode connector and adapter identification.....	12
5.3 Optical fiber splice.....	12
5.4 Optical fiber splitter/coupler.....	13
5.5 Housings for cable terminations.....	13
5.5.1 General.....	13
6 CORDS, ARRAY CABLES, AND TRANSITIONS.....	13
6.1 General.....	13
6.2 Cord cable.....	13
6.3 Cord connectors.....	13
6.4 Termination configuration.....	14
6.4.1 Simplex.....	14
6.4.2 Duplex.....	14
6.4.2.1 A-to-B duplex patch cord.....	14
6.4.2.2 A-to-A duplex patch cord.....	14
6.4.3 Array.....	15

6.4.3.1 General 15

6.4.3.2 Array patch cords and array cables 16

6.4.3.2.1 Type-A:1-1 array patch cord and array cable 16

6.4.3.2.2 Type-A:2-1 array patch cord 17

6.4.3.2.3 Type-A:2-2 array patch cord and array cable 18

6.4.3.2.4 Type-B:1-1 array patch cord and array cable 19

6.4.3.2.5 Type-B:2-1 array patch cord 20

6.4.3.2.6 Type-B:2-2 array patch cord and array cable 21

6.4.3.2.7 Type-C:1-1 array patch cord and array cable 22

6.4.3.2.8 Type-C:2-1 array patch cord 23

6.4.3.2.9 Type-C:2-2 array patch cord and array cable 24

6.5 Optical fiber transitions 25

6.5.1 General 25

6.5.2 Type-A fiber transitions 26

6.5.3 Type-U fiber transitions 27

6.5.3.1 Type-U1 fiber transitions 27

6.5.3.2 Type-U2 fiber transitions 28

7 OPTICAL FIBER TRANSMISSION PERFORMANCE AND TEST REQUIREMENTS 29

7.1 General 29

7.1.1 Cabling testing standards 29

7.2 Field-test instruments 29

7.2.1 Multimode 29

7.2.2 Single-mode 29

7.3 Link and channel performance measurements 29

7.3.1 General 29

7.3.2 Cabling Subsystem 1 30

7.3.3 Cabling Subsystem 2 and Cabling Subsystem 3 30

7.3.4 Use of test cords 31

7.3.5 Link attenuation allowance calculation 31

7.3.6 Passive link attenuation allowance calculation 32

7.3.7 Channel attenuation allowance calculation 33

ANNEX A (NORMATIVE) OPTICAL FIBER CONNECTOR PERFORMANCE SPECIFICATIONS 34

A.1 Introduction 34

A.2 Intermateability requirements 34

A.3 Test samples 34

A.3.1 General 34

A.3.2 Array connector samples 34

A.3.3 Mechanical loading samples 34

A.3.4 Test samples with functional points 34

A.4 Performance requirements 34

A.4.1 Visual and mechanical inspections 34

A.4.2 Attenuation 35

A.4.3 Return loss 35

A.4.4 Low temperature 35

A.4.5 Temperature life 36

A.4.6 Humidity 36

A.4.7 Impact 37

A.4.8 Strength of coupling mechanism 37

A.4.9 Durability 38

A.4.10 Cable retention 38

A.4.11 Flex 39

A.4.12 Twist 40

ANNEX B (NORMATIVE) GRANDFATHERED FIBER AND CABLE TYPES, AND CONNECTING HARDWARE IDENTIFICATION 41

B.1 General 41

B.2 Grandfathered cable transmission performance	41
B.3 Grandfathered multimode and single-mode connector and adapter identification.....	41
ANNEX C (NORMATIVE) MAINTAINING OPTICAL FIBER POLARITY	43
C.1 General.....	43
C.2 Duplex polarity systems	43
C.2.1 General.....	43
C.2.2 Consecutive-fiber positioning.....	44
C.2.3 Reverse-pair positioning	46
C.3 Array polarity systems	48
C.3.1 General.....	48
C.3.2 Connectivity Method A	50
C.3.2.1 Connectivity Method A supporting multiple duplex signals	50
C.3.2.2 Connectivity Method A supporting parallel signals for single-plug transceiver interfaces that employ one row of fibers per plug.....	51
C.3.2.3 Connectivity Method A supporting parallel signals for two-plug transceiver interfaces that employ one row of fibers per plug.....	52
C.3.2.4 Connectivity Method A supporting parallel signals for single-plug transceiver interfaces that employ two rows of fibers per plug and array cables that employ one row of fibers per plug.....	53
C.3.2.5 Connectivity Method A supporting parallel signals for single-plug transceiver interfaces and array patch cords and cables that exclusively employ two rows of fibers per plug.....	54
C.3.3 Connectivity Method B	55
C.3.3.1 Connectivity Method B supporting multiple duplex signals	55
C.3.3.2 Connectivity Method B supporting parallel signals for single-plug transceiver interfaces that employ one row of fibers per plug.....	56
C.3.3.3 Connectivity Method B supporting parallel signals for two-plug transceiver interfaces that employ one row of fibers per plug.....	57
C.3.3.4 Connectivity Method B supporting parallel signals for single-plug transceiver interfaces that employ two rows of fibers per plug and array cables that employ one row of fibers per plug.....	58
C.3.3.5 Connectivity Method B supporting parallel signals for single-plug transceiver interfaces and array patch cords and cables that exclusively employ two rows of fibers per plug.....	59
C.3.4 Connectivity Method C	60
C.3.4.1 Connectivity Method C supporting multiple duplex signals.....	60
C.3.4.2 Connectivity Method C supporting parallel signals for single-plug transceiver interfaces that employ one row of fibers per plug.....	61
C.3.4.3 Connectivity Method C supporting parallel signals for two-plug transceiver interfaces that employ one row of fibers per plug.....	62
C.3.4.4 Connectivity Method C supporting parallel signals for single-plug transceiver interfaces that employ two rows of fibers per plug and array cables that employ one row of fibers per plug.....	63
C.3.4.5 Connectivity Method C supporting parallel signals for single-plug transceiver interfaces and array patch cords and cables that exclusively employ two rows of fibers per plug.....	64
C.3.5 Connectivity Methods U1 and U2 supporting multiple duplex signals	65
ANNEX D (NORMATIVE) OPTICAL BRANCHING COMPONENT PERFORMANCE SPECIFICATIONS67	
D.1 General.....	67
D.2 Optical Branching Component Performance Specifications	68
ANNEX E (INFORMATIVE) GUIDELINES FOR FIELD-TESTING LENGTH, LOSS AND POLARITY OF OPTICAL FIBER CABLING	69
E.1 General.....	69
E.2 Test criteria.....	69
E.2.1 General.....	69
E.2.2 Tier 1	70
E.2.3 Tier 2 (Optional)	70
E.3 Test instruments.....	71
E.3.1 General.....	71
E.3.2 Optical loss test set.....	71
E.3.3 Visible light source	71

E.3.4	Optical time domain reflectometer	71
E.3.5	Connector end-face cleaning and inspection equipment	71
E.4	Precautions to measurement testing	72
E.5	Test measurement methods	72
E.5.1	Optical cabling attenuation	72
E.5.1.1	General	72
E.5.1.2	Verifying test jumper quality	73
E.5.1.3	Multimode	74
E.5.1.3.1	General	74
E.5.1.3.2	Setting the reference	74
E.5.1.3.3	Verifying the reference	75
E.5.1.3.4	Measuring link attenuation	75
E.5.1.4	Single-mode	76
E.5.1.4.1	General	76
E.5.1.4.2	Setting the reference	76
E.5.1.4.3	Verifying the reference	77
E.5.1.4.4	Measuring link attenuation	77
E.5.1.5	Calculating cabling attenuation	77
E.5.2	Length	77
E.5.3	Polarity	78
E.5.4	OTDR trace	78
E.6	Documentation	79
ANNEX F (INFORMATIVE) BIBLIOGRAPHY AND REFERENCES		80

List of Tables

Table 1	– Optical fiber cable transmission performance parameters	8
Table 2	– Array cord fiber color code	15
Table 3	– Type-A:1-1 array patch cord and array cable fiber sequence	16
Table 4	– Type-A:2-1 array patch cord fiber sequence	17
Table 5	– Type-A:2-2 array patch cord and array cable fiber sequence	18
Table 6	– Type-B:1-1 array patch cord and array cable fiber sequence	19
Table 7	– Type-B:2-1 array patch cord fiber sequence	20
Table 8	– Type-B:2-2 array patch cord and array cable fiber sequence	21
Table 9	– Type-C:1-1 array patch cord and array cable fiber sequence	22
Table 10	– Type-C:2-1 array patch cord fiber sequence	23
Table 11	– Type-C:2-2 array patch cord and array cable fiber sequence	24
Table 12	– Type-A transition fiber routing sequence	26
Table 13	– Type-U1 transition fiber routing sequence	27
Table 14	– Type-U2 transition fiber routing sequence	28
Table 15	– Test cord loss allowance	31
Table 16	– Grant-factored optical fiber cable transmission performance parameters	41
Table 17	– Mouse color limits for beige	42
Table 18	– Summary of components supporting multiple duplex signals	48
Table 19	– Summary of components supporting parallel signals for transceiver interfaces that employ one row of fibers per plug	48
Table 20	– Summary of components supporting parallel signals for transceiver interfaces that employ two rows of fibers per plug and array cables that employ one row of fibers per plug	49
Table 21	– Summary of components supporting parallel signals for transceiver interfaces and array patch cords and array trunk cables that exclusively employ two rows of fibers per plug	49
Table 22	– Optical Branching Component Performance Specifications	68

List of Figures

Figure 1 – Illustrative relationship between the ANSI/TIA-568 series and other relevant TIA standards.....	ix
Figure 2 – Elements of generic cabling topology.....	3
Figure 3 – Position A and B configuration of a LC.....	10
Figure 4 – Example of Type-A MPO configuration.....	11
Figure 5 – Example of Type-B MPO configuration.....	12
Figure 6 – A-to-B duplex patch cord.....	14
Figure 7 – A-to-A duplex patch cord.....	14
Figure 8 – Type-A:1-1 array patch cord and array cable (key-up to key-down).....	16
Figure 9 – Type-A:2-1 array patch cord (key-up to key-down).....	17
Figure 10 – Type-A:2-2 array patch cord and array cable (key-up to key-down).....	18
Figure 11 – Type-B:1-1 array patch cord and array cable (key-up to key-up).....	19
Figure 12 – Type-B:2-1 array patch cord (key-up to key-up).....	20
Figure 13 – Type-B:2-2 array patch cord and array cable (key-up to key-up).....	21
Figure 14 – Type-C:1-1 array patch cord and array cable (pair-wise flipped, key-up to key-down).....	22
Figure 15 – Type-C:2-1 array patch cord (pair-wise flipped, key-up to key-down).....	23
Figure 16 – Type-C:2-2 array patch cord and array cable (key-up to key-down).....	24
Figure 17 – Type-A fiber transition.....	26
Figure 18 – Type-U1 fiber transition.....	27
Figure 19 – Type-U2 fiber transition.....	28
Figure 20 – Link Reference Plane.....	29
Figure 21 – Passive Link Reference Plane.....	30
Figure 22 – Channel Reference Plane.....	30
Figure 23 – A-to-B duplex optical fiber patch cord.....	43
Figure 24 – Consecutive-fiber positioning shown with horizontally mounted hardware.....	44
Figure 25 – Consecutive-fiber positioning cabling system example shown with horizontally mounted hardware.....	45
Figure 26 – Reverse-pair positioning shown with horizontally mounted hardware.....	46
Figure 27 – Reverse-pair positioning cabling system example shown with horizontally mounted hardware.....	47
Figure 28 – Connectivity Method A supporting multiple duplex signals.....	50
Figure 29 – Connectivity Method A supporting parallel signals for single-row single-plug transceivers.....	51
Figure 30 – Connectivity Method A supporting parallel signals for two-plug one-row transceivers.....	52
Figure 31 – Connectivity Method A supporting parallel signals for one-plug two-row transceivers and array cables that employ one row of fibers per plug.....	53
Figure 32 – Connectivity Method A supporting parallel signals for one-plug two-row transceivers and array patch cords and cables.....	54
Figure 33 – Connectivity Method B supporting multiple duplex signals.....	55
Figure 34 – Connectivity Method B supporting parallel signals for one-plug one-row transceivers.....	56
Figure 35 – Connectivity Method B supporting parallel signals for two-plug one-row transceivers.....	57
Figure 36 – Connectivity Method B supporting parallel signals for one-plug two-row transceivers and array cables that employ one row of fibers per plug.....	58
Figure 37 – Connectivity Method B supporting parallel signals for exclusively one-plug two-row transceivers and array patch cords and cables.....	59
Figure 38 – Connectivity Method C supporting multiple duplex signals.....	60
Figure 39 – Connectivity Method C supporting parallel signals for one-plug one-row transceivers.....	61
Figure 40 – Connectivity Method C supporting parallel signals for two-plug one-row transceivers.....	62
Figure 41 – Connectivity Method C supporting parallel signals for one-plug two-row transceivers and array cables that employ one row of fibers per plug.....	63
Figure 42 – Connectivity Method C supporting parallel signals for exclusively one-plug two-row transceivers and array patch cords and cables.....	64
Figure 43 – Connectivity Method U1 supporting multiple duplex signals.....	65
Figure 44 – Connectivity Method U2 supporting multiple duplex signals.....	66
Figure 45 – Example of OLTS reference measurement (P ₁) with one cord (multimode).....	73
Figure 46 – Example of a measurement (P ₂) when verifying OLTS cords (multimode).....	74

ANSI/TIA-568.3-E

Figure 47 – Example of OLTS reference measurement (P_1) with one cord (multimode) 75
Figure 48 – Example of a multimode attenuation measurement (P_2) 75
Figure 49 – Example of OLTS reference measurement (P_1) one launch cord (single-mode) 76
Figure 50 – Example attenuation measurement of single-mode cabling using an OLTS 77
Figure 51 – OTDR setup illustration of cabling test 78

FOREWORD

(This foreword is not a part of this Standard.)

This Standard was developed by TIA Subcommittee TR-42.11.

Approval of standard

This Standard was approved by the Telecommunications Industry Association (TIA) Subcommittee TR-42.11, TIA Engineering Committee TR-42, and the American National Standards Institute (ANSI).

ANSI and TIA review standards every 5 years. At that time, standards are reaffirmed, withdrawn, or revised according to the submitted updates. Updates to be included in the next revision should be sent to the committee chair or to ANSI or TIA.

Contributing organizations

More than 30 organizations within the telecommunications industry (including manufacturers, consultants, end users, and other organizations) contributed their expertise to the development of this Standard.

Documents superseded

This Standard replaces ANSI/TIA-568.3-D, published in October 2016, and incorporates content from ANSI/TIA-568.3-D-1, published in January 2019.

Significant technical changes from the previous edition

- Incorporates below content from ANSI/TIA-568.3-D-1.
 - Adds OM5 fiber cabling color designation.
 - Removes OM1 and OM2 fiber cabling color designations.
 - Modifies multimode reference-grade to standard-grade loss allowance to 0.5dB.
 - Moves OS1, OM1 and OM2 connector and adapter color identification to Annex as part of grandfathered specifications.
 - Adds ISO/IEC cabled fiber type designations (OS1a) to harmonize with and ISO/IEC 11801-1.
- Adds Type-A fiber transition definition and two new fiber transition variants – Type-U1 and Type-U2.
- Adds new connectivity Methods U1 and U2.
- Adds ANSI/TIA-492AAAF detail specifications for multimode optical fibers, which cancels and replaces ANSI/TIA-492AAAA, -492AAAB, -492AAAC, -492AAAD, and -492AAAE.
- Adds ANSI/TIA-492CAAC detail specifications for single-mode optical fibers, which cancels and replaces ANSI/TIA-492CAAA and ANSI/TIA-492CAAB.
- Specifies B-652.D or B-657 as acceptable fiber for Single-mode Indoor-Outdoor, Inside Plant and Outside Plant cables.
- Adds IEC optical fiber designations (A1-OM5, -OM4, -OM3) to harmonize with IEC 60793-2.
- Adds description and reference for testing cable plant terminated with array connectors.

Relationship to other TIA standards and documents

The following are related standards regarding various aspects of structured cabling that were created under TIA TR42.

- ANSI/TIA-568.0, *Generic Telecommunications Cabling for Customer Premises*
- ANSI/TIA-568.1, *Commercial Building Telecommunications Cabling Standard*
- ANSI/TIA-568.2, *Balanced Twisted-Pair Telecommunications Cabling and Components Standard*
- ANSI/TIA-568.4, *Broadband Coaxial Cabling and Components Standard*
- ANSI/TIA-569, *Telecommunications Pathways and Spaces*
- ANSI/TIA-570, *Residential Telecommunications Infrastructure Standard*
- ANSI/TIA-606, *Administration Standard for Telecommunications Infrastructure*
- ANSI/TIA-607, *Generic Telecommunications Bonding and Grounding (Earthing) for Customer Premises*
- ANSI/TIA-758, *Customer-Owned Outside Plant Telecommunications Infrastructure Standard*
- ANSI/TIA-862, *Structured Cabling Infrastructure Standard for Intelligent Building Systems*
- ANSI/TIA-942, *Telecommunications Infrastructure Standard for Data Centers*
- ANSI/TIA-1005, *Telecommunications Infrastructure Standard for Industrial Premises*
- ANSI/TIA-1179, *Healthcare Facility Telecommunications Infrastructure Standard*
- ANSI/TIA-4966, *Telecommunications Infrastructure for Educational Facilities*

Following is the schematic relationship between the ANSI/TIA-568 series and other relevant standards.

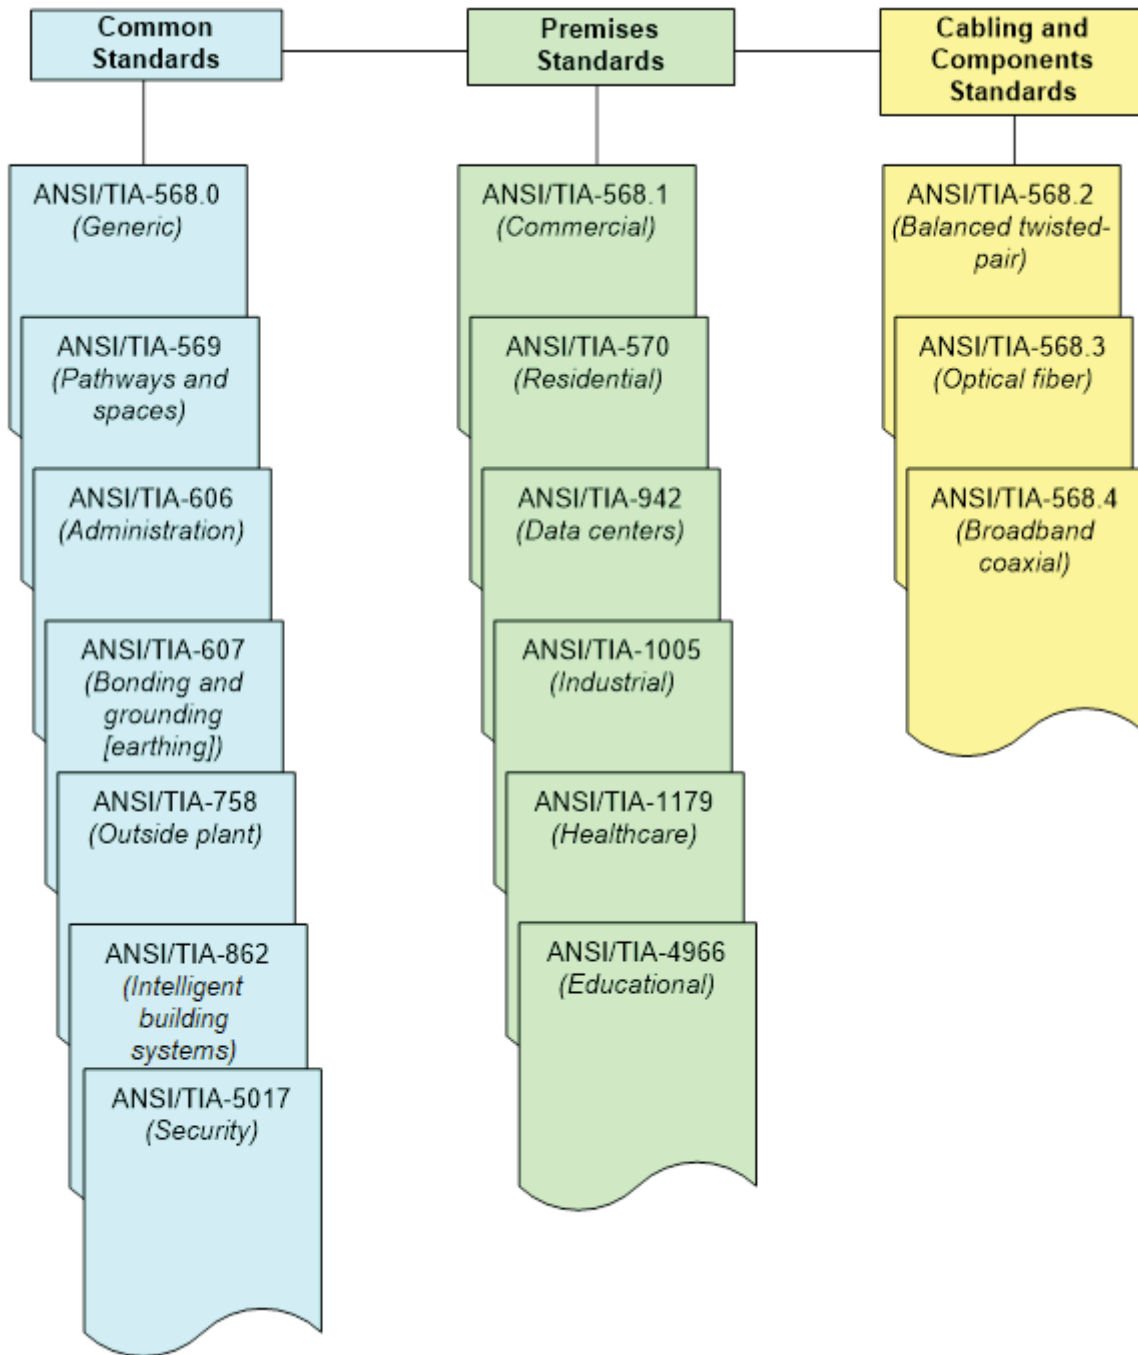


Figure 1 – Illustrative relationship between the ANSI/TIA-568 series and other relevant TIA standards

ANSI/TIA-568.3-E

The following documents produced by IEEE and the National Fire Protection Association (NFPA) may be useful to the reader:

- a) *National Electrical Safety Code*[®] (NESC[®]) (IEEE C2-2012)
- b) *National Electrical Code*[®] (NEC[®]) (NFPA 70-2014)

Useful supplements to this Standard are BICSI's *Telecommunications Distribution Methods Manual*, the *Outside Plant Design Reference Manual*, and the *Information Technology Systems Installation Methods Manual*. These manuals provide practices and methods by which many of the requirements of this Standard are implemented.

Other references are listed in Annex F.

Annexes

There are six annexes to this Standard. Annex A, Annex B, Annex C and Annex D are normative and considered requirements of this Standard. Annex E and Annex F are informative and not considered requirements of this Standard.

Purpose

The purpose of this Standard is to specify cabling and component requirements for premises optical fiber cabling. It is intended to be used by manufacturers; however, manufacturers, users, designers and installers will find this Standard useful. Additionally, this Standard is intended to be used as a reference by the suites of common standards and premises cabling standards listed in the Foreword.

Specification of criteria

Two categories of criteria are specified: mandatory and advisory. The mandatory requirements are designated by the word "shall"; advisory requirements are designated by the words "should", "may", or "desirable" which are used interchangeably in this Standard.

Mandatory criteria generally apply to protection, performance, administration and compatibility; they specify minimally acceptable requirements. Advisory criteria are presented when their attainment may enhance the general performance of the cabling system in all its contemplated applications.

A note in the text, table, or figure is used for emphasis or offering informative suggestions, or providing additional information.

Metric equivalents of United States (US) customary units

The dimensions in this Standard are metric or US customary with approximate conversion to the other.

Life of the Standard

This Standard is a living document. The criteria contained in this Standard are subject to revisions and updating as warranted by advances in building construction techniques and telecommunications technology.

1 SCOPE

This Standard is applicable to premises optical fiber cabling and components. Specified in this Standard are requirements for components (e.g., cable, connectors, connecting hardware, patch cords), connectivity and cabling. Test and measurement requirements are also incorporated into this Standard.

2 NORMATIVE REFERENCES

The following standards contain provisions that, through reference in this text, constitute provisions of this Standard. At the time of publication, the editions indicated were valid. All standards are subject to revision, and parties to agreements based on this Standard are encouraged to investigate the possibility of applying the most recent editions of the standards.

Fiber optic test procedures (FOTPs):

- TIA-455-1, *Cable Flexing for Fiber Optic Interconnecting Devices*
- TIA-455-2, *Impact Test Measurements for Fiber Optic Devices*
- TIA-455-4, *Fiber Optic Component Temperature Life Test*
- TIA-455-5, *Humidity Test Procedure for Fiber Optic Components*
- TIA-455-6, *Cable Retention Test Procedure for Fiber Optic Cable Interconnecting Devices*
- TIA-455-8, *Measurement of Splice or Connector Loss and Reflectance Using an OTDR*
- TIA-455-13, *Visual and Mechanical Inspection of Fiber Optic Components, Devices, and Assemblies*
- TIA-455-21, *Mating Durability Of Fiber Optic Interconnecting Devices*
- TIA-455-34, *Interconnection Device Insertion Loss Test*
- TIA-455-36, *Twist Test For Fiber Optic Connecting Devices*
- ANSI/TIA-455-78, *Optical Fibres Part 1-40: Measurement Methods and Test Procedures – Attenuation*
- TIA-455-107, *Determination of Component Reflectance or Link/System Return Loss Using a Loss Test Set*
- ANSI/TIA-455-171, *Attenuation by Substitution Measurement for Short-Length Multimode Graded-Index and Single-Mode Optical Fiber Cable Assemblies*
- TIA-455-185, *Strength of Coupling Mechanism for Fiber Optic Interconnecting Devices*
- TIA-455-188, *Low-Temperature Testing of Fiber Optic Components*

Fiber standards:

- ANSI/TIA-492AAAF, *Detail Specification for Class 1a Graded-Index Multimode Optical Fibers; Modifications of IEC 60793-2-10:2019, Optical Fibres – Part 2-10: Product Specifications – Sectional Specification for Category A1 Multimode Fibres*
- ANSI/TIA-492CAAC, *Sectional Specification for Class B Single-Mode Optical Fibers*

Cabled fiber standards:

- ANSI/TIA-598, *Optical Fiber Cable Color Coding*
- ICEA S-83-596, *Standard for Indoor Optical Fiber Cable*
- ICEA S-87-640, *Standard for Optical Fiber Outside Plant Communications Cable*